

MNS *iS* Motor Control Center Interface Manual Web Interface System Release V8.1



Power and productivity
for a better world™



MNS is a registered trademark.

Other trademarks and trade names reside with their respective owners.

This document relates to the MNS iS System Release 8.1.

The information in this document is subject to change without notice and should not be construed as a commitment by ABB. ABB assumes no responsibility for any errors that may appear in this document.

In no event shall ABB be liable for direct, indirect, special, incidental, or consequential damages of any nature or kind arising from the use of this document, nor shall ABB be liable for incidental or consequential damages arising from use of any software or hardware described in this document.

This document and parts thereof must not be reproduced or copied without ABB's written permission, and the contents thereof must not be imparted to a third party nor be used for any unauthorized purpose. The software described in this document is furnished under a license and may be used, copied, or disclosed only in accordance with the terms of such license.

All rights reserved.

Copyright © 2015 ABB Automation Products GmbH, Ladenburg, Germany

Table of content

General 4

- Target Group4
- Use of Warning, Caution, Information and Tip icon4
- Terminology5
- Related Documentation.....9
- Related System Version.....9
- Document Revision History.....9

Introduction..... 10

Installation..... 11

- Mechanical and electrical installation11
- Software installation11
- Hardware installation.....11

Operation..... 12

- Getting started12
- Classic WEB Layout.....13
 - Cubicle View 15
 - Side Menu..... 15
 - Cubicle scheme..... 16
 - Navigation..... 18
 - Operate view..... 22
 - Alarms and Trips..... 27
 - Status Information 33
 - MLink Device setup..... 39
 - Redundancy..... 56
- Modern WEB Layout.....57
 - Cubicle View 59
 - Navigation..... 62
 - Device Details Page..... 64
 - Redundancy..... 104
- MView ID105
- Automatic Logoff106
- WEB Server Interface settings107

Troubleshooting and Maintenance 108

General

Target Group

This document describes communication and control interfaces used in MNS iS. The manual is primarily intended for those requiring information on accessing information and data provided from MNS iS. Furthermore the document provides information for integration of MNS iS as Fieldbus component into PLC or higher level Process Control Systems to control system and application engineers.

It is assumed that the reader of this manual is familiar with basic terms of Fieldbus and control communication (e.g. basic knowledge about PROFIBUS, Modbus etc.).

Use of Warning, Caution, Information and Tip icon

This publication includes **Warning**, **Caution**, and **Information** icons where appropriate to point out safety related or other important information. It also includes **Tip** icons to point out useful hints to the reader. The corresponding symbols should be interpreted as follows:



The electrical warning icon indicates the presence of a hazard that could result in *electrical shock*.



The warning icon indicates the presence of a hazard that could result in *personal injury*.



The caution icon indicates important information or warnings related to the concept discussed in the text. It might indicate the presence of a hazard that could result in *corruption of software or damage to equipment/property*.



The information icon alerts the reader to pertinent facts and conditions.



The tip icon indicates advice on, for example, how to design your project or how to use a certain function

Although **Warning** notices are related to personal injury, and **Caution** notices are associated with equipment or property damage, it should be understood that the operation of damaged equipment could, under certain operational conditions, result in impaired process performance leading to personal injury or death. It is, therefore, imperative that you comply fully with all **Warning** and **Caution** notices.

Terminology

List of the terms, acronyms, abbreviations and definitions that the document uses.

Abbreviation	Term	Description
	Aspect Object	ABB technology. An Aspect Object is a computer representation of a real object such as a pump, a valve, an order or a virtual object such as a service or an object type. An Aspect Object is described by its aspects and is organized in structures.
	Alarm	Alarm is defined as status transition from any state to abnormal state. Status transition to abnormal state can be data crossing over the pre-defined alarm limit.
	Bus Local	A Control Access term describing that the <i>MControl</i> accepts its commands from a device on the switchgear control network, e.g. the Web Interface, <i>MView</i> .
COTS	Commercial off the shelf	Commercial off the shelf product, term to describe products available on the market, ready to use
DCS	Distributed Control System	See also PCS
DTM	Device Type Manager	Software module used to manage devices via Fieldbus (e.g. PROFIBUS) using frame application environment (e.g. PactWare, ABB Fieldbus Builder etc.)
Eth.	Ethernet	Ethernet is a local area network (LAN) technology. The Ethernet standard specifies the physical medium, access control rules and the message frames.
	Event	An event is a status transition from one state to another. It can be defined as alarm, if the state is defined as abnormal or as warning as a pre-alarm state.
FD	Field Device	Term for devices connected to the Fieldbus (e.g. motor control units or circuit breaker protection)
GSD file	Geräte Stamm Datei (German abbreviation)	A hardware description file for a PROFIBUS-DP or PROFIBUS-DP/V1 slave type
GPS	Global Positioning System	System to detect local position, universal time and time zone, GPS technology provides accurate time to a system
	Hardware Local	A Control Access term describing that the <i>MControl</i> accepts its commands from the Hardwired inputs, when the respective Local control input is set to true.

Abbreviation	Term	Description
HMI	Human Machine Interface	Generic expression
LVS	Low voltage switchgear	A factory built assembly built to conform with IEC 60439-1
MCC	Motor Control Centre	Common term for switchgear used for motor control and protection.
MNS		Modular Low Voltage Switchgear family from ABB
MNS <i>iS</i>		The integrated intelligent switchgear solution from ABB
	<i>MStart</i> <i>MFeed</i> <i>MControl</i> <i>MLink</i> <i>MView</i> <i>MNavigate</i>	MNS <i>iS</i> components integrated in the switchgear, see the MNS <i>iS</i> System Guide for technical details
	MODBUS	Fieldbus communication protocol
	MODBUS RTU	Fieldbus communication protocol
	Motor Starter	Consists of motor controller and electrical components to control and protect a motor, part of Motor Control Center
NLS	Native Language Support	Providing the ability to change the language of software tools in order to support native languages (English is basis, others are optional)
OPC		OLE for Process Control, an industrial standard for exchange of information between components and process control application
PCS	Process Control System	High level process control system
PLC	Programmable Local Controller	Low level control unit
	PROFIBUS-DP	Fieldbus communication protocol with cyclic data transfer (V0).
	PROFIBUS-DP/V1	Fieldbus communication protocol, extension of PROFIBUS-DP allowing acyclic data transfer and multi master (V1).

Abbreviation	Term	Description
	PROFIBUS-DP/V2	Fieldbus communication protocol, extension of PROFIBUS-DP allowing time stamp and communication between master and slave (V2).
	PROFINET	PROFINET is an open standard for Industrial Ethernet and standardized in IEC 61158 and IEC 61784.
PNIO	PROFINET IO	PROFINET for decentralized periphery and distributed automation
RCU	Remote Control Unit	Local control unit with pushbutton and indicator to operate a device (e.g. motor) from field level.
RS232		Standard No. 232 for PC communication, established by EIA (Electronics Industries Association, USA)
RS485		Communication interface standard from EIA (Electronics Industries Association, USA), operating on voltages between 0V and +5V. RS-485 is more noise resistant than RS-232C, handles data transmission over longer distances, and can drive more receivers.
RTC	Real Time Clock	Integrated clock function in devices used to generate time and date information if a remote clock system is not present
	Software Local	A Control Access term describing that the <i>MControl</i> accepts its commands from the hardwired inputs as a result of either the PCS or <i>MView</i> passing the Control Access Authority to Soft-Local. Note: Does not require the hardwired local input to be set to true.
SNTP	Simple Network Time Protocol	A protocol used for time synchronization in Control Network through Ethernet
	Switchgear Bus Network	Term used to describe the internal switchgear communication network, between <i>MLink</i> and <i>MControl</i> .
TCP/IP	Transmission Control Protocol / Internet Protocol	TCP/IP is a high-level connection oriented , reliable, full duplex communication protocol developed for integration of the heterogenous systems.
	Trip	A consequence of an alarm activated or an external trip command from another device to stop the motor or trip the circuit breaker.

Abbreviation	Term	Description
UTC	Coordinated Universal Time	Coordinated Universal Time is the international time standard. It is the current term for what was commonly referred to as Greenwich Meridian Time (GMT). Zero (0) hours UTC is midnight in Greenwich England, which lies on the zero longitudinal meridian. Universal time is based on a 24 hour clock.
	Warning	A warning is defined as status transition from any state to pre-alarm state to inform in advance before an alarm level is reached.

Related Documentation

MNS *iS*

1TGC910211 M0203 MNS *iS* Interface Manual *MLink*, Release 7.0
1TGC910111 M0201 MNS *iS* *MLink* Upgrade Kit Manual
1TGC910231 M0203 MNS *iS* Interface Manual OPC Server, Release 7.3
1TGC910241 M0201 MNS *iS* Interface Manual Profibus, Release 7.0
1TGC910251 M0202 MNS *iS* Interface Manual Modbus, Release 7.0
1TGC910292 M0201 MNS *iS* Interface Manual PROFINET IO, Release 7.6
1TGC910283 M0201 MNS *iS* *MControl* Interface Manual Profibus Direct, Release 7.6
1TGC910261 M0201 MNS *iS* Interface Manual Redundancy, Release 7.0
1TGC910271 M0202 MNS *iS* *MConnect* Interface Manual, Release 7.0
1TGC910001 B0204 MNS *iS* System Guide
1TGC910201 M0201 MNS *iS* Quick Guide Installation and System Setup, Release 7.0
1TGC910090 M0209 *MNavigate* Help file V7.6
1TGC910018 M0208 MNS *iS* ATEX – Enhancements for Safety

Related System Version

The content of this document is related to MNS *iS* System Release 7.6.

The described functions are designed but may not be fully implemented in all details. Please refer to the current system guides and release notes regarding possible restrictions.

Document Revision History

Introduction

This document gives a short introduction of the web server and its features. The web server is an option in MNS *iS* and it may not be available in each particular installation of MNS *iS*.

There are different possibilities to access the *MLink*. One possibility is using a web interface, e.g. Internet Explorer or Mozilla Firefox. The web interface can run on thin clients like Laptop PC or Desktop PC. Another possibility is the use of *MView* panel which is an option for the MNS *iS* cubicle.

All user actions can be performed with a mouse or a touch screen - a keyboard does not need to be connected.

The web server provides the following user functions (depending on user rights):

- Access to any *MLink* in the network
- Operation of all *MControl* belonging to a *MLink*
- Supervision of process values e.g. currents, voltages, switch status, etc.
- Sending commands to the *MControl* e.g. start, stop, open, close, etc.
- Display alarm and events, reset alarms
- Display of *MControl* parameters
- Setting the time and date of the *MLink*
- Showing *MLink* application details
- Upload of alarm, trip and event messages from *MControl* internal memory

Configuration parameters of the web server are stored in parameter files located on *MNavigate*. All required files can be downloaded by using *MNavigate*.

To use *MView* (or a PC with web interface) to access the web server in *MLink* a list with user names and passwords as well user rights (user profile) must be configured and loaded into *MLink* via *MNavigate*.

For further details refer to the MNS *iS* *MNavigate* help file.

Installation

Mechanical and electrical installation



For details on mechanical and electrical installation please refer to the MNS iS MLink Interface manual.

Software installation

If the MView panel is used, all required software is installed from factory. No further software installation is required.

If a 3rd party panel or web interface on a PC is used, please ensure that software requirements as listed below are followed.

- Web browser
 - Supporting XHTML 1.0, CSS 2.0, JavaScript 1.0, DOM 1.0, XML HTTP Request and Frames. This is usually supported by all standard web interfaces.
 - Cookies must be enabled

Hardware installation

A TCP/IP connection to the Switchgear Control Network must be available. Check the settings of the IP address and match the settings of the Switchgear Control Network. For web access connector LAN2 of MLink device has to be used. For details see the MNS iS MLink Interface Manual, see reference hereunder.

Hardware ID numbers	1TGE1020x9Rxxxx	1TGE120021R0x10
MLink Types		
Hardware available for MNS iS Versions	up to V6.0	from V6.1 onwards
MNS iS Interface Manual MLink	1TGC 91012x M020x	1TGC 910210 M020x

Operation

This chapter describes how to operate the switchgear using the web server.

Beginning with MNSiS Release 7.6 a WEB page layout selection is implemented. This document is describing both of them in 2 main chapters:

- Classic WEB Layout
- Modern WEB Layout

The WEB layout can be changed by using MNavigate. Here a regarding parameter setting can be done and after download the selected page layout gets activated. For information, see document MNS iS MNavigate Manual

Getting started

The first step is to enter the IP address (e.g. http://192.168.200.100) of any MLink in the network into the interface address bar. Depending on the parameter setting **Layout** (For more details please refer to the MNavigate Help File) one of the following screens will appear. In both a list of all available MLinks is shown.

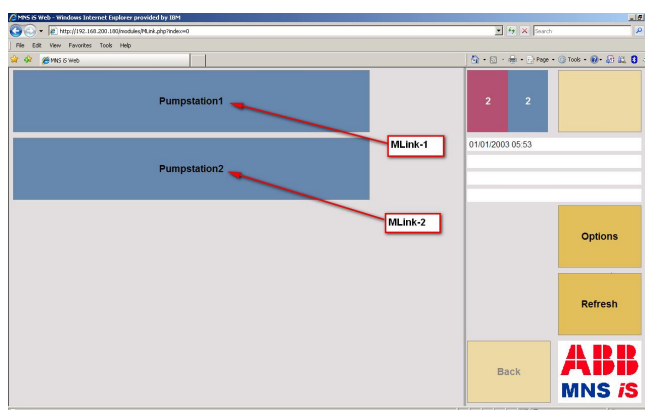


Figure 1 - MLink list view – Classic WEB Layout

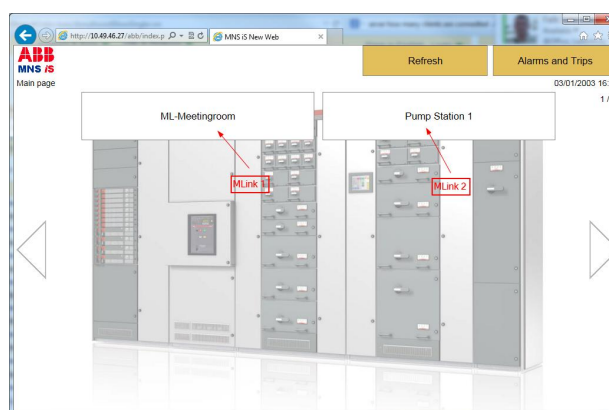




Figure 2 - MLink list view – Modern WEB Layout


Note: If MView is used it is not required to enter the IP address into the address bar. Before the first use MView has to be configured to access the desired MLink automatically. This configuration can vary based upon the type of interface (touch panel or pc) used for the particular installation.

In situations where redundant MLink are utilized only the active MLink is displayed.

 If this list does not show all MLink, please check the MView ID. This MView ID enables the user to create logical networks. Only MLink parameterized with the MView ID for that particular network segment will be displayed. For more information please see chapter [MView ID](#)

 Due to performance it is recommended to login with maximum 2 internet browsers to 1 MLink simultaneously.

Classic WEB Layout

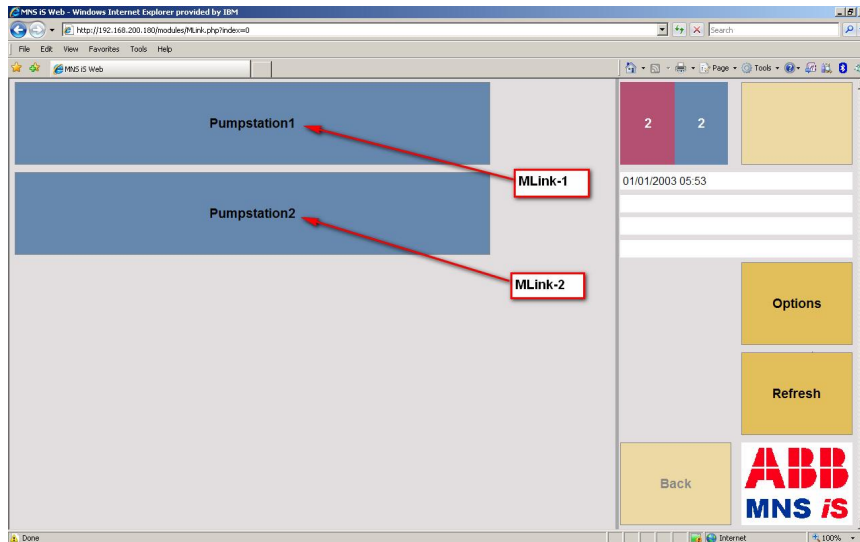

After choosing one MLink by clicking on the related button (e.g. “Pump Station 1”) the following screen appears. This screen is only visible after accessing the first time after power up. The device is creating an internal database containing all system related information. The time for creating that database depends on the number of configured MControls.

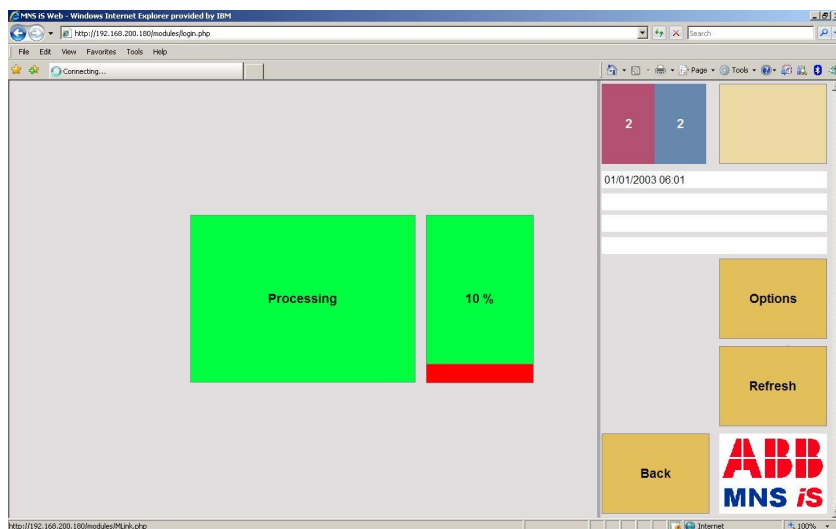


Figure 3 Progress indication

Afterwards a logon screen appears:

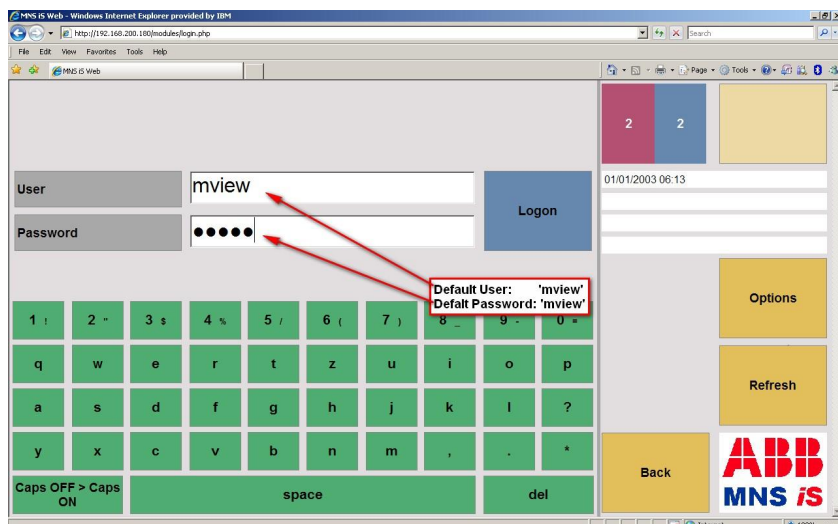


Figure 4 - Logon view

User and password must be entered by the virtual keyboard in the window (on MView) or optionally by a real keyboard if present. After selecting the Logon button the entered user and password are checked. For user administration, see document MNS iS MNavigate Manual. If the password is correct the user is allowed to access the switchgear view:

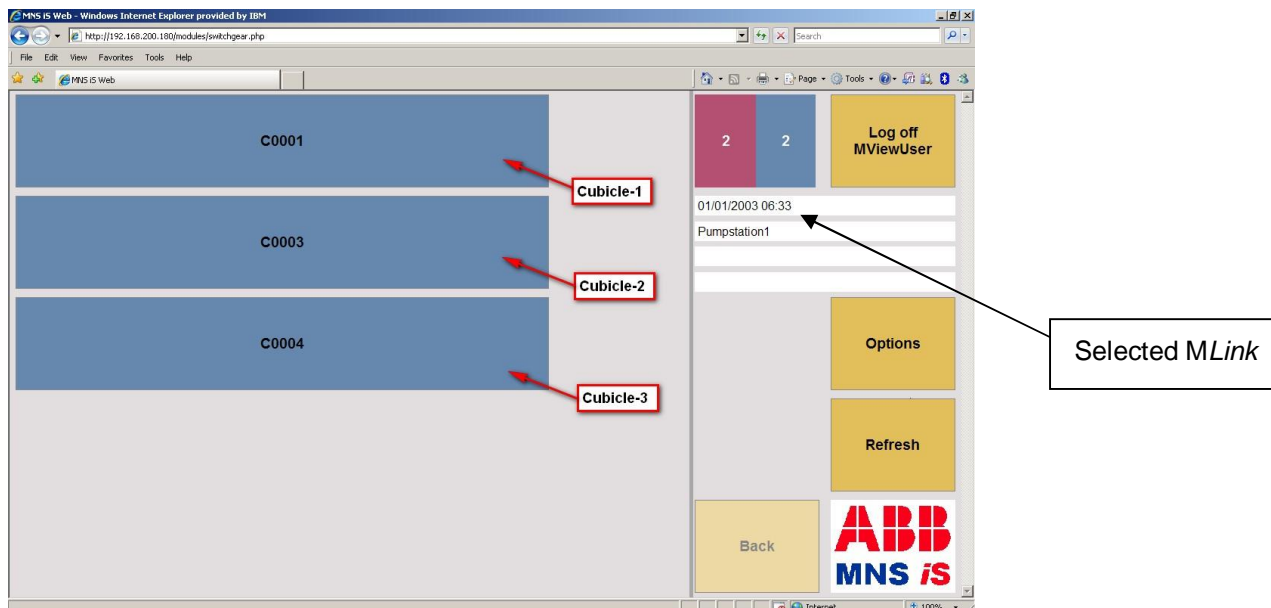


Figure 5 - Switchgear view

This view shows a list of all cubicles containing configured MControls. This list could consist of up to 7 entries (cubicles). After choosing one cubicle (e.g. "B101-01") the cubicle front view of the selected cubicle is displayed.

Cubicle View

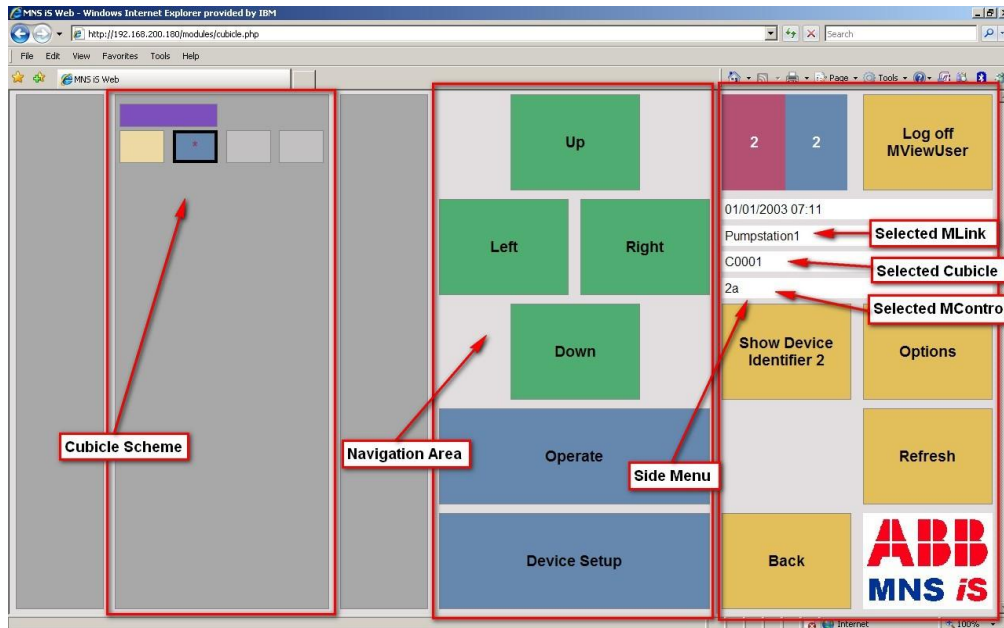


Figure 6 - Cubicle view*

* Colors shown are from the standard MNS iS color profile.

Side Menu

In the example in **Figure 50** the menu and navigation button are located in the right part of the screen (default). For lefties the menu can be located on the left side, Error! Reference source not found. by setting the corresponding flag in the user definition in *MNavigate*.

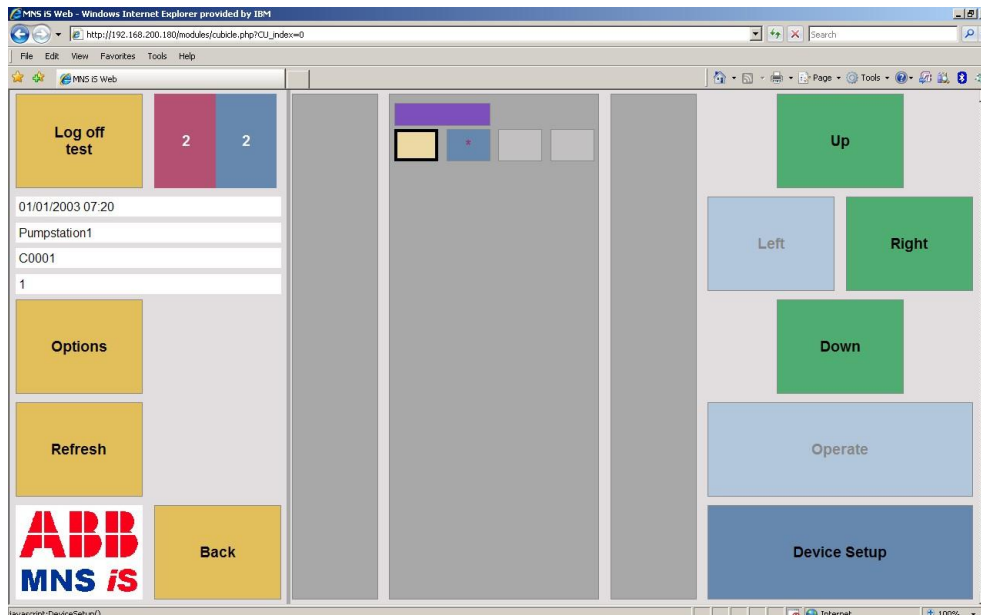


Figure 7 Cubicle view with menu left

The elements of the menu have the following functions (top down):

- “Log off <user name>”: This button shows the user who is logged in. By clicking the button the user is logged off and gets back to the *MLink* list view, see **Figure 2**.
- ABB Logo: By clicking on the logo the version of the web server is indicated
- Text area with 4 lines. This text field indicates the current position in the navigation hierarchy:
 1. Current system time
 2. Name of the *MLink*
 3. Name of the cubicle
 4. Name of the *MControl*
- “Options”: By clicking this button additional buttons appear, providing the following options:
 1. “Show Device Identifier <x>”: The *MLink* and *MControl* devices have the possibility of 3 identifiers. This button allows switching to the next identifier (x ranges from 1 to 3)
 2. “Show all Alarms” / “Show current Alarms only”: This option is used for alarm view only. If option “Show all Alarms” is selected, all possible alarms / events are shown and only active alarms / events are highlighted
- “Refresh”: Refresh the current view
- “Back”: Go back to the last visited view. This button is inactive in **Figure 2** (start view) and **Figure 49 - Switchgear view** (go back by “Log off <user name>”)

Cubicle scheme

Apart from the menu the view consists of a scheme of the cubicle and a navigation area.

The cubicle scheme shows the positions of the devices in the cubicle. The upper one with the default plum colour is the *MLink*, the remaining are the positions of the configured *MStarts*. The colours depict the status of the combined *MControl* and *MStart* combination.











Figure 8 – Cubicle view, cubicle scheme	Blue ^e		Online and tripped
	Orange incl. red star ^e		Online, switched on with alarm
 All colours that are highlighted with an ^e can be edited in <i>MNavigate</i> with the Web Colour Settings function. For more details please refer to the <i>MNavigate</i> Help File	Green incl. red star ^e		Online, switched off with alarm
	Blue incl. red star ^e		Online, tripped with alarm
	Grey incl. red cross		Configured according to DeviceList but currently absent, and Application file missing (<i>MControl</i> application download required).
	white incl. red cross		Online, Application file missing (<i>MControl</i> application download required)

* Colors shown are from the standard MNS iS color profile.

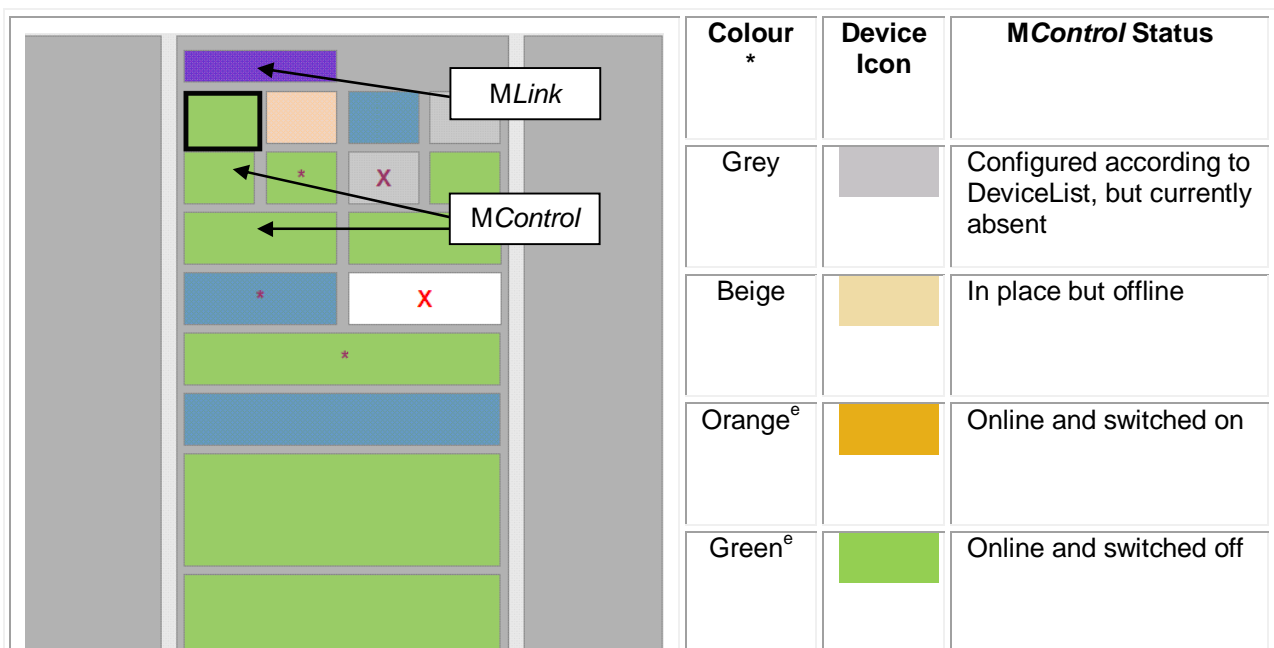Navigation

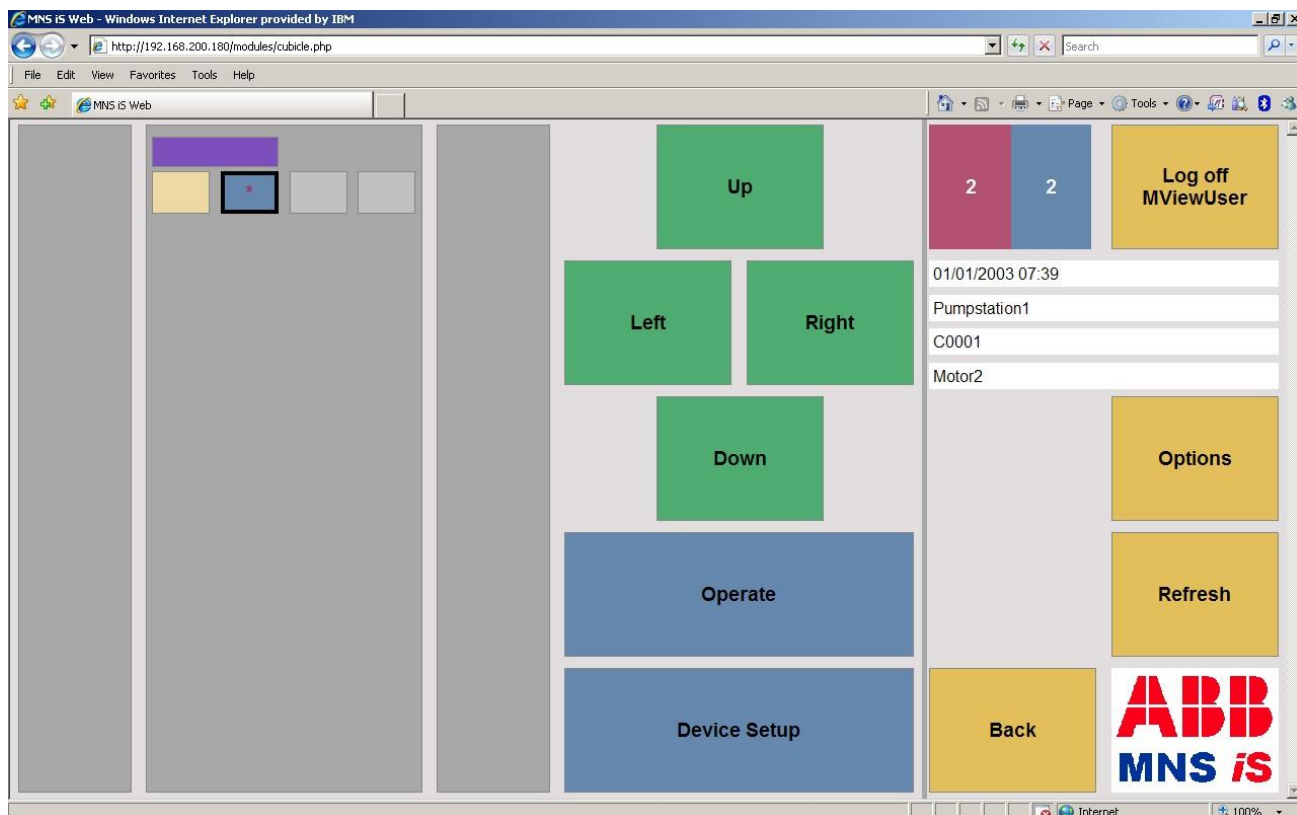


Figure 9 - Cubicle Navigation overview

Selection of a particular device is performed with the use of the four directional navigation keys, individual devices are selected by highlighting them with the focus, the selected device is the device with the black frame.



MControl with focus

Information relating to the highlighted device is shown in the text area on the right hand side of the screen.

Device names / information

01/01/2003 07:39
Pumpstation1
C0001
Motor2

Description

Time and Date
Name of MLink
Name of Cubicle
Name of Module

The information can change when utilising the ‘Show Device Identifier, this enables the user to toggle the device identifiers associated with the MControls.

Dependant upon the requirements different options exist:

- When the MLink is highlighted it is only possible to select [Device Setup](#)
- When MControl is selected both [Device Setup](#) and [Operate](#) are available
- Selecting Operate for the MControl is only possible when the device is ‘Online’. For more information on the MControl status please review to the [Cubicle View](#).

MControl Device setup

The MControl Device setup provides the following functions dependant upon the User Profile configured in MNavigate. The Device setup page is navigated to from the [Cubicle View](#) page

In some cases the shown setup menu items may not be available (disabled) due to the user profile and the MControl status. Disabled setup items are shown light blue.








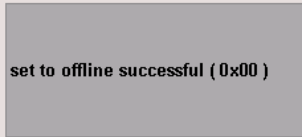



Figure 10 MControl Device Setup screen

Actions and Options for MControl Device Setup

	Sets the MControl to the Offline condition		Sets the MControl to the Online condition
	Downloads the Application to the MControl		Downloads the Parameter to the MControl
	Downloads the Configuration settings to the MControl		Enables the user to view the Parameter and Configuration settings of the MControl
	If an operation is performed a result message is then displayed at the bottom of the screen		
	"Locate Module" is enabled when MControl is ONLINE and disabled when MControl is OFFLINE. For details about functionality please refer section Error! Reference source not found.		

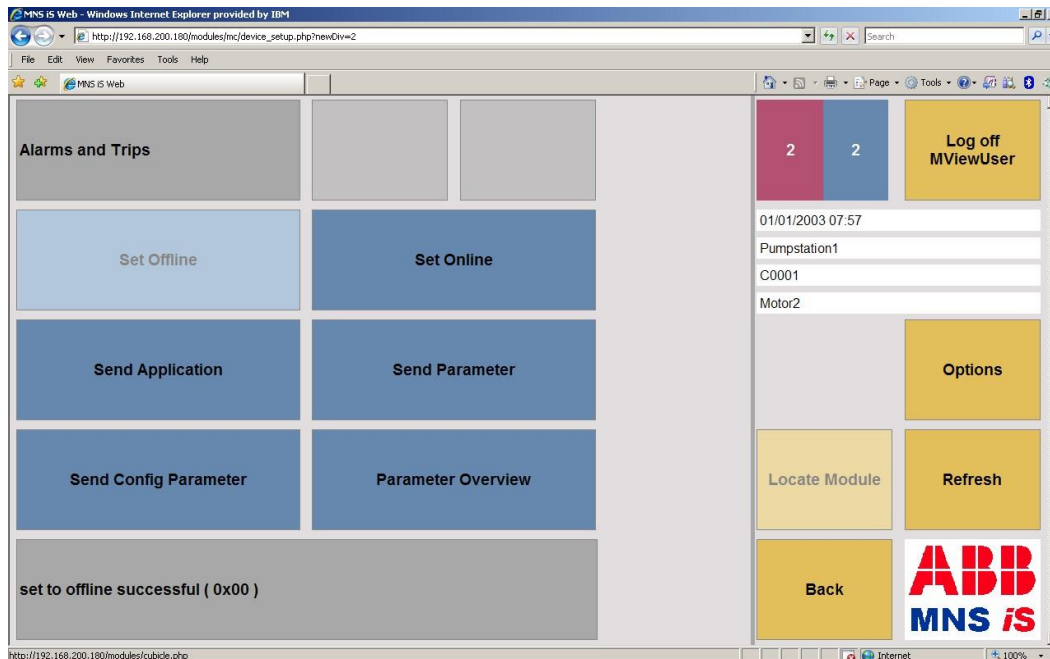Parameter Overview

If the user selects the option MC Parameter overview the parameters of the selected MControl are shown.

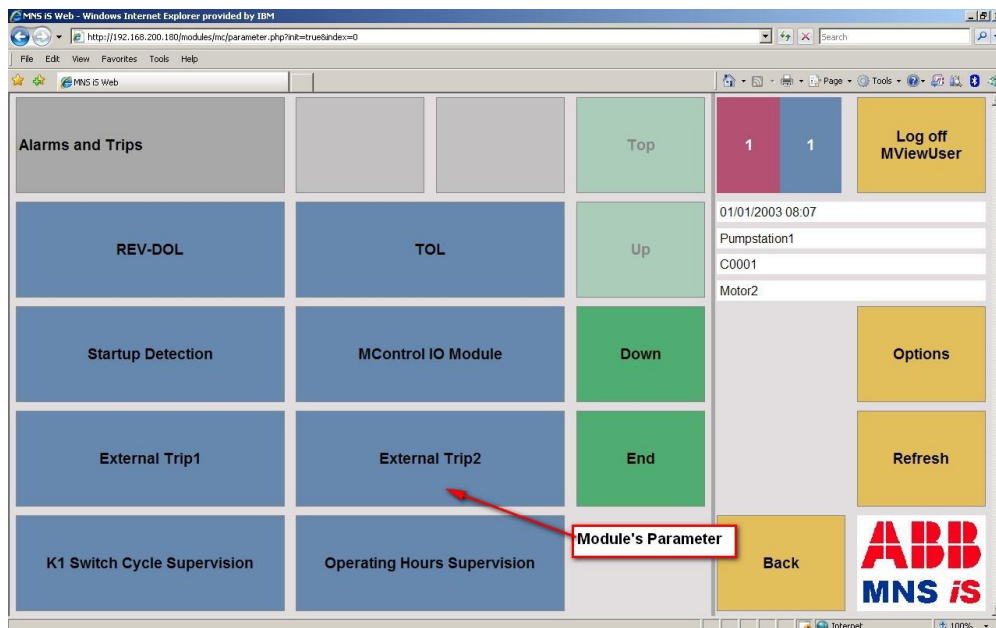


Figure 11 MControl parameter module overview

After selecting the parameter module a detailed overview appears.

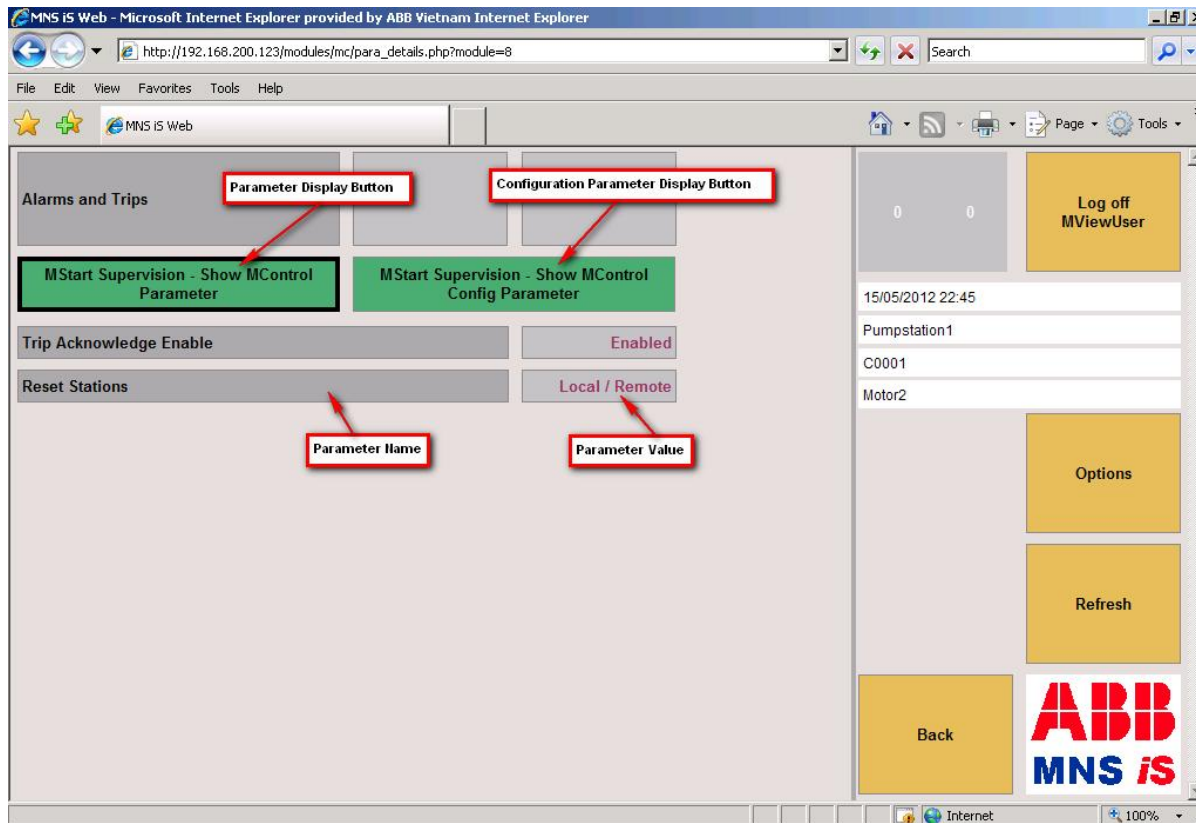


Figure 12 MControl parameter details

When user selects 'Show MControl Config Parameter' the following screen appears:


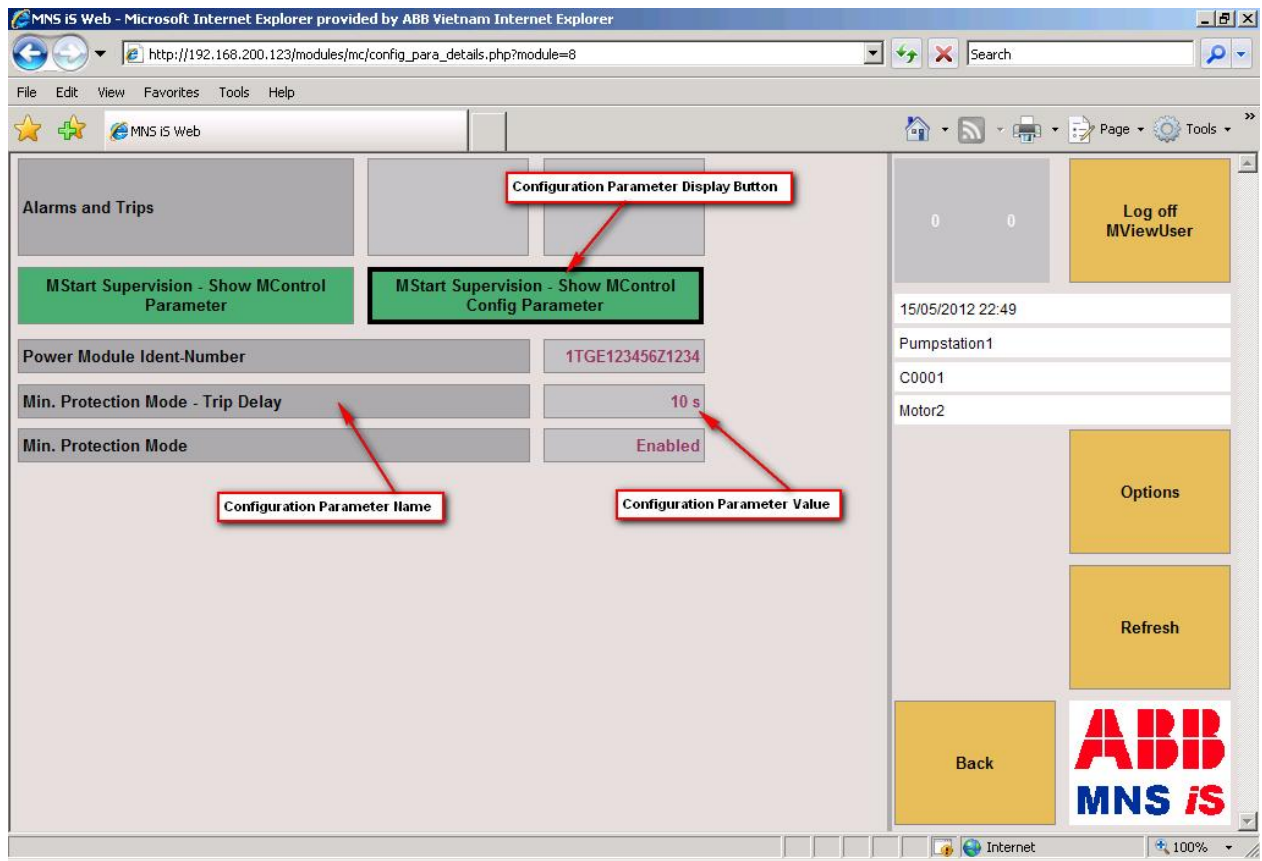


Figure 13.1 MControl configuration parameter details

Use the Back button to return to the cubicle view



Operate view

The view below is the focal point for operating and monitoring the MControl / MStart.

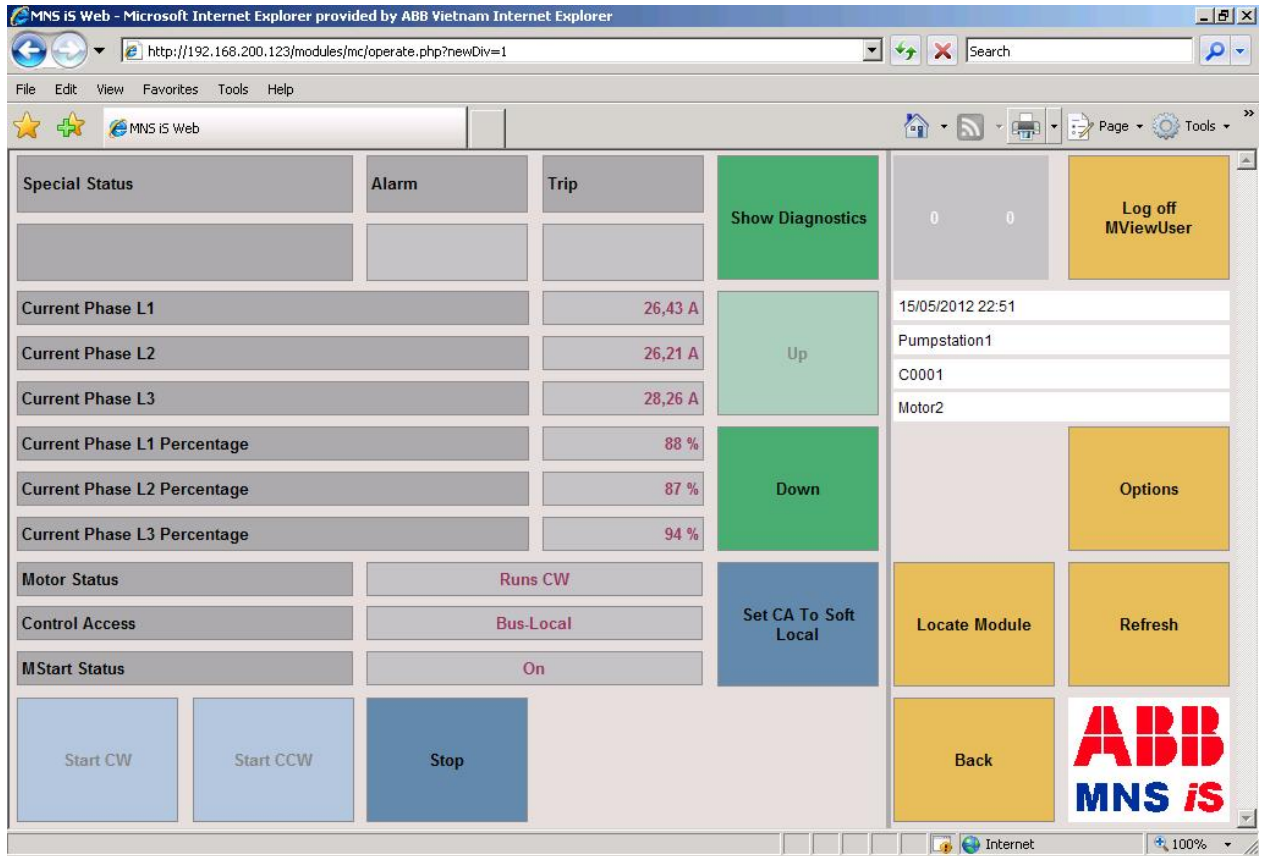


Figure 14 - Operate view

This screen enables interrogation and operation as follows:

Control	On / Off and Control Access Handling
Alarm & Trip Interrogation	Viewing of Alarm & Trip status together with Event monitoring
Status Information	Operation and Maintenance information and diagnostics
Process Variables	Interrogation of Process and Measurement values
Special Status Information	Indication of running Proof Test & Indication of activated Minimum Protection Mode

Controlling a device

To control a single device from the Web Interface, the following is required;

- The MControl must be in the ['Online'](#) state.
- The User Profile created in MNavigate must allow 'Switching' commands to be sent.
- The [Motor Status](#) must be Stopped Ready to Start, Running or Tripped.
- The [MStart Status](#) must be either Main Switch On or Test Position.
- The [Control Access](#) status must be set to Bus-Local.

Select before operate

For safety reasons the active buttons (for sending commands to MControl) work according to “select before operate” in two steps:

'Click' Start CW

'Click' Start CW

Current Phase L1	0,00 A		
Current Phase L2	0,00 A		
Current Phase L3	0,00 A		
Percentage Current Phase L1	0 %		
Percentage Current Phase L2	0 %		
Percentage Current Phase L3	0 %		
Motor Status	Stopped ready to start		
Control Access	Bus-Local		
MStart Status	MainSwitchOn		
Start CW	Start CCW	Stop	

Current Phase L1	0,00 A		
Current Phase L2	0,00 A		
Current Phase L3	0,00 A		
Percentage Current Phase L1	0 %		
Percentage Current Phase L2	0 %		
Percentage Current Phase L3	0 %		
Motor Status	Stopped ready to start		
Control Access	Bus-Local		
MStart Status	MainSwitchOn		
Start CW	Start CCW	Stop	

Current Phase L1	48,47 A		
Current Phase L2	48,99 A		
Current Phase L3	48,76 A		
Percentage Current Phase L1	96 %		
Percentage Current Phase L2	97 %		
Percentage Current Phase L3	97 %		
Motor Status	Running		
Control Access	Bus-Local		
MStart Status	MainSwitchOn		
Start CW	Start CCW	Stop	

The example left shows the sequence required to start a motor in the CW direction from the MView, for this to be possible the Control Access must be in the Bus-Local state.

With the first click the button is selected and adopts another colour (dark blue). Motor Status indication remains unchanged.

With a second click on the selected button the command is finally sent to the MControl.

Motor Status then changes to ‘Running’ and current flow is indicated.

Command Selector



Device specific commands can be sent to the MControl. In this example (motor control) commands like “Start CW”, “Start CCW” or “Stop” are listed. “Stop” is inactive (light blue) since the motor is stopped. Other factors influencing buttons to be inactive are the control access, user rights, and parameterisation and configuration of the modules

Locate Module

Locate module function enables the user to check availability of physical MStart in switchgear panel. *Locate module* function is available at “Operate” page & “Device Setup” page under menu column next to *Refresh button*. The functionality can be used to check the physical location of MStart module. As soon as the button is pressed the LED’s on the front of MStart are blinking for a dedicated time interval (40 seconds).

When MControl connected to MStart is ONLINE, Locate Module button will be enabled and if MControl is OFFLINE Locate Module button will be disabled.

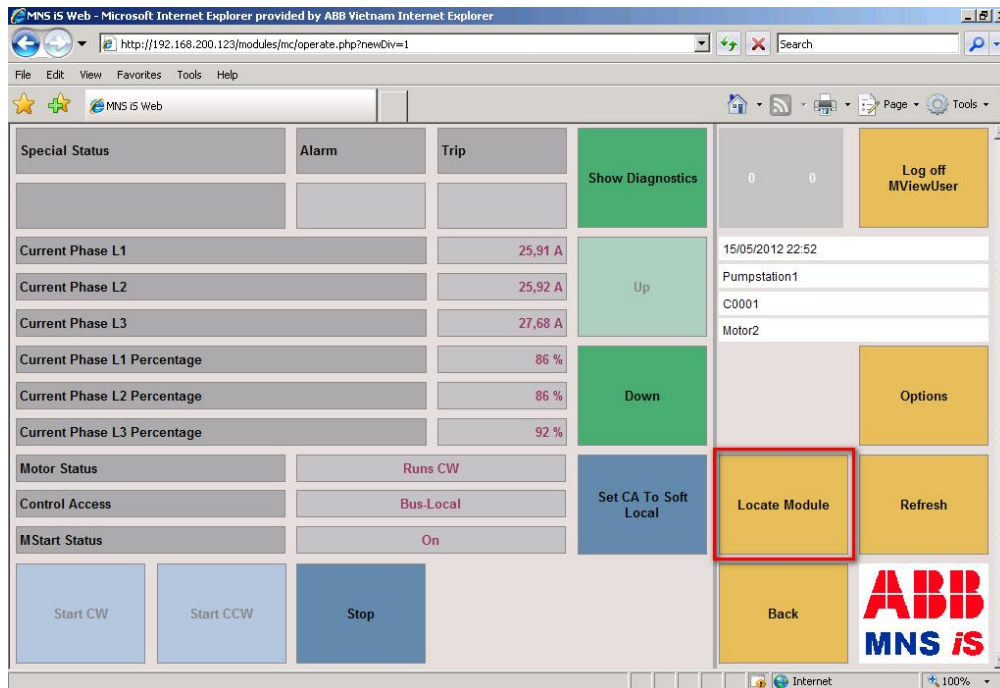


Figure 15: Locate Module Function in Operate Page

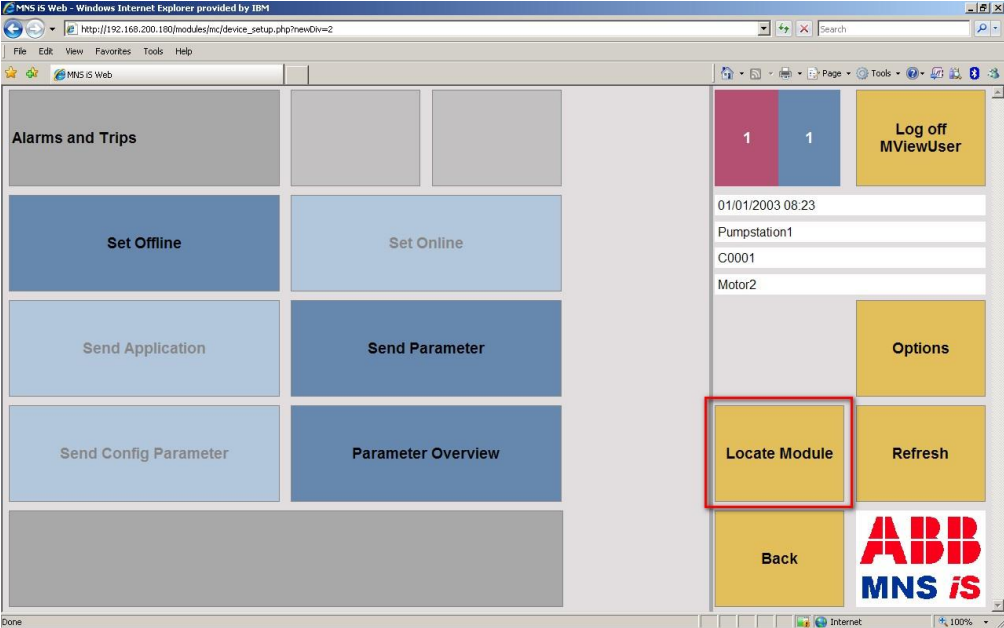


Figure 16: Locate Module in MControl Device Setup page


Alarms and Trips

The top section of the [Operate View](#) is where the Alarms and Trip are indicated in the Web Interface. The examples below are shown with the standard MNS iS color profile, these colors may be edited in MNavigate to suit plant operating requirements.




The Alarm indication is .to the left and Trip indication is to the right. Indication is given if any Alarm or Trip is active, for more detailed interrogation navigate to the [Alarm View](#) by selecting the active Alarm or Trip area.


The following basic possibilities exist for Alarm and Trip indication; other combinations may be displayed due the actual plant operational conditions.

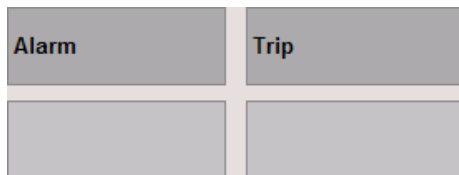


No Alarms or Trips active

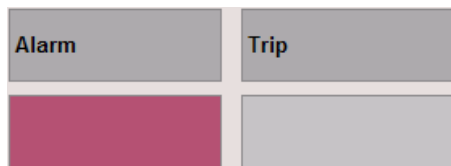

Any active Alarm

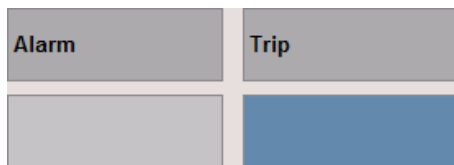


Any active Trip

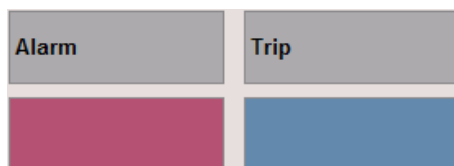

Active Alarm and Active Trip




Trip has been Acknowledged

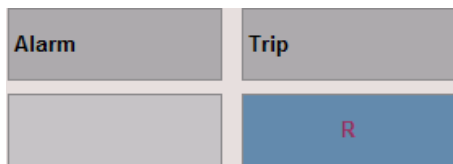

Trip may now be reset

Alarm view

By selecting the alarm or trip area in the [Operate view](#) the user is able to access the alarm view.

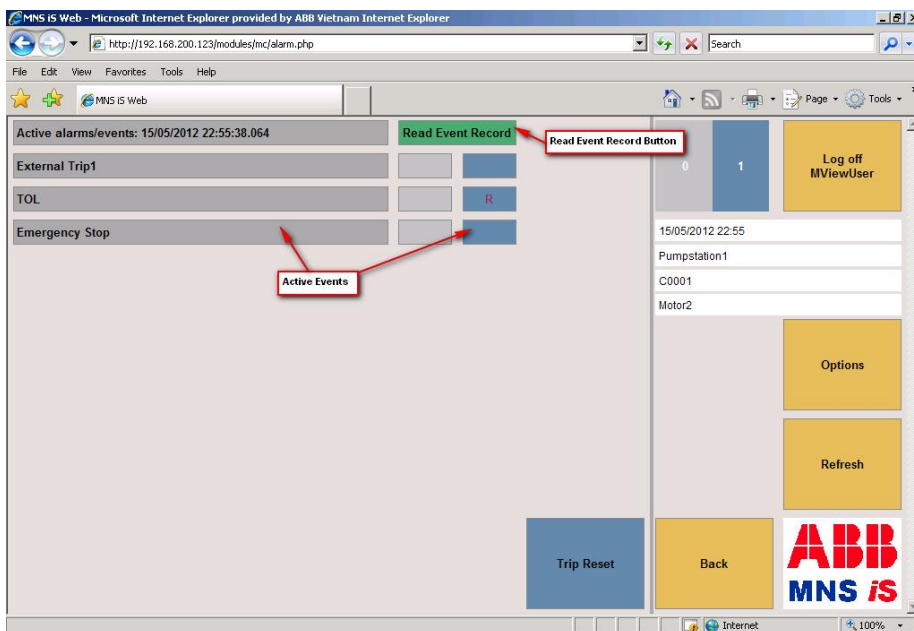

After selecting either the Alarm or Trip area from the Operate View, the Alarm View is then displayed. All active Alarms and Trips are then displayed for the selected device.

Device information is displayed as in the Operate Side View to the right hand side.

The top row shown in the Alarm / Trip indication is the Time Stamp from the last Event to occur, this can be either an Alarm, Trip or [Event](#).

Figure 17 - Alarm view, current alarms

Active alarms/events: 15/05/2012 22:55:38.064	Read Event Record
External Trip1	<input type="checkbox"/> <input type="checkbox"/>
TOL	<input type="checkbox"/> <input type="checkbox"/> R
Emergency Stop	<input type="checkbox"/> <input type="checkbox"/>

In the Alarm view indication for both Alarm and Trip is split as in the Operate View. The left hand side indicates the Alarm and the right hand side the Trip. The Acknowledged and Reset functions are also indicated here.

Where trips are highlighted with a blue boarder it is not possible with the current user rights to reset. Please refer to the MNavigate Help File section 'Reset Mask' for further information.

The colors shown above are the standard MNS iS color profile

Read Event Record

When user clicks on 'Read Event Record' button in Alarm view the last 32 event details related to a particular MControl are shown.


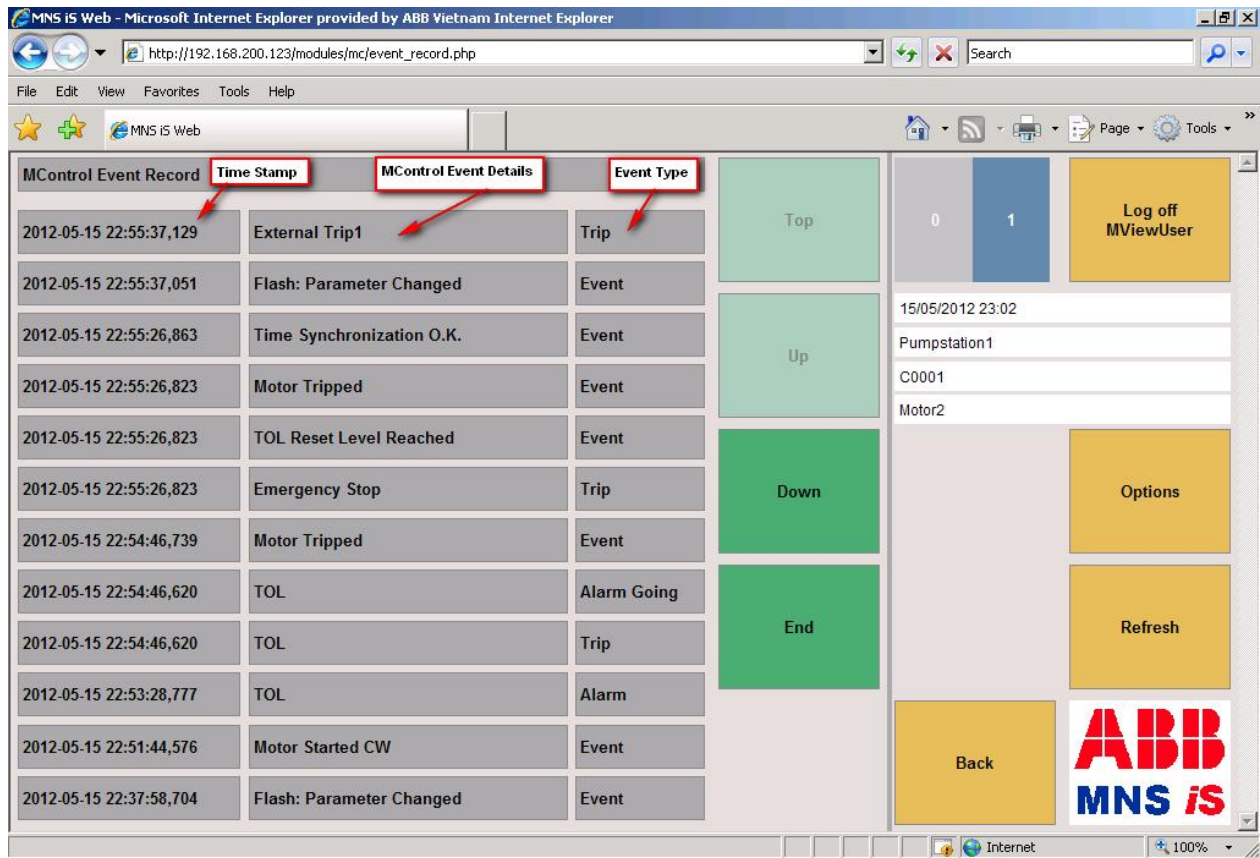


Figure 18 – Read Event Record

Use the Back button to return to the cubicle view




Show All Alarms / Events

From the [Alarm View](#) shown previously the possibility exists to view all events and alarms associated with the particular MControl / MStart.


The Alarm view as default shows only the active Alarms.

To interrogate all events; the following commands are available:

Select Options



Show All Alarms



The following is then displayed

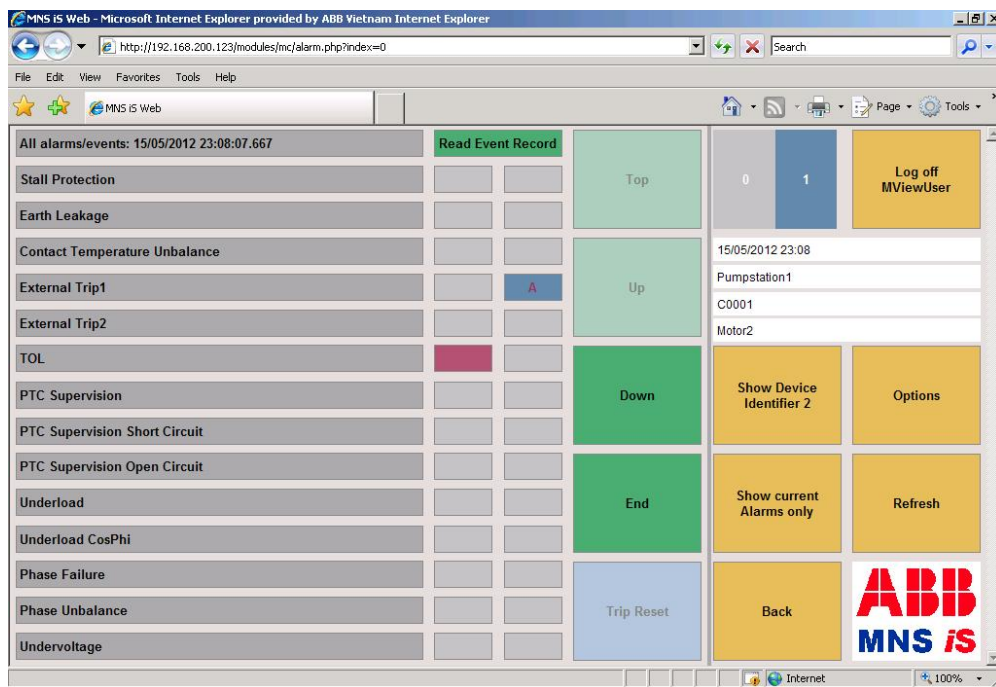


Figure 19 - Alarm view, Show all alarms / events

It is now possible to navigate through the alarms and events with the following keys

Up
Pages up through the table.



Top
Navigates to the first entry in the table.



Down
Pages down through the table.



End
Navigates to the last entry in the table



Alarms / Events displayed depend upon Project configuration.

All alarms/events: 07/10/2009 08:56:01.370		
Control Voltage	<input type="checkbox"/>	<input type="checkbox"/>
Start Limitation	<input type="checkbox"/>	<input type="checkbox"/>
Autorestart Inhibit	<input type="checkbox"/>	<input type="checkbox"/>
Emergency Stop	<input type="checkbox"/>	<input type="checkbox"/>
Main Switch Supervision	<input type="checkbox"/>	<input type="checkbox"/>
Feedback Supervision K1	<input type="checkbox"/>	<input type="checkbox"/>
Feedback Supervision K2	<input type="checkbox"/>	<input type="checkbox"/>
Feedback Supervision K3	<input type="checkbox"/>	<input type="checkbox"/>
Motor Still Running	<input type="checkbox"/>	<input type="checkbox"/>
Motor Not Running	<input type="checkbox"/>	<input type="checkbox"/>
Welded	<input type="checkbox"/>	<input type="checkbox"/>
Test Mode Failure	<input type="checkbox"/>	<input type="checkbox"/>
No Load	<input type="checkbox"/>	<input type="checkbox"/>
IRF Hardware	<input type="checkbox"/>	<input type="checkbox"/>

All alarms/events: 07/10/2009 08:56:01.370		
MStart Id Number Or Range Error	<input type="checkbox"/>	<input type="checkbox"/>
MStart Communication Error	<input type="checkbox"/>	<input type="checkbox"/>
Location Supervision	<input type="checkbox"/>	<input type="checkbox"/>
IRF Software	<input type="checkbox"/>	<input type="checkbox"/>
Motor Stopped	<input type="checkbox"/>	<input type="checkbox"/>
Motor Stopped By RCU	<input type="checkbox"/>	<input type="checkbox"/>
Motor Stopped By Priority Stop	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started By RCU	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started CW	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started CW By RCU	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started CCW	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started CCW By RCU	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started Open Direction	<input type="checkbox"/>	<input type="checkbox"/>

All alarms/events: 07/10/2009 08:56:01.370		
Actuator Both Limit Switches Active	<input type="checkbox"/>	<input type="checkbox"/>
Actuator Torque Open	<input type="checkbox"/>	<input type="checkbox"/>
Actuator Torque Close	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Card Failure	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Low Level Sensor1	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Short Circuit Sensor1	<input type="checkbox"/>	<input type="checkbox"/>
PT100 High Level Sensor1	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Open Circuit Sensor1	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Low Level Sensor2	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Short Circuit Sensor2	<input type="checkbox"/>	<input type="checkbox"/>
PT100 High Level Sensor2	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Open Circuit Sensor2	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Low Level Sensor3	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Short Circuit Sensor3	<input type="checkbox"/>	<input type="checkbox"/>

All alarms/events: 07/10/2009 08:56:01.370		
Motor Started Close Direction	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started N1	<input type="checkbox"/>	<input type="checkbox"/>
Motor Started N2	<input type="checkbox"/>	<input type="checkbox"/>
Motor Tripped	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Failsafe Activated	<input type="checkbox"/>	<input type="checkbox"/>
Main Switch Off	<input type="checkbox"/>	<input type="checkbox"/>
Test Position Activated	<input type="checkbox"/>	<input type="checkbox"/>
Main Switch On	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Test Position Deactivated	<input type="checkbox"/>	<input type="checkbox"/>
Flash: Configuration Parameter Changed	<input type="checkbox"/>	<input type="checkbox"/>
Flash: Parameter Changed	<input type="checkbox"/>	<input type="checkbox"/>
CA Switched To Local	<input type="checkbox"/>	<input type="checkbox"/>
CA Switched To Bus-Local	<input checked="" type="checkbox"/>	<input type="checkbox"/>
CA Switched to Remote	<input type="checkbox"/>	<input type="checkbox"/>

All alarms/events: 07/10/2009 08:56:01.370		
PT100 High Level Sensor3	<input type="checkbox"/>	<input type="checkbox"/>
PT100 Open Circuit Sensor3	<input type="checkbox"/>	<input type="checkbox"/>
Fuse Supervision L1	<input type="checkbox"/>	<input type="checkbox"/>
Fuse Supervision L2	<input type="checkbox"/>	<input type="checkbox"/>
Fuse Supervision L3	<input type="checkbox"/>	<input type="checkbox"/>
Contact Temperature Supervision L1	<input type="checkbox"/>	<input type="checkbox"/>
Contact Temperature Supervision L2	<input type="checkbox"/>	<input type="checkbox"/>
Contact Temperature Supervision L3	<input type="checkbox"/>	<input type="checkbox"/>
Switch Cycle Supervision K1	<input type="checkbox"/>	<input type="checkbox"/>
Switch Cycle Supervision K2	<input type="checkbox"/>	<input type="checkbox"/>
Switch Cycle Supervision K3	<input type="checkbox"/>	<input type="checkbox"/>
Operating Hours	<input type="checkbox"/>	<input type="checkbox"/>
Insertion Cycle Supervision MStart	<input type="checkbox"/>	<input type="checkbox"/>
StarDelta Transition Failed	<input type="checkbox"/>	<input type="checkbox"/>

All alarms/events: 07/10/2009 08:56:01.370		
TOL Bypass Activated	<input type="checkbox"/>	<input type="checkbox"/>
TOL Reset Level Reached	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Time Synchronization Lost	<input type="checkbox"/>	<input type="checkbox"/>
Time Synchronization O.K.	<input checked="" type="checkbox"/>	<input type="checkbox"/>

When entries are in Alarm / Trip format they are displayed with both Alarm and Trip indication

TOL	<input type="checkbox"/>	<input checked="" type="checkbox"/>
-----	--------------------------	-------------------------------------

When they are an Event they are displayed as below

TOL Reset Level Reached	<input checked="" type="checkbox"/>
-------------------------	-------------------------------------

Figure 20 Alarms and Events

General Alarm/Trip Indication

General Alarm/Trip Indication function informs user about the Alarms or trips occurred in any MControl which is connected to any MLink in the network with same MView ID. It also indicates number of alarms or trips occurred in MLink network.


This function is located at the top of side menu bar in all MView pages except on pages inside ABB Logo.




Figure 21: General Alarm/Trip Indication on MLink list page

General Alarm/Trip indication button is partitioned in two sections: one for Alarms and another for Trips. General Alarm / Trip button can have the following layout:


1-Alarm and 2-Trip of MControl:

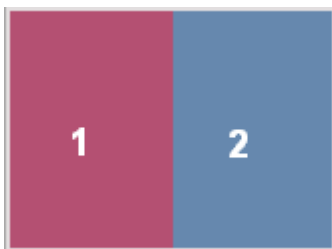


1-Alarm and 0-Trip:

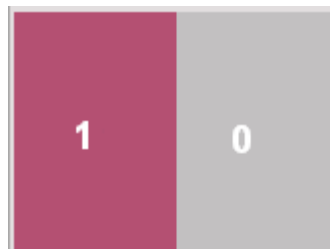

0-Alarm and 1-Trip:

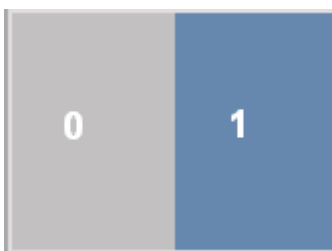

0-Alarm and 0-Trip:

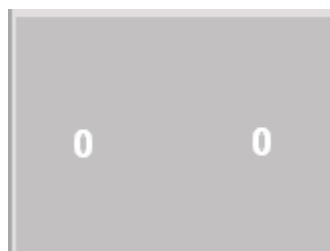

Note:

Colors shown are from the standard MNS iS color profile. User can change colours of Alarm and Trips by changing web colour settings in MNavigate.

When user clicks on General Alarm/Trip indication button at MLink list page (user is not logged-in) it will redirect to login page. User has to enter the user credentials. After entering user credentials, it will redirect to Plant alarm page as shown in below image.

Plant Alarm page will list all the devices containing Alarms and Trips occurred in MLink network provided MView IDs of all connected MLinks are same. List gives information of Device identifier and MLink name to which the device is connected and also alarm and trip.

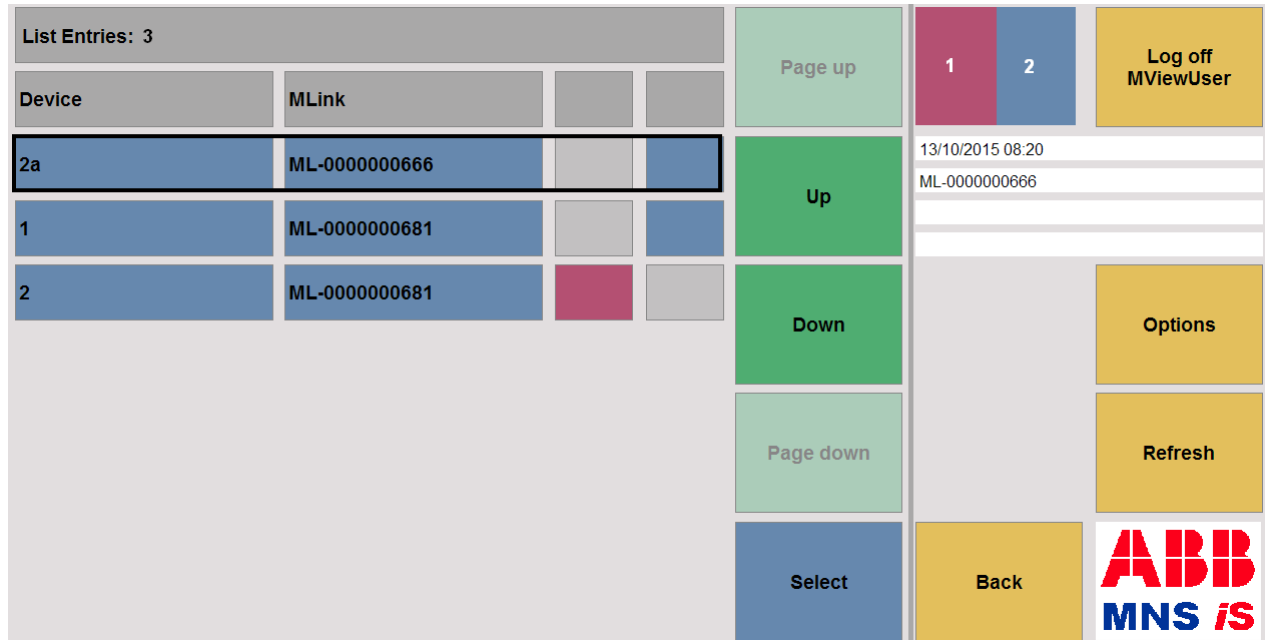


Figure 22: Plant Alarm page


Selecting one of the listed devices will redirect to Alarm/Event page of that particular device. If the user is created on both MLinks the redirection is done automatically. If not the user has to enter the credentials before redirection to Alarm/Event page.

Status Information

Process values / measurement values

The process value area shows different groups of values received by *MControl* depending on group selector settings. The display changes from measurement values to diagnostic values to the device status. All values are updated periodically. If there are more than 6 process values the list can be scrolled up and down by the navigation buttons to the right of the list.

Group Selector

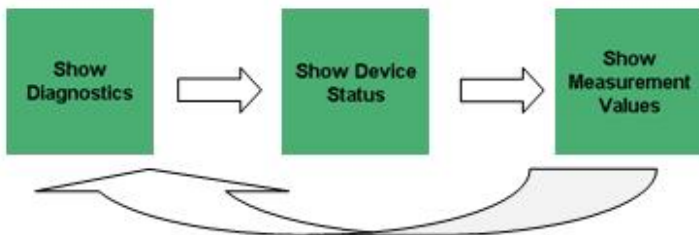


Using the group selector three different groups of values can be displayed:

- Measurement Values (default)
- Diagnostics
- Device Status

Measured values		Show Diagnostics
Current Phase L1	23,23 A	Up
Current Phase L2	23,05 A	
Current Phase L3	22,83 A	
Phase Voltage L1-L2	523,74 V	Down
Phase Voltage L2-L3	518,34 V	
Phase Voltage L3-L1	523,48 V	


Diagnostic information		Show Device Status
Operating Hours	3 h	Up
TOL Diagnostic	0	
Time To Reset	NA	
Time To Trip	NA	Down
Measured Motor Startup Time	0,38 s	
Current At Trip L1	(0,00) A	

Device status information		Show Measurement Values
Starter State	67240321	Up
GPI1 Status	1	
GPI2 Status	0	
GPI3 Status	0	Down
GPI4 Status	1	
GPI5 Status	0	

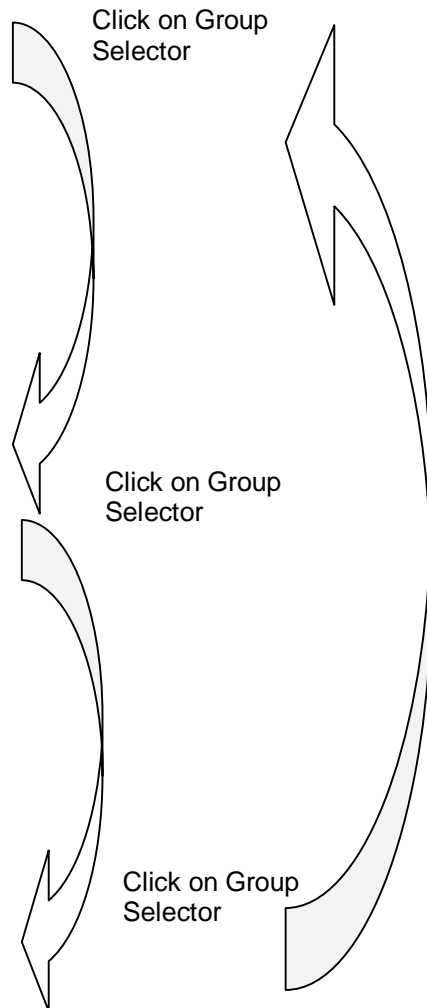

Status information

The Status information area is located above the [Command Selector](#) keys. Information on the Control Access function is contained in the [Control Access status \(CA\)](#) section.

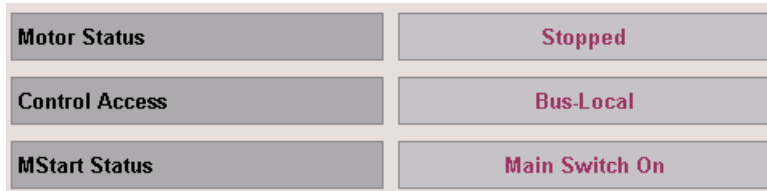

The information displayed here enables the user to have an overview of the MStart, the Motor and which interface holds the current Control Access rights.

Figure 23 – Status Information Area

The following possibilities exist for **Motor Status**.

NOTE: Motor Status information is Starter Type Dependant. Please refer to the MNavigate Help File for further information.



No Alarms or Trips present.



Starter type dependant information



Stopped due to Protection function or external action



When background of the Motor Status is highlighted with Blue, this indicates that the MStart has been switched to Failsafe Status, this is due to loss of communication between the MControl and MLink or MLink and DCS.



The following possibilities exist for **MStart Status**



Main power and Control circuits connected. Isolator in ON position.



Main power circuit disconnected, Control circuit connected. Isolator in TEST position.



Main power and Control circuits are disconnected. The isolator is in either the OFF position or the ISOLATED position.

Control Access status (CA)

Control Access (CA) is a mechanism within MNS iS to define and determine which interface has control rights to operate the *MControl*, this handling is defined below. Control Access rights can be given, for example, by a specific command sent to switch operation rights from push-button (hardwired to *MControl*) to any other interface connected to the switchgear control network (e.g. *MView* or *PCS*). Soft-Local or Remote options exist for the CA handling from the Web Interface, it is only possible to have one of these selected for operation on any single *MLink*.

The following possibilities exist for Control Access Status



Control from Plant Control System via the Fieldbus interface.



Operation is possible via *MView* (local panel in switchboard) or via a Web interface (any PC with a Web Browser software).



Operation is possible via digital inputs on *MControl*. Soft Local does not require a hardware input to be set




Operation is possible via digital inputs on *MControl*. Hardware Local required a signal to be set on the 'Local' Function, parameterised in *MNavigate*. Hardware Local




Operation is possible only via *MControl* Direct Fieldbus interface card (direct connection).

CA Status – Soft Local / Bus Local Operation

Operation of the CA for the Web interface utilises the [“select before operate”](#) mechanism

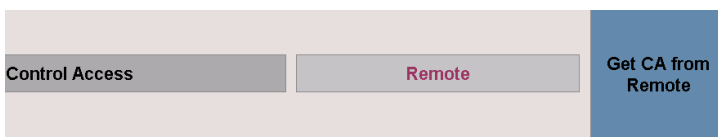

Here the PCS currently 'Holds' the CA. The PCS can at anytime request the CA by sending the 'Remote' or 'Auto' command.

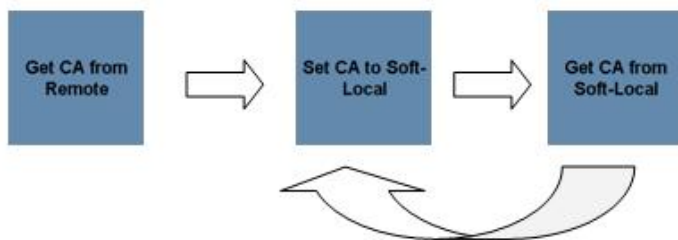


To obtain the CA at the Web Interface, select 'Get CA'.... This is possible either when the CA has either Remote or Soft-Local status. Once the CA is Set to Bus-Local it is then possible to Control the *MControl* from the Web Interface. From Bus-Local it is then possible from the Web Interface to set the CA to Soft-Local.


Note:

The CA can be taken from any holder by the Hardware-Local functionality. This has the highest Control Access authority. For more information please refer to the *MNavigate* help file.

CA Status – Set CA to Remote Operation

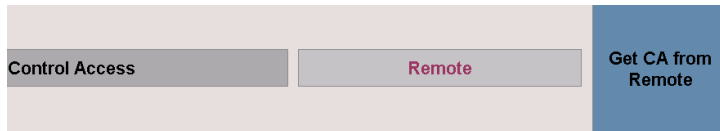

Here the PCS currently 'holds' the CA.

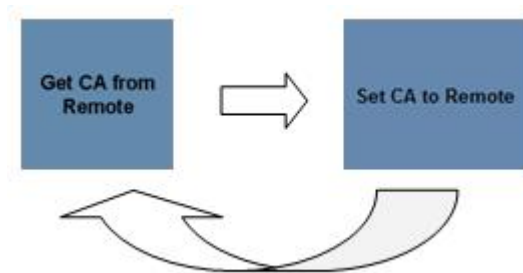


In this mode of operation the Web Interface can at anytime obtain the CA from Remote and also return the MControl to Remote operation

Note:


The CA can be taken from any holder by the Hardware-Local functionality. This has the highest Control Access authority. For more information please refer to the *MNavigate* help file.

Special Status Information

The top section of the [Operate View](#) is where the Special Status Information is indicated in the Web Interface.

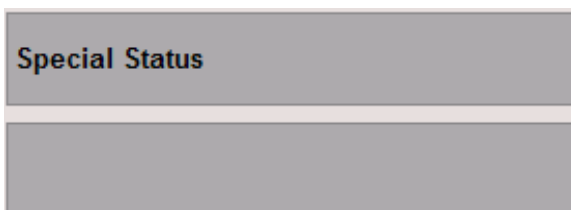

No Information

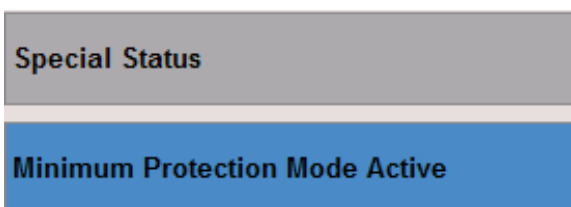

As long as the Minimum Protection Mode is running the shown indication is done. If the Minimum Protection Mode is finished the box is cleaned.

Indication of MLink Simulation

The MLink Simulation supports the ABB service personnel during commissioning to run DCS connection tests. If enabled the MNSiS MLink Simulation provides process data even if no real MControl / MStart is connected.

A running simulation is indicated as shown below.

MLink Simulation Running	Alarm	Trip	Show Diagnostics	0	1	Log off MViewUser
Current Phase L1		0,00 A	Up	11/08/2014 09:44		
Current Phase L2		0,00 A		ML-003		
Current Phase L3		0,00 A		S001		
Current Phase L1 Percentage		0 %	Down	1-1-1		
Current Phase L2 Percentage		0 %		Options		
Current Phase L3 Percentage		0 %		Locate Module		
Motor Status	Stopped Ready to start		Set CA To Soft Local	Refresh		
Control Access	Bus-Local			Back		
MStart Status	On			ABB MNS iS		
Start CW		Stop				

Figure 24: MLink Simulation indication in Operate page

MLink Device setup

The user selects the device setup from the [cubicle view](#) by highlighting the MLink with the cursor and selecting 'Device Setup'.

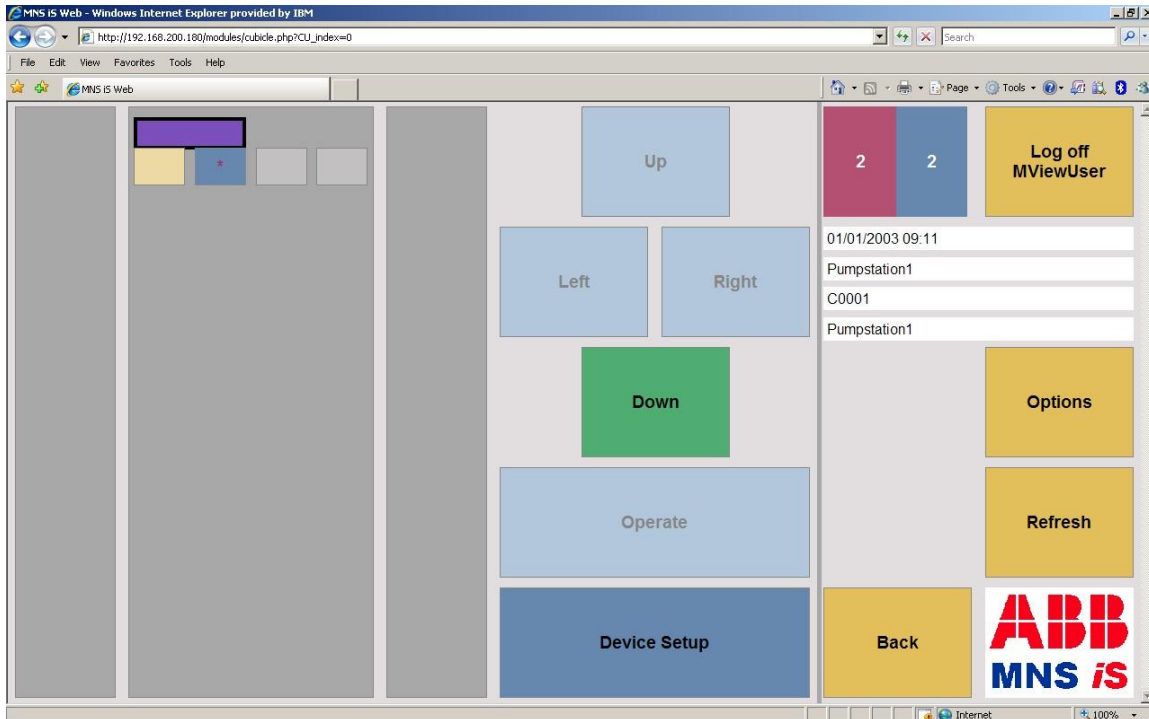


Figure 25 MLink Device Setup selection

MLink settings

The device setup for *MLink* gives the user the possibility to providing the correct user rights are available.

- Set the internal system time ([Time synchronization](#))
- Obtain application version / status information ([Application Information](#))
- Search for MControls ([MControl Search](#))
- Retrieve [Network Information](#) (IP Configuration setting)
- [MLink Parameter overview](#)

Time synchronization

Depending on the kind of time synchronization RTC or NTP the device setup looks different. In some cases the shown menu items may not be available (disabled) due to the user profile. Disabled menu items are shown light blue.

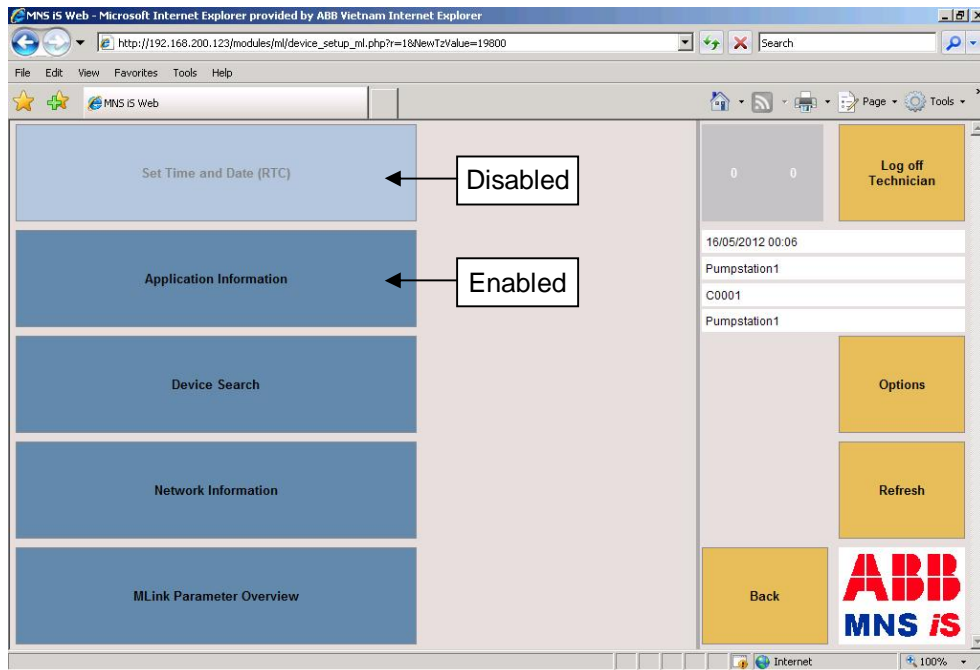


Figure 26 MLink Device Setup, no user right for setting the MLink system time (RTC)

Time synchronisation

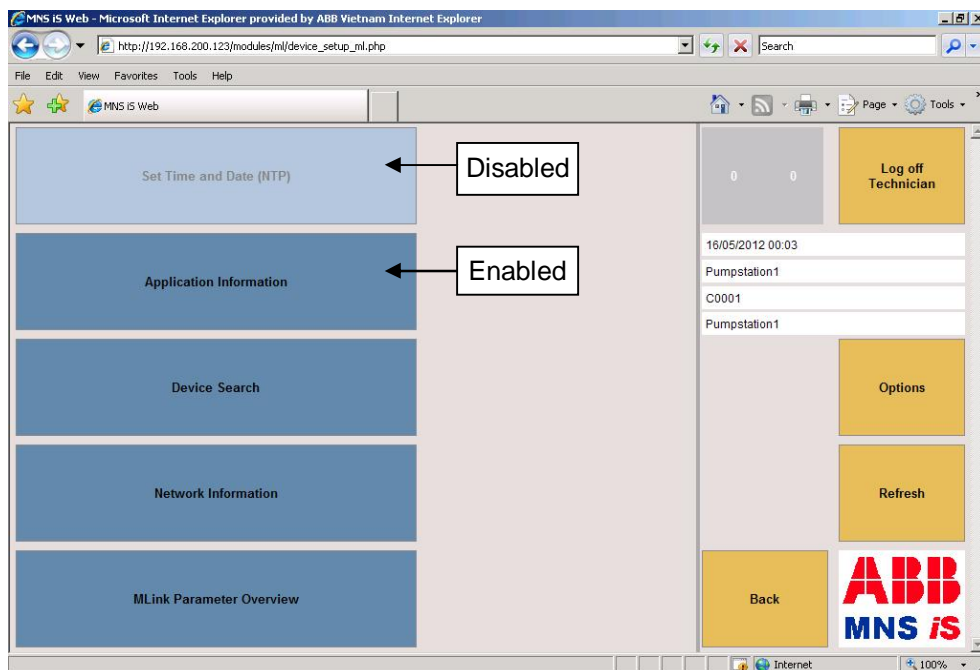


Figure 27 MLink Device Setup, no user right for setting the MLink system time (NTP)

Depending upon the user profile setting and project configuration “Time Synchronization” the following options are possible:

1. No time synchronization configured

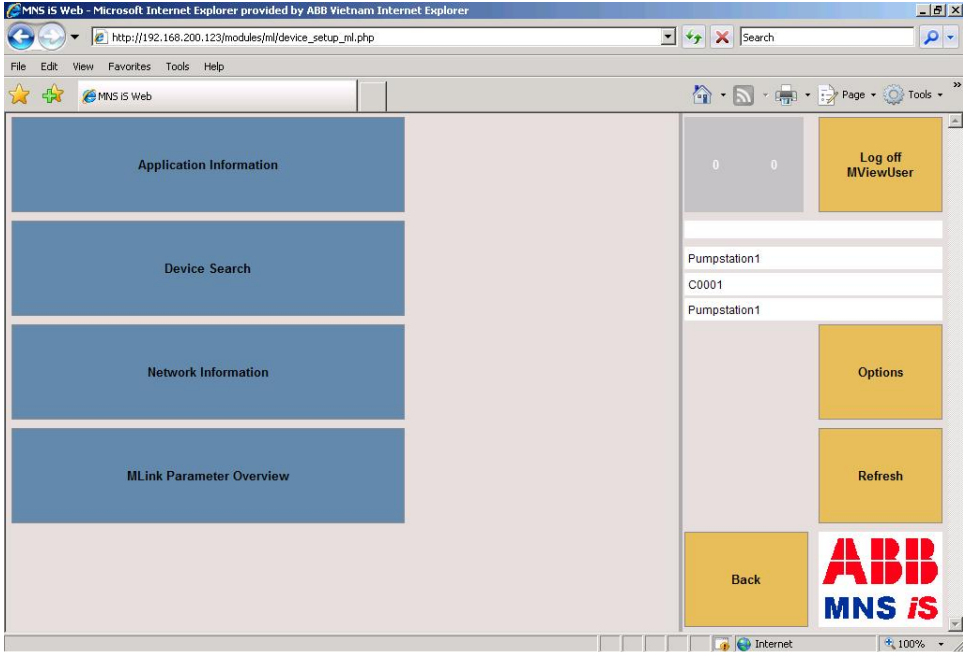


Figure 28 MLink Device Setup, no time synchronization configured

2. RTC time synchronization

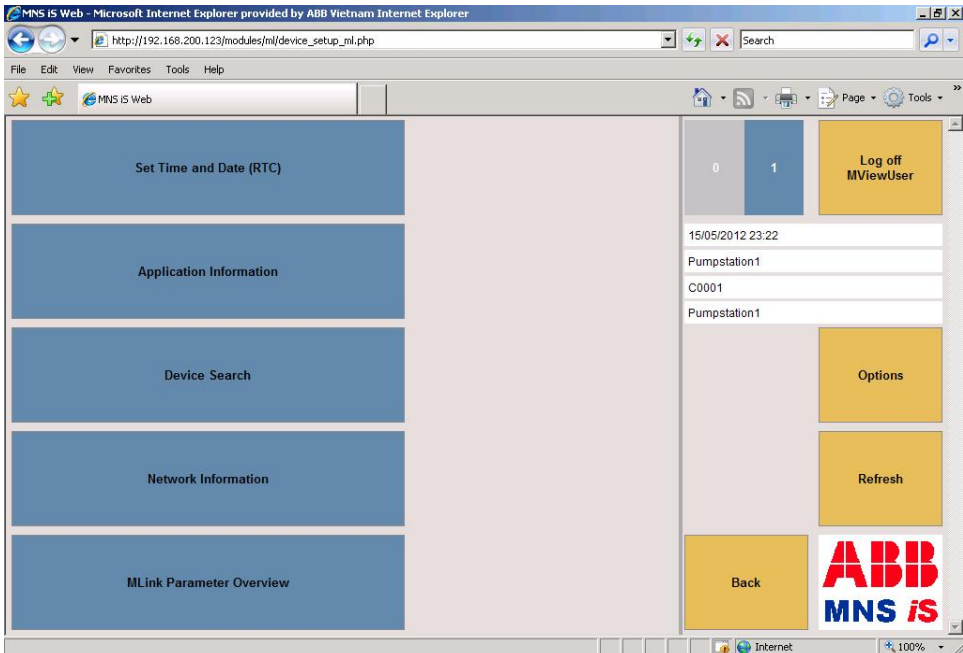


Figure 29 MLink Device Setup, RTC time synchronization

After selecting the menu item **Set Time and Date (RTC)** the following screen appears.


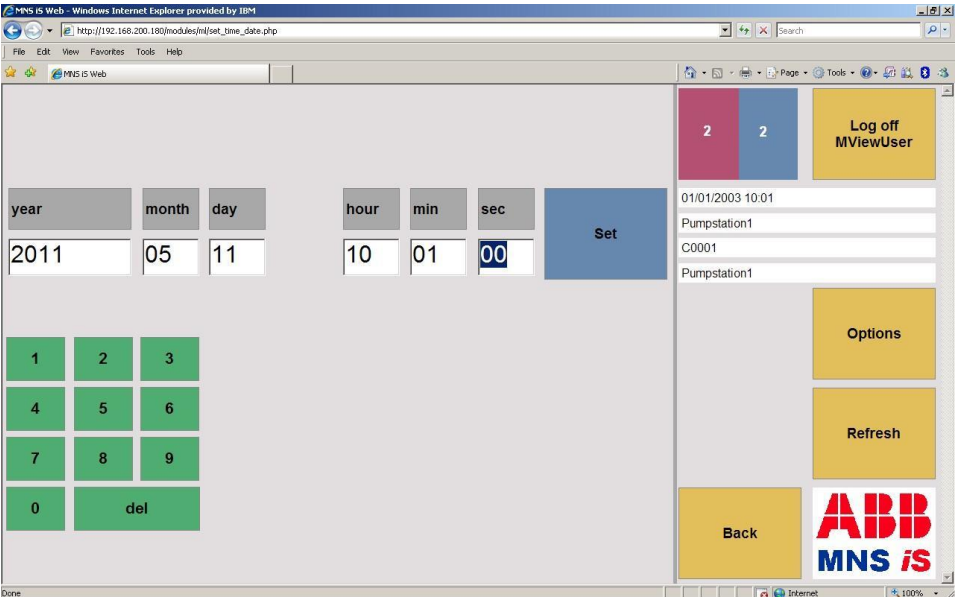


Figure 30 MLink Device Setup, setting RTC time

From here it is possible to set the MLink system time.

Use the Back button to return to the cubicle view



3. NTP time synchronization

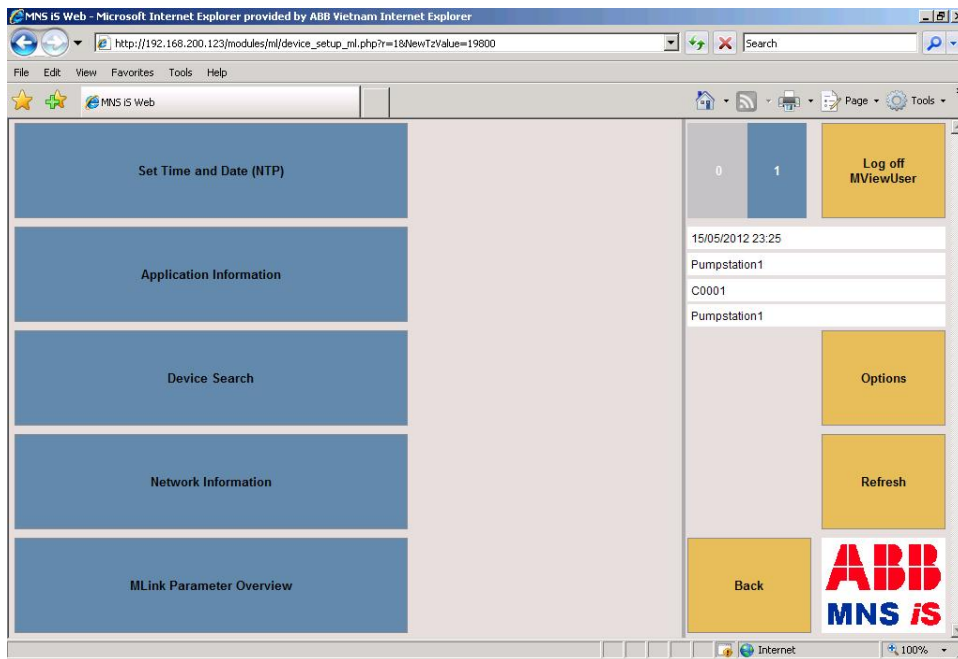


Figure 31 MLink Device Setup, NTP time synchronization

After selecting the menu item **Set Time and Date (NTP)** the following screen appears.

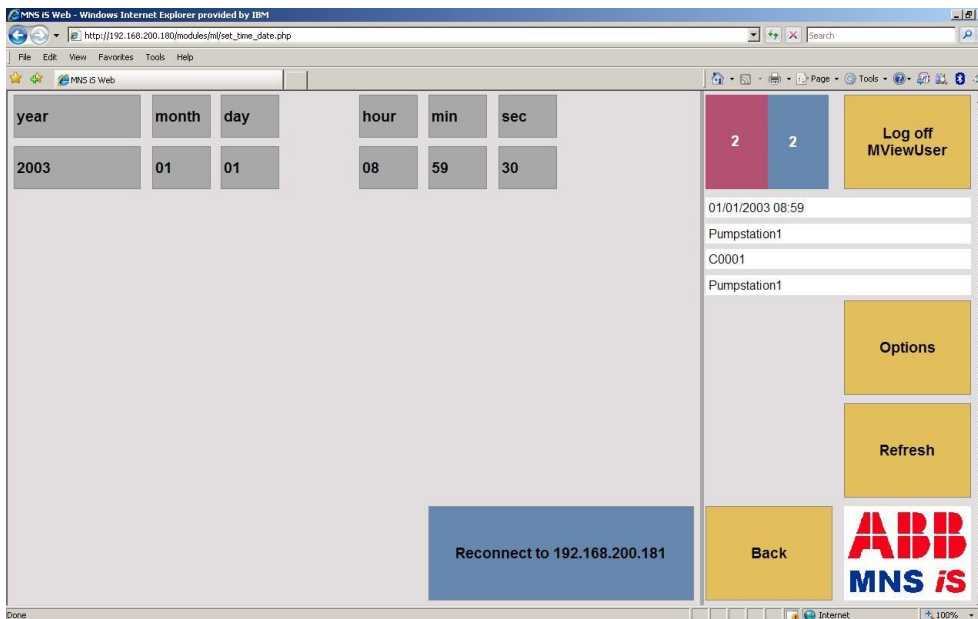




Figure 32 MLink Device Setup, reconnect to NTP server


Here the user has the possibility to request the time from the time server again.

Local Time Zone Support


After enabling **Use Time Zone Offset** in *MNavigate* the WEB interface shows localized time information on the system menu and on Alarm / Event overview page. As soon as the parameter file is downloaded the local time zone offset is taken out of the client machine and added to *MLink* system time information.

If the **Use Time Zone Offset** setting is disabled the UTC system time is shown in system menu.

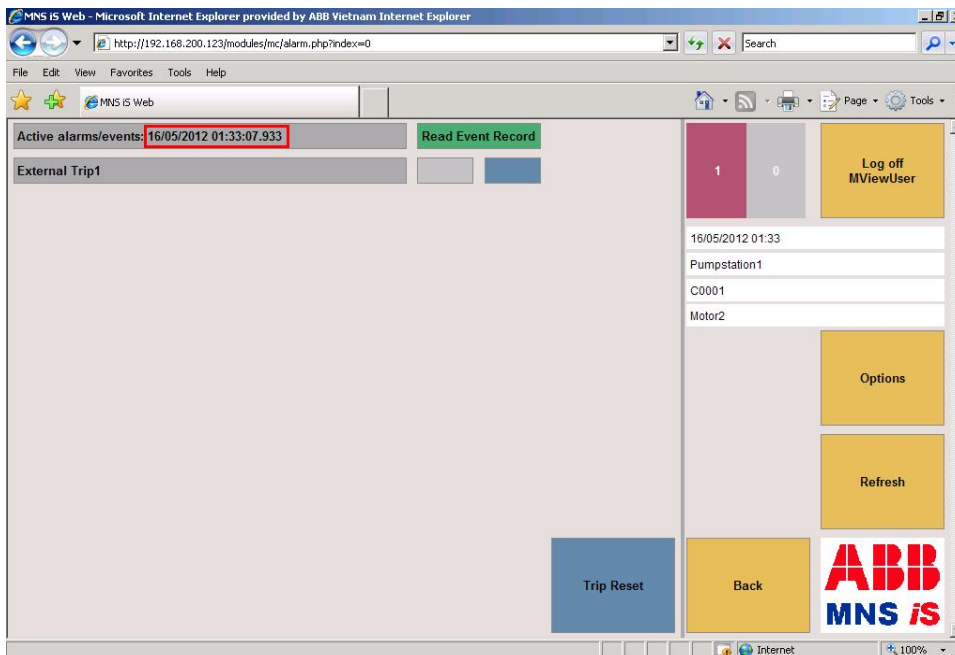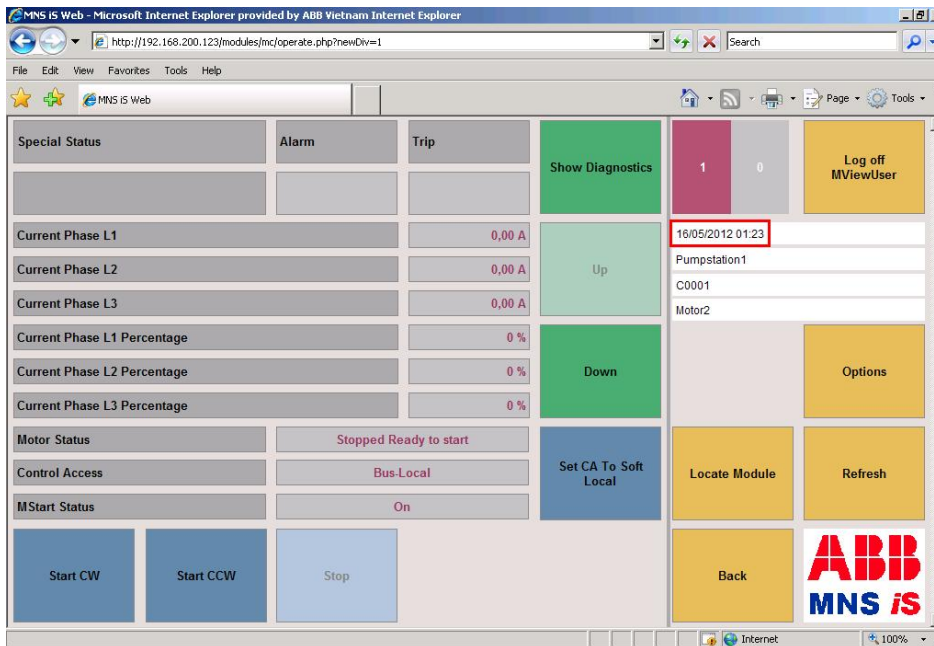


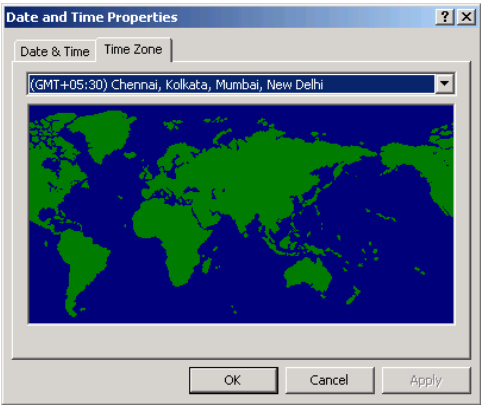

The Web Interface is running on a machine having an offset of 2h (1h offset & 1h daylight saving).

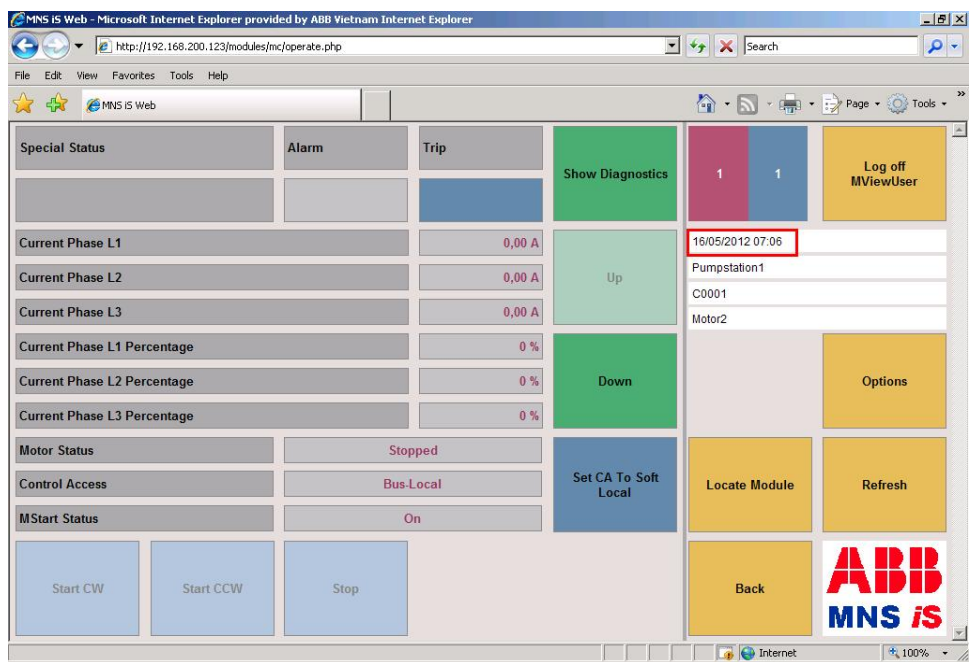


After enabling of **Use Time Zone Offset** setting in *MNavigate* the offset is added accordingly (system menu & Alarm / Event overview).

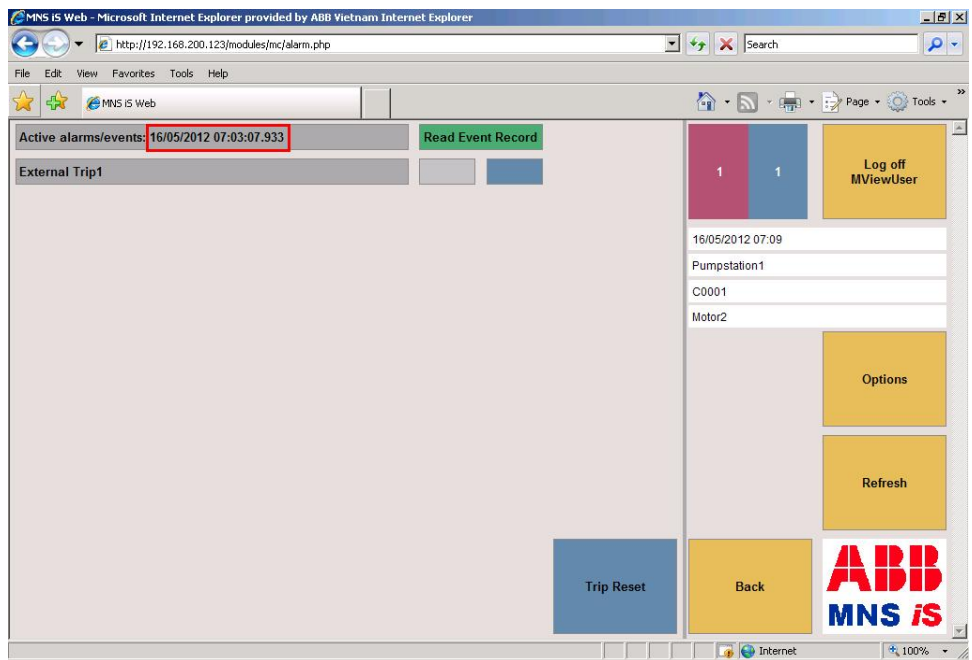

For further details how to activate local time zone support (**Use Time Zone Offset**) refer to the MNS iS *MNavigate* help file.

Use the Back button to return to the cubicle view



Application Information

If the user selects **Application Information** the following screen appears, giving *MLink* application version information.


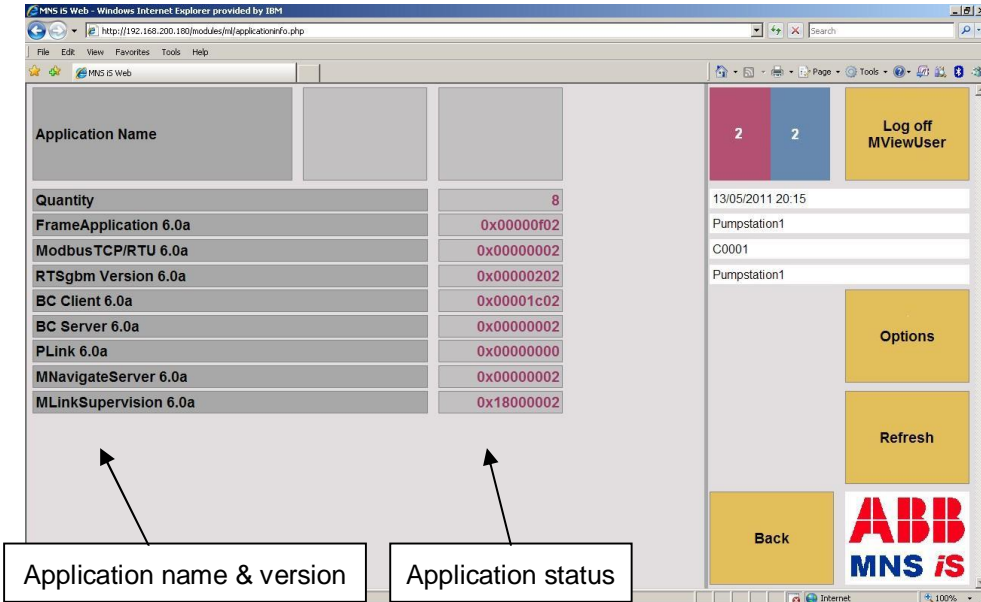


Figure 33 *MLink* Device Setup, Application information

This screen can be used to review internal tasks and processes executed by the *MLink*.

Use the Back button to return to the cubicle view



MControl Search Function

If the user selects **MControl Search** the following screen appears, giving the possibility to find MControls in a MNS *iS* system:

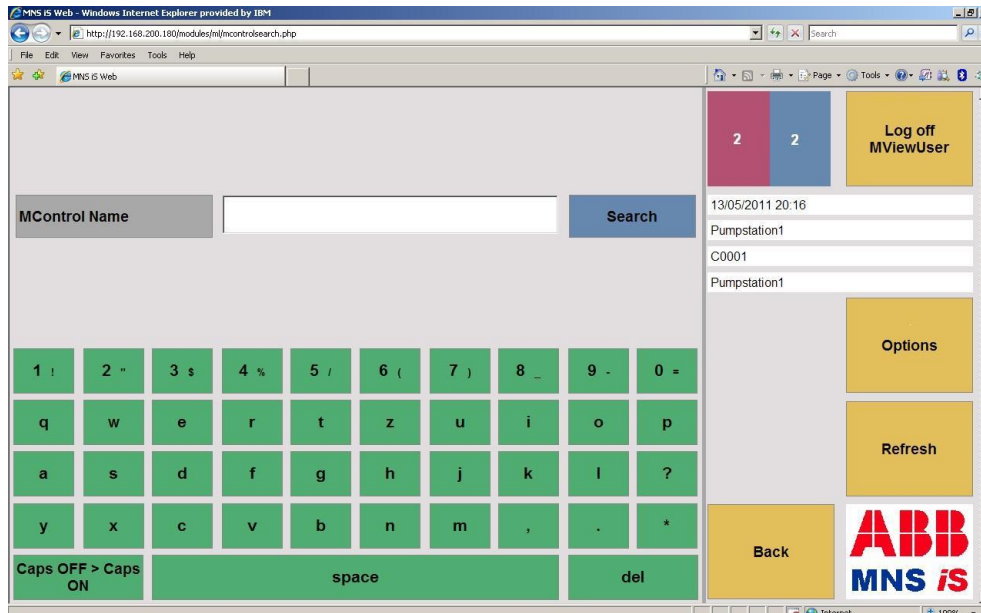


Figure 34 MControl Search Dialog

From here it is possible to either enter the full tag name or a group of characters to search for a module. The input field allows entering two supported 'wild' search characters:

- ? Replaces a single undefined character
- * Replaces an undefined string

The *MLink* then searches with the entered MControl tag name against all 3 device identifiers (Device Identifier 1, Device Identifier 2, LocationId (Device Identifier 3)). If the MControl name matches to one of these identifiers the result is shown in a dialog containing three columns. The third column is the identifier the match occurred.

Device	MLink	ID
Valve-4	PumpStation2	1

In the example above the MControl / MStart has the name 'Valve-4' designated as its 'device identifier 1' and MLink named PumpStation2 is connected.

Result	Device	MLink	ID	Device Id Number
Match in MControl Device Identifier 1	Device Identifier 1 of MControl	DeviceName1 of MLink is shown		1
Match in MControl Device Identifier 2	Device Identifier 2 of MControl	DeviceName2 of MLink is shown		2
Match in MControl Device Identifier 3	Device Identifier 3 of MControl	LocationId of MLink is shown		3

The following shows an example of the correct usage of this feature. Here the shown MNS iS network structure is taken as precondition. The startup page of MView is MLink Pump Station 1.

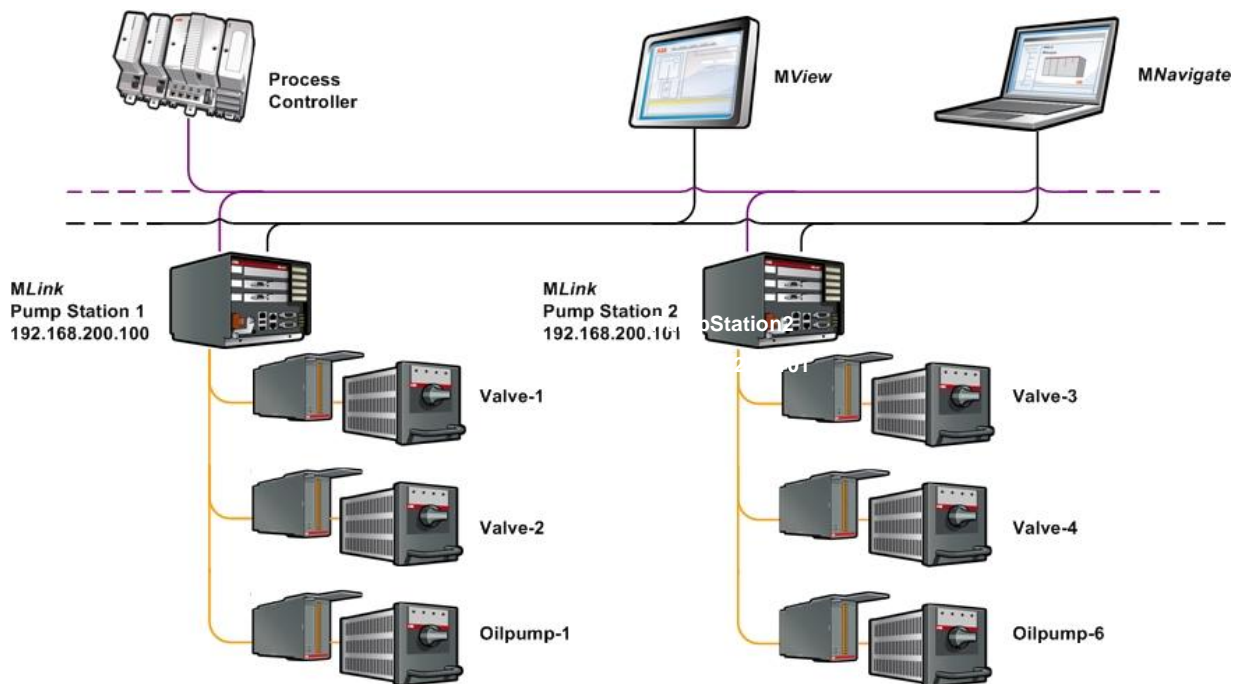


Figure 35 MNS iS System Structure



If an MControl is not found with a know Device Identifier please check the MView ID . This MView ID enables the user to create logical networks. Only MControls connected to a MLink parameterised with the MView ID for that particular network segment will be displayed. For more information please see chapter [MView ID](#)

When the physical location and / or the exact name of a MControl is not known the search function can be used in the following way.

User input: "Valve-01":

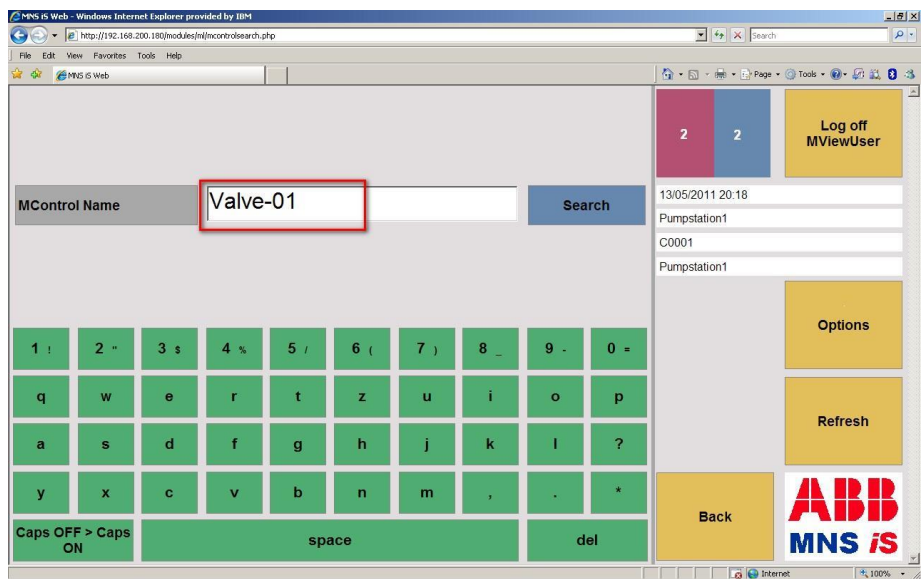


Figure 36 User Input 1

MView output:

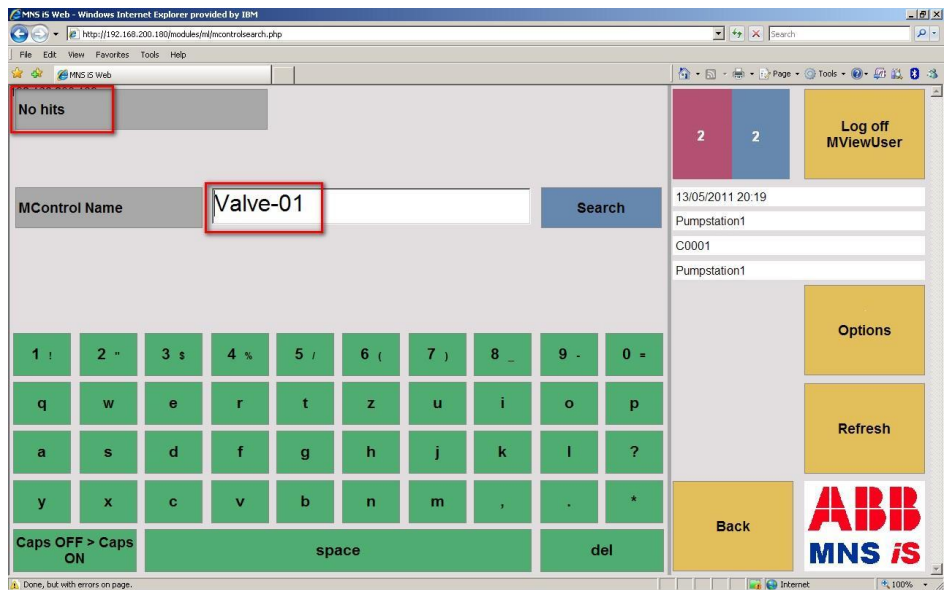


Figure 37 Search Results 1

Result: There is no MControl "Valve-01" available in the MNS iS network.

User input: "Valve-?" – Search with undefined character

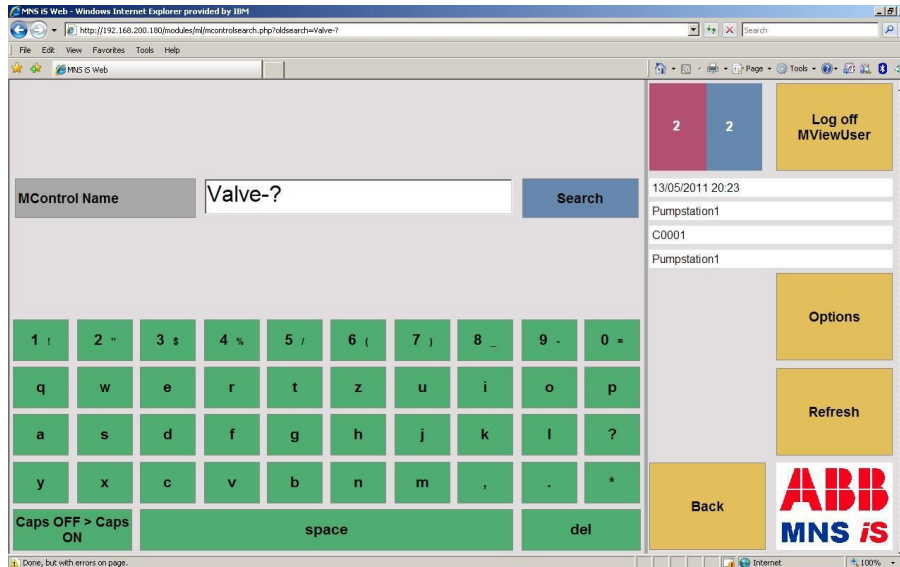


Figure 38: User Input 2

MView output:

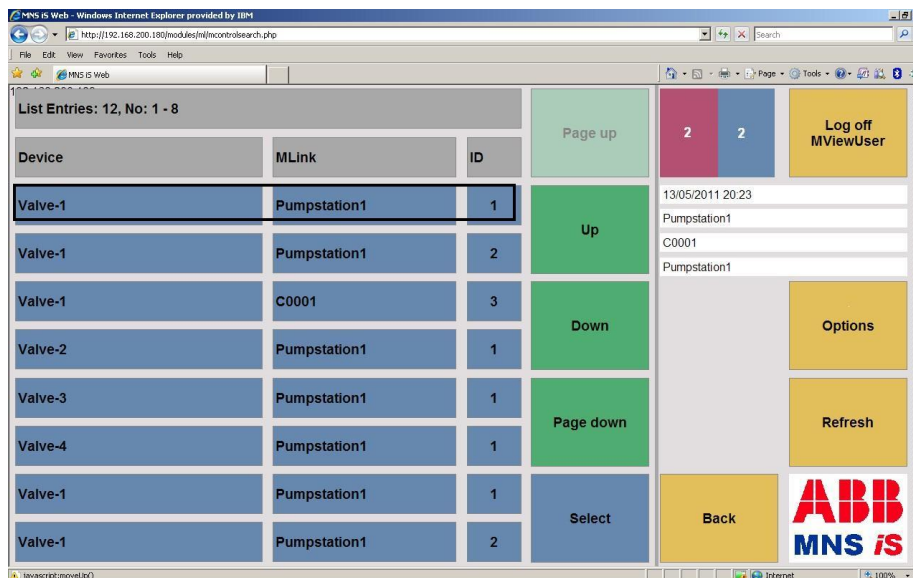


Figure 39: Search Results 2

Result: 4 MControls were found, connected to two different MLinks. In this case the selected MControl is connected to the same MLink the MView uses (Pump Station 1). If the user selects one of these MControls (Valve-1) a redirection is done to the Operate Screen of the dedicated MControl.

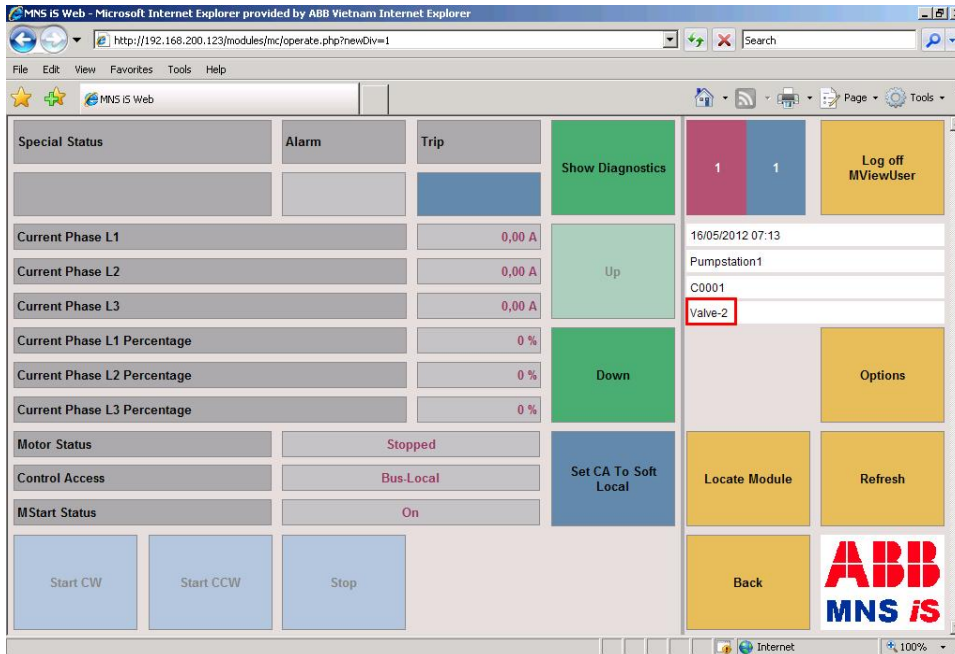


Figure 40: Redirection from Search Results 2

User input: “Val*”-?” – Search with undefined string

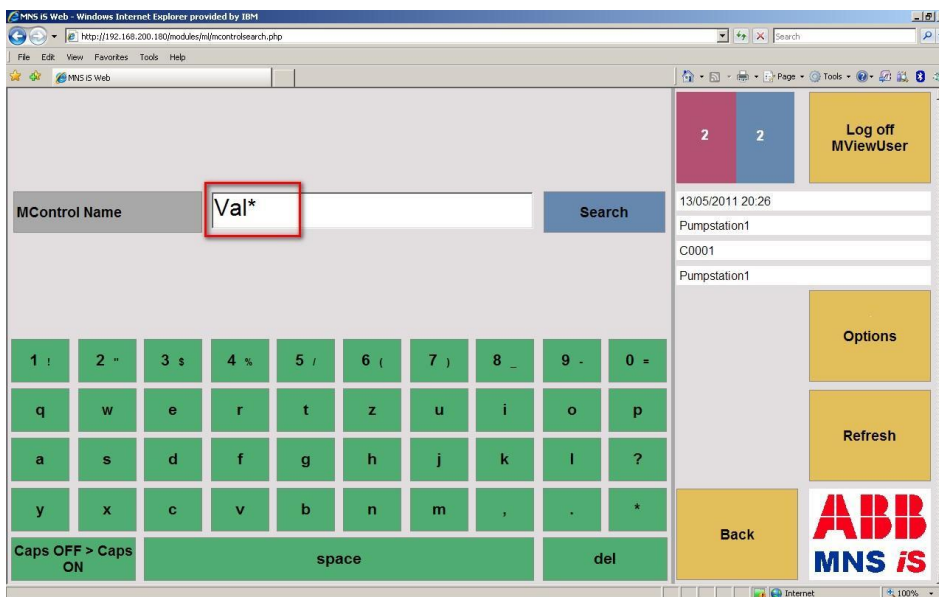


Figure 41: User Input 3

MView output:

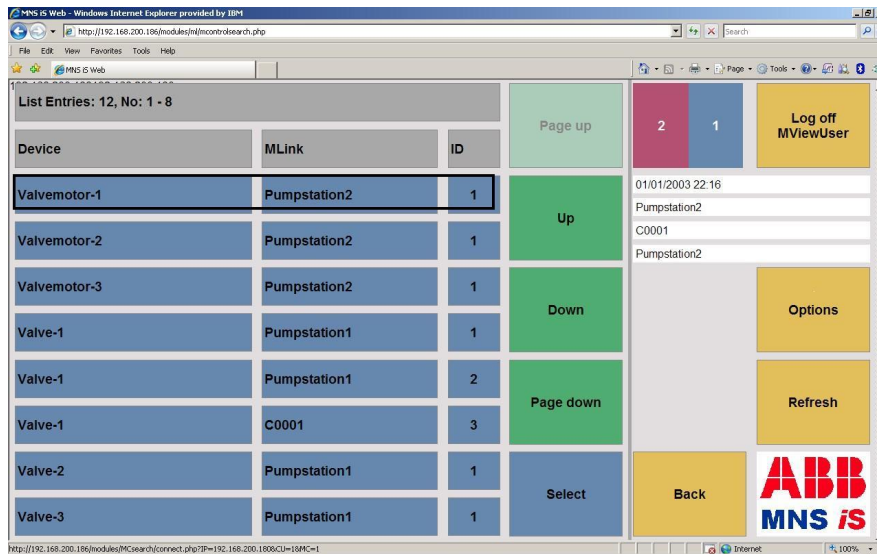


Figure 42: Search Results 3

Result: 4 MControls were found, connected to two different MLinks. In this case the selected MControl is connected to another MLink the MView uses (Pump Station 2). If the user selects one of these MControls (Valve-3) a redirection is done to the **Operate Screen** of the dedicated MControl.

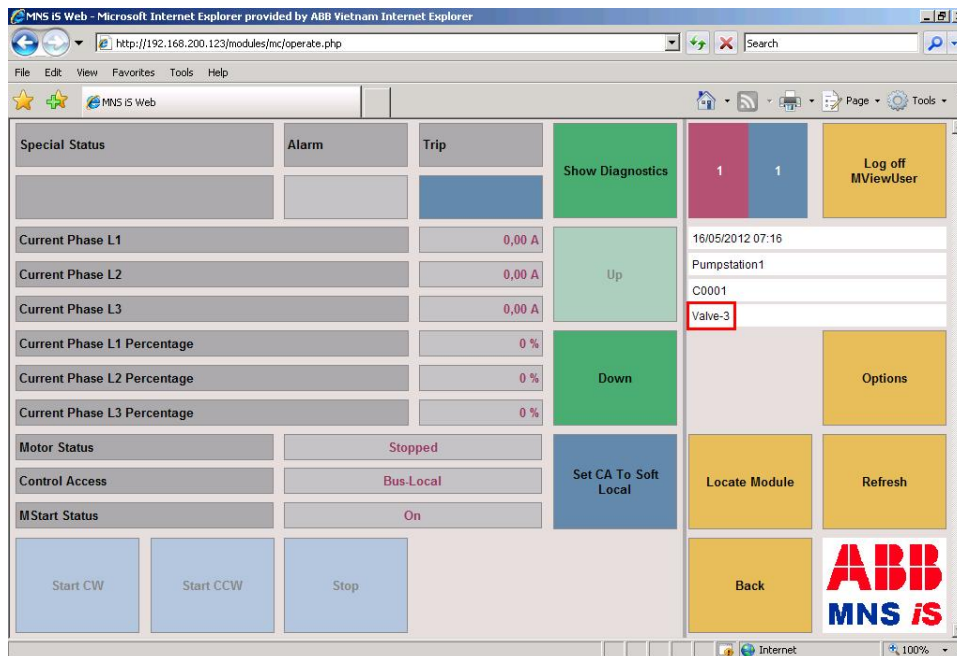


Figure 43: Redirection from Search Results 3

Network Information

If the user selects **Network Information** the following screen appears, giving information regarding used Ethernet IP address settings and Subnet masks.


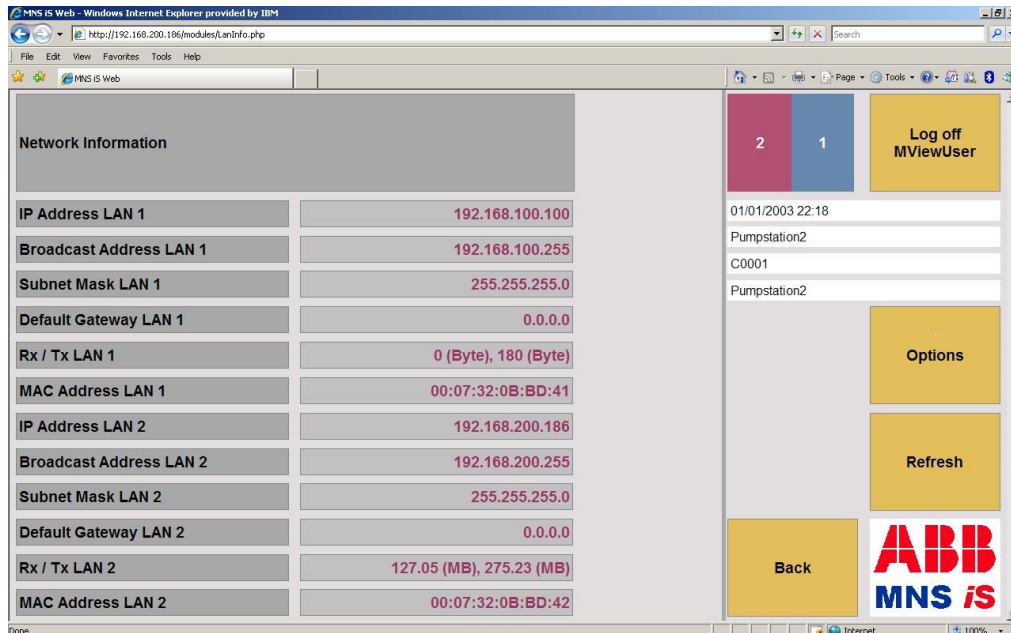



Figure 44 Network Information Dialog

Use the Back button to return to the cubicle view




MLink Parameter Overview

If the user selects 'MLink Parameter Overview' the following screen appears, giving overview regarding various MLink Parameters i.e. OPC ID, MView ID, Access control. These have direct relationship with parameter value set and downloaded to MLink via MNavigate.

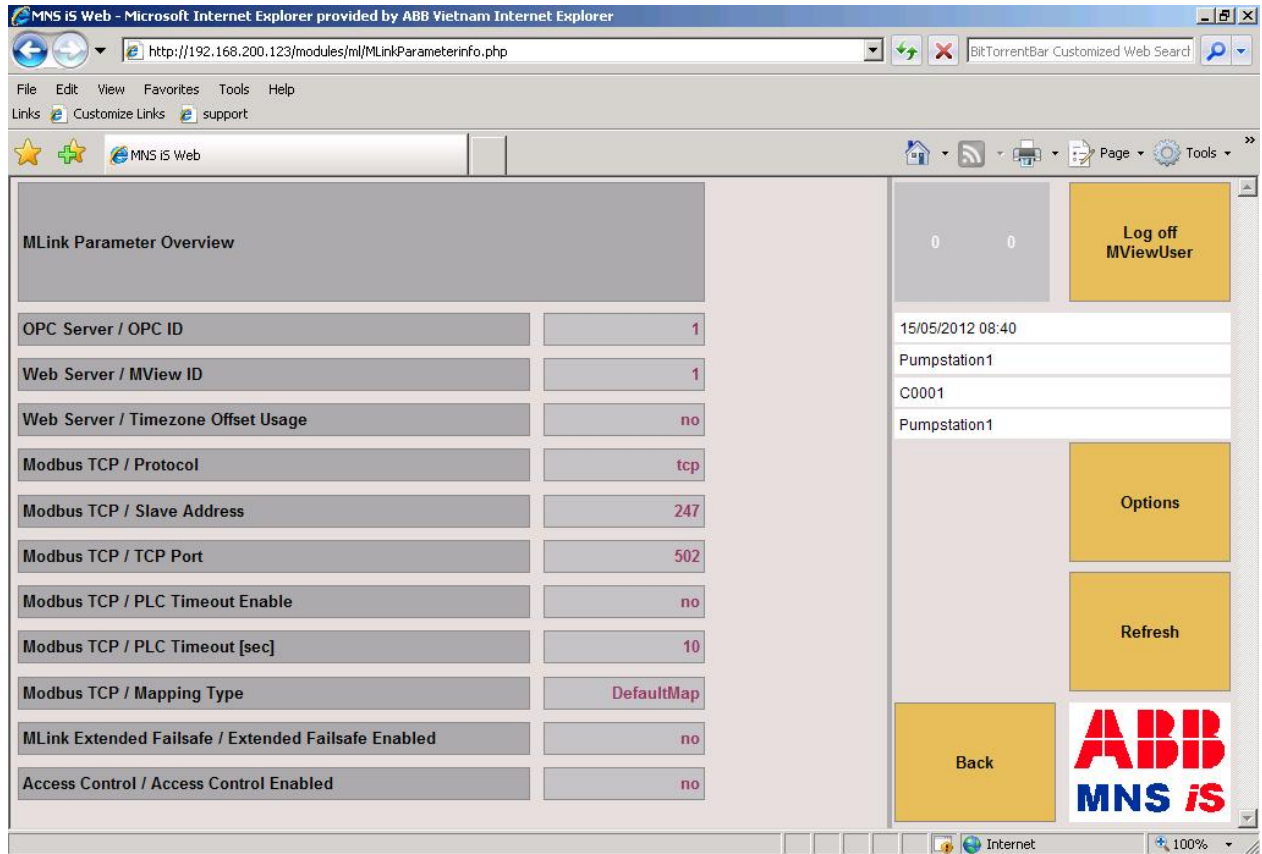

Use the Back button to return to the cubicle view



Redundancy

The web interface will always use data received from the primary *MLink*. Should a change over occur the web interface will be automatically redirected. The following sequence will run when a change over of the primary *MLink* is initiated. For more information please refer to the MNS iS Redundancy Manual.

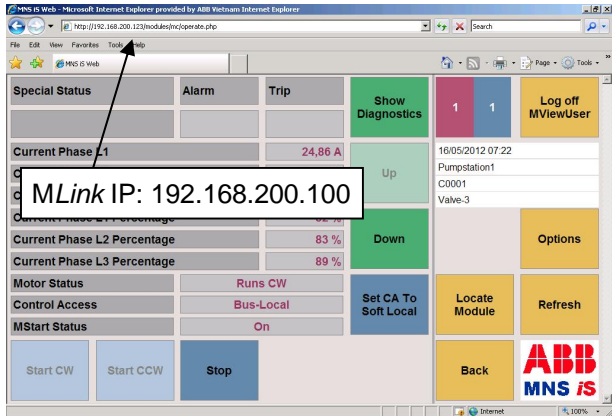


Figure 45 Screen before redundancy event



Change over of *MLink* initiated.

Web Interface redirection

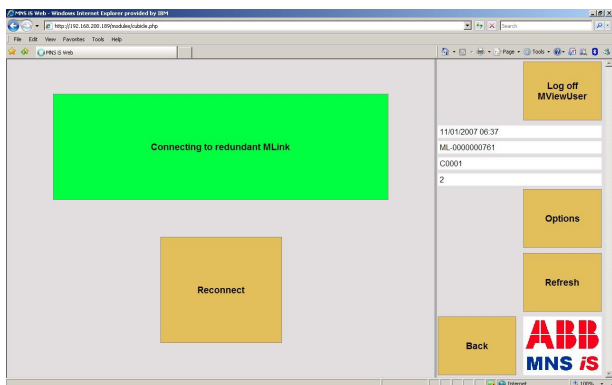


Figure 46 Screen during redundancy redirection

Web Interface redirection


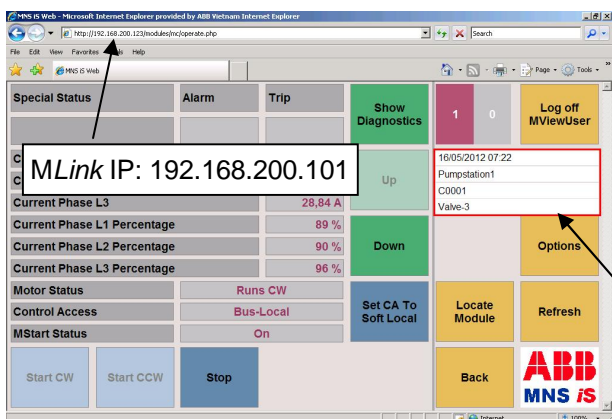


Figure 47 Screen after redundancy event



The red frame on the right hand side is indicating a redundancy error. Please refer to the MNS iS Interface Manual Redundancy for more detailed information.

Modern WEB Layout

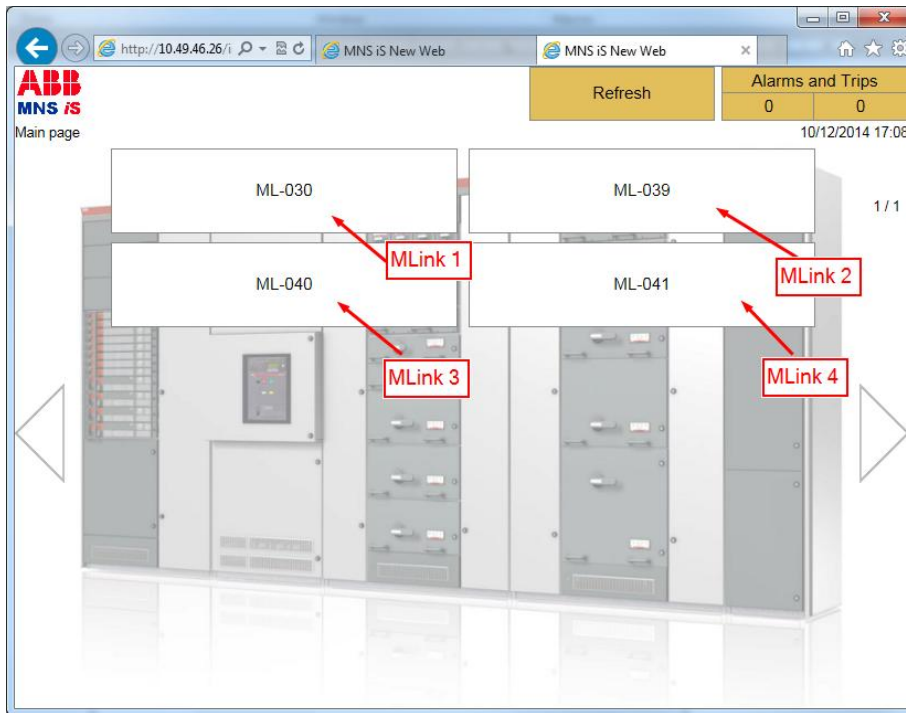

After choosing one MLink by clicking on the related button (e.g. “Pump Station 1”) a logon screen appears:

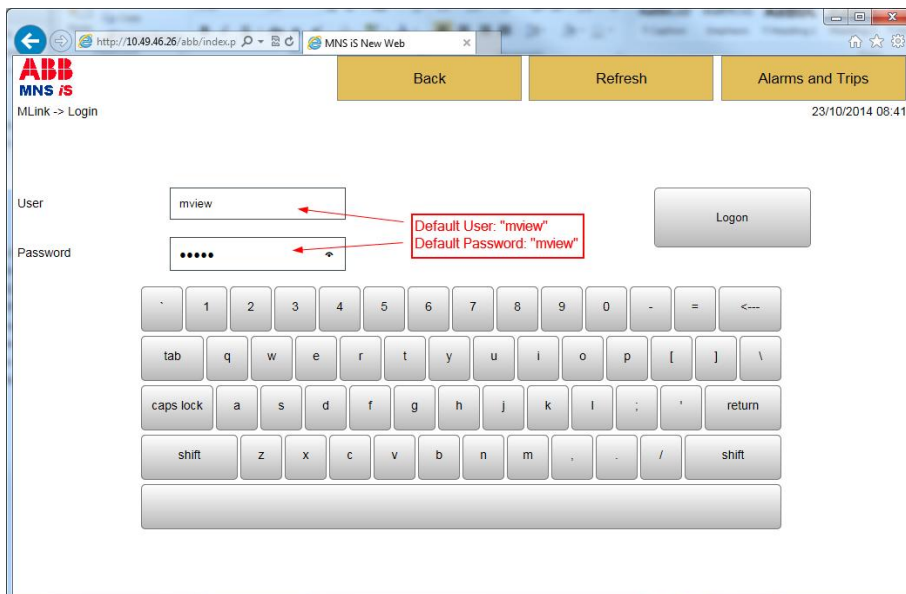


Figure 48 - Logon view

User and password must be entered by the virtual keyboard in the window (on *MView*) or optionally by a real keyboard if present. After selecting the Logon button the entered user and password are checked. For user administration, see document *MNS iS MNavigate Manual*. If the password is correct the user is allowed to access the cubicle selection view:



Figure 49 - Switchgear view

This view shows all available cubicles containing configured MNS iS Power Modules which are connected to the same *MLink* (via *MControl*). This screen contains maximum 2 cubicles. If there are Power Modules in more than 2 cubicles connected to one *MLink* then the green arrows on the right and left hand side can be used to navigate between the cubicles. After choosing one cubicle (e.g. “S001”) the cubicle front view of the selected cubicle is displayed.

Use the green arrows on the right and left hand side to navigate.



Cubicle View

After selection of a dedicated cubicle the cubicle view appears. It shows information about all devices inserted into the same cubicle. The right hand side of the dialog contains detailed information (**Information Area**) about the selected module. A module can be the cubicle itself or a Power Module (*MStart*, *MFeed* or ACB module). It can be selected by single click inside the cubicle schema. As soon as the selection is done a focus (black frame) indicates the selection.

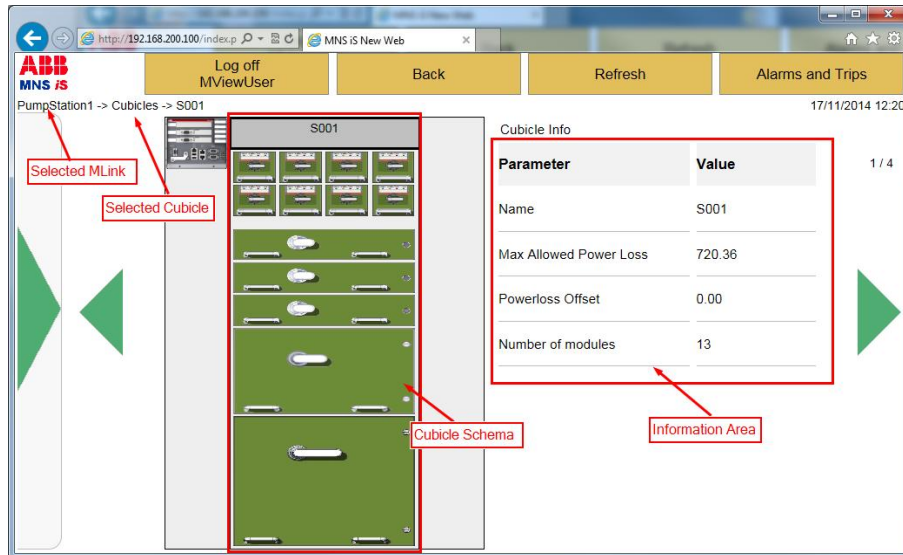


Figure 50 - Cubicle view* - Cubicle selected

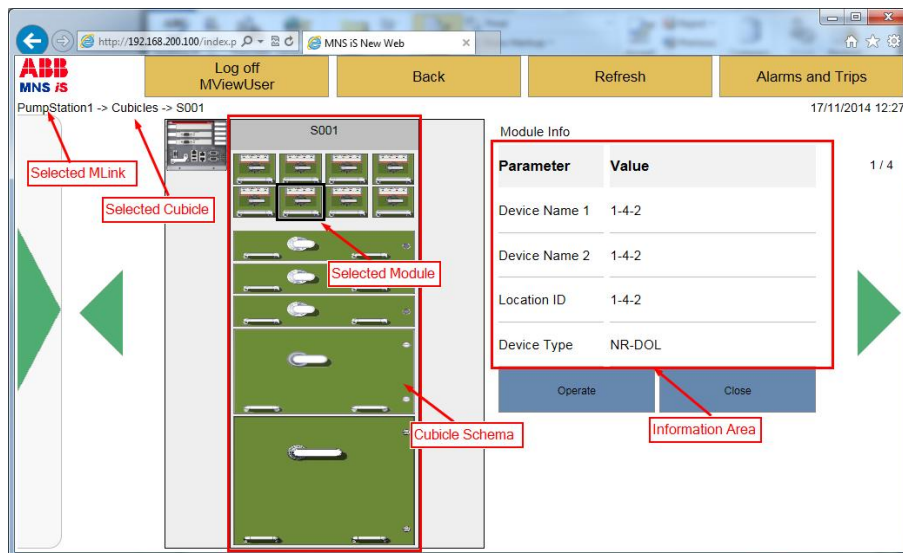


Figure 51 - Cubicle view* - Module (*MStart* + *MControl*) selected

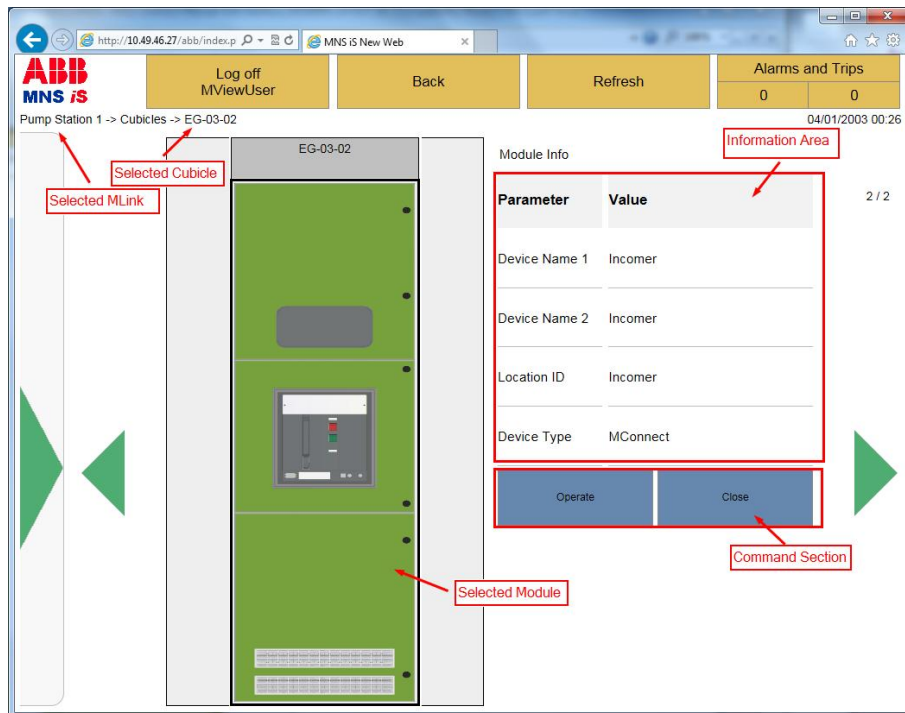
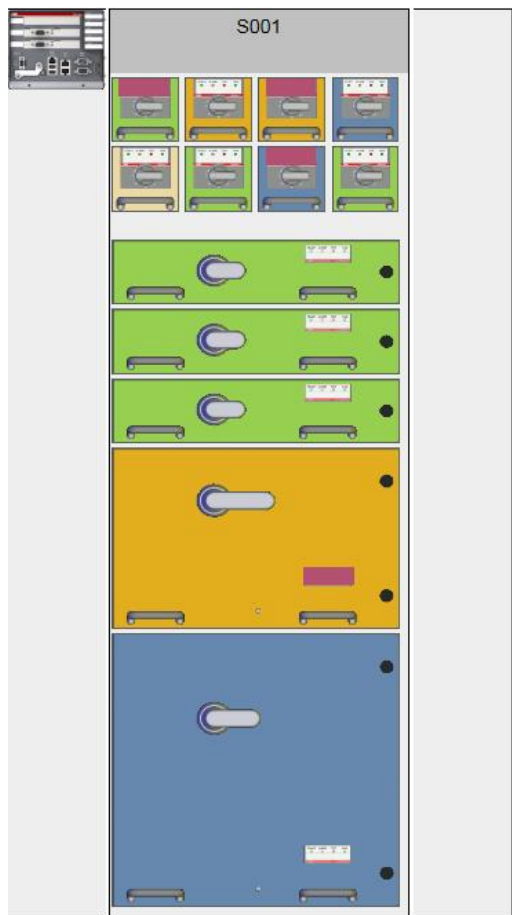













Figure 52 - Cubicle view* - Module (ACB + MConnect) selected

* Colors shown are from the standard MNS iS color profile.

The cubicle scheme shows the positions of the devices in the cubicle. On the left hand side (control compartment) a MLink is shown in the first cubicle. In the middle section all available Power Modules (MStart, MFeed or ACB module) are shown.

The colors depict the status of the combined MControl and MStart combination.

	Colour *	Device Icon	MControl Status
	Grey		Configured according to Device List, but currently absent
	Beige		In place but offline
	Orange ^e		Online and switched on
	Green ^e		Online and switched off
	Blue ^e		Online and tripped
	Orange incl. red stripe ^e		Online, switched on with alarm
<p> All colors that are highlighted with an ^e can be edited in MNavigate with the Web Color Settings function.</p> <p>For more details please refer to the MNavigate Help File</p>	Green incl. red stripe ^e		Online, switched off with alarm
	Blue incl. red stripe ^e		Online, tripped with alarm
	Grey incl. red cross		Configured according to Device List but currently absent, and Application file missing (MControl application, parameter and configuration download required).
	White incl. red cross		Online, Application file missing (MControl application, parameter and configuration download required)

* Colors shown are from the standard MNS iS color profile.

Navigation

After log in to a dedicated MLink it is possible to navigate through all the cubicles inside the same switchgear. After clicking the left hand side arrow a menu is opened showing all cubicles in the same switchgear.

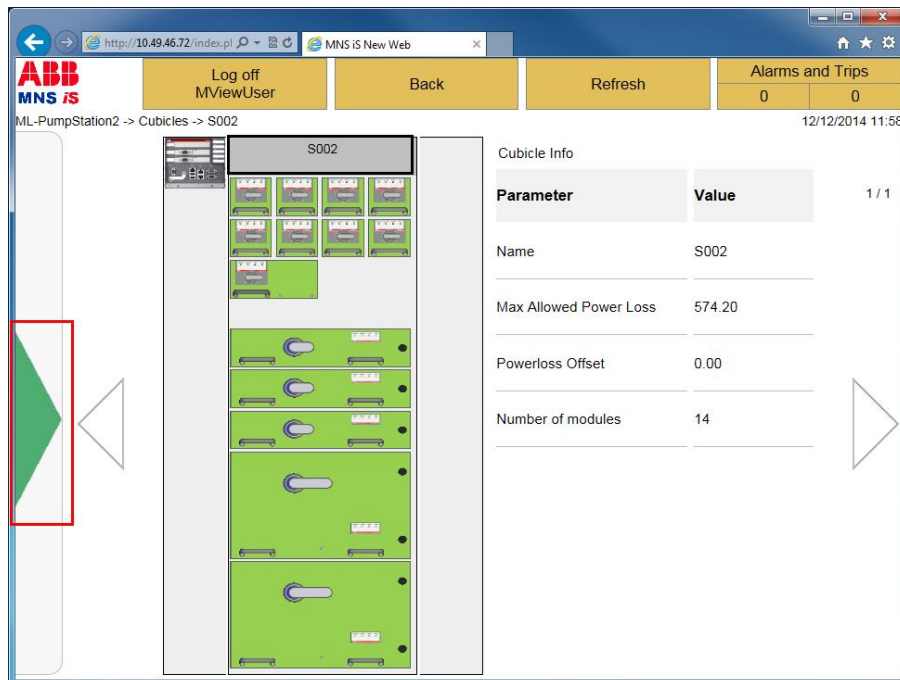


Figure 54 – Switchgear Navigation – Start Overview

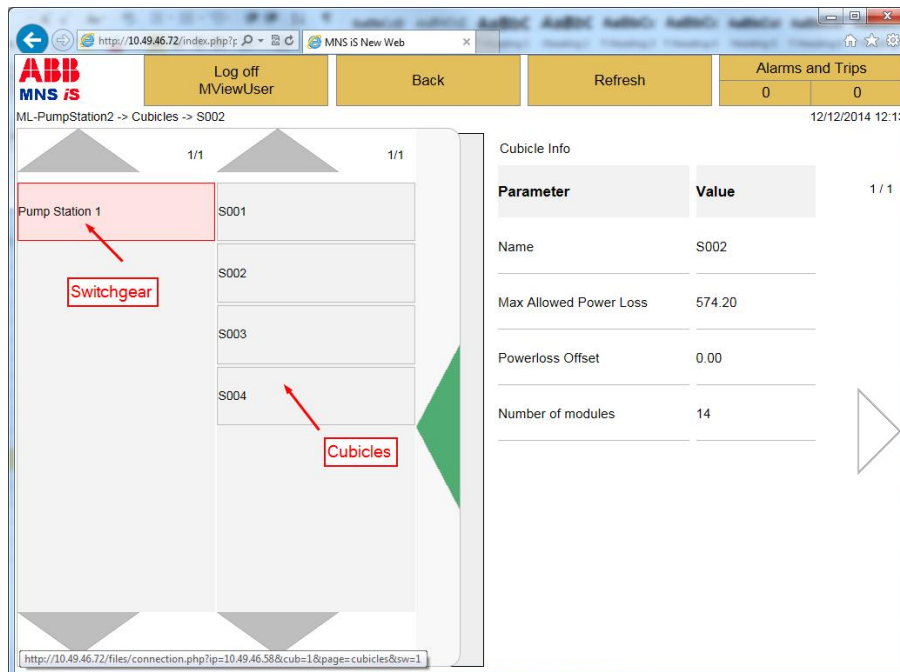


Figure 55 - Switchgear Navigation – Select Cubicle

After selection of a dedicated cubicle the side menu is closed and the cubicle is shown.

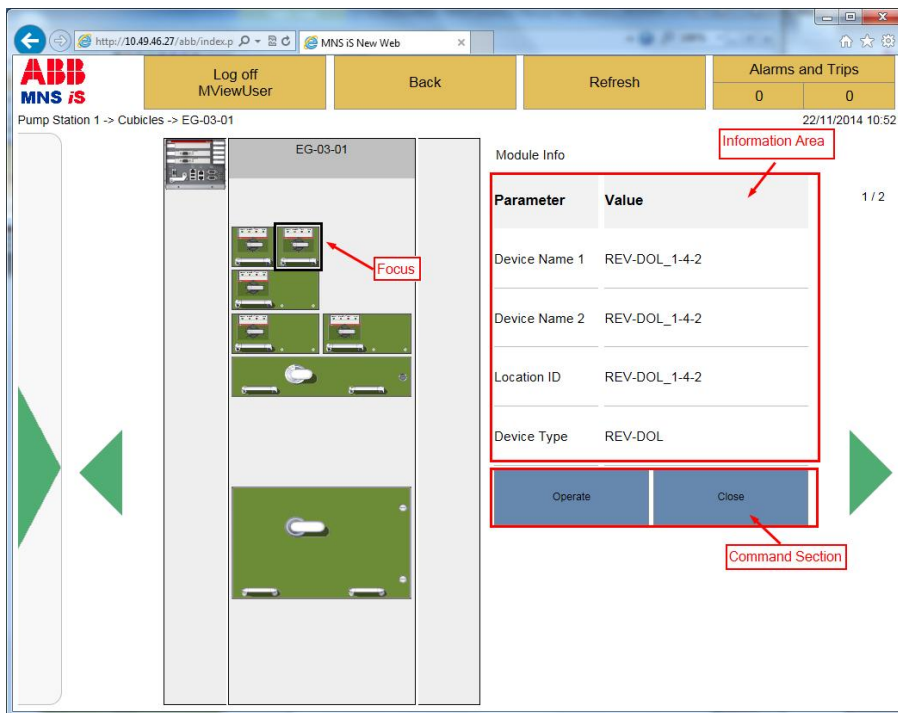


Figure 56 - Cubicle Navigation overview

Module selection is done by clicking on a particular icon. Selected modules are marked with a focus (black frame). After selection the device information is shown on the right hand side (**Information Area**) together with a **Command Section** that contains menu commands.

Dependent on the selected module the **Command Section** contains different options exist:

- When the Cubicle is highlighted there is no additional option available
- When *MControl* is selected **Operate** and **Close** options are available

The **Operate** button will start the **Device Details Page**. The **Close** button will close the **Information Area** for that particular module.

Device Details Page

The **Device Details Page** contains different information and options depending on the selected module. In a first step one of the following icons (representing a module each) has to be selected:

Depending on the selected device type (*MLink*, *MStart*, *ACB*) the layout and options of the dialog are slightly different. The main difference is the **Navigation Bar** which is representing possible actions. After selecting a module and clicking on **Operate** the **Device Details Page** is started.

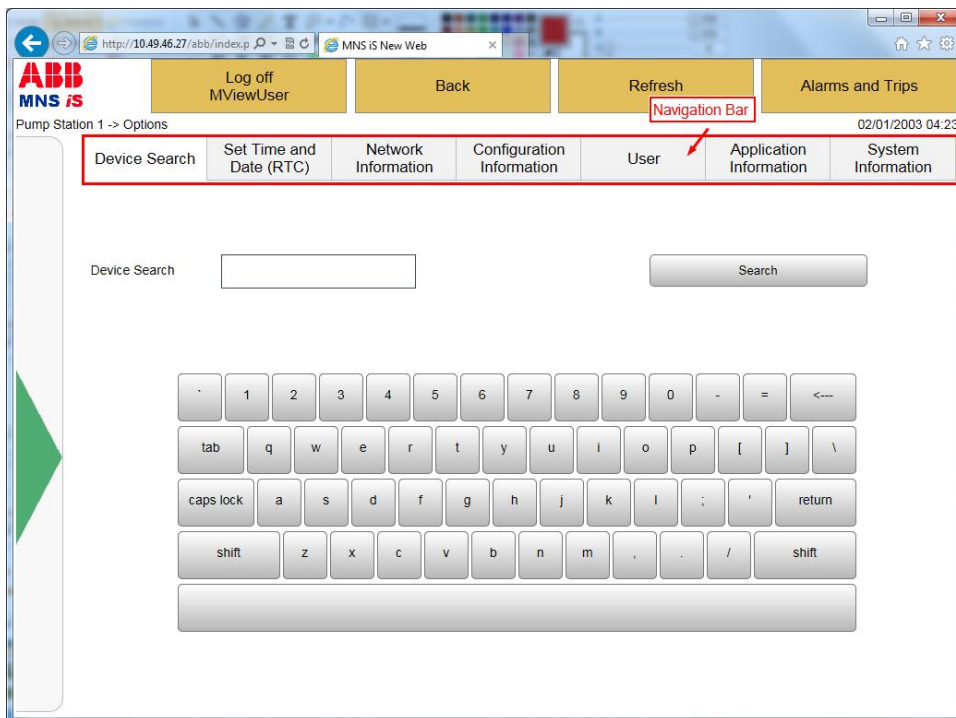
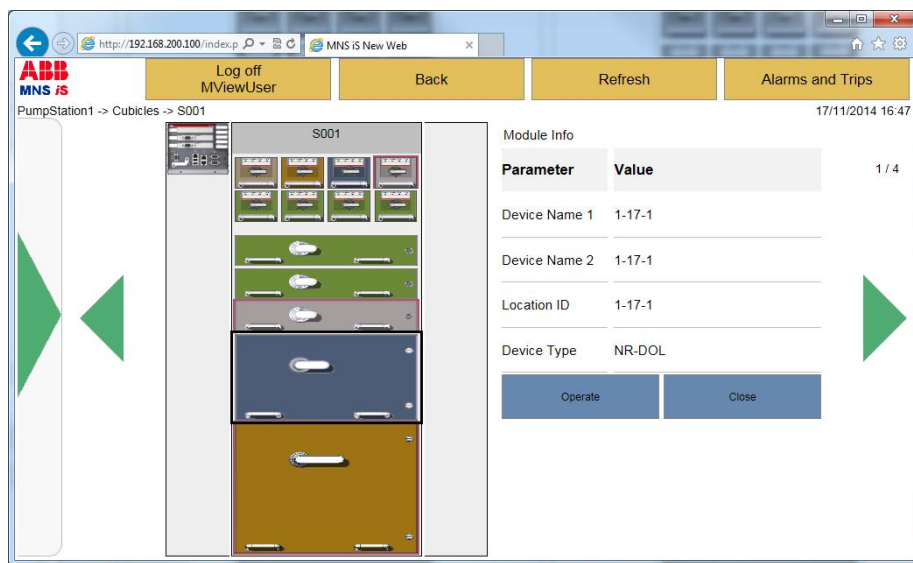


Figure 57 Device Details Page – *MLink*

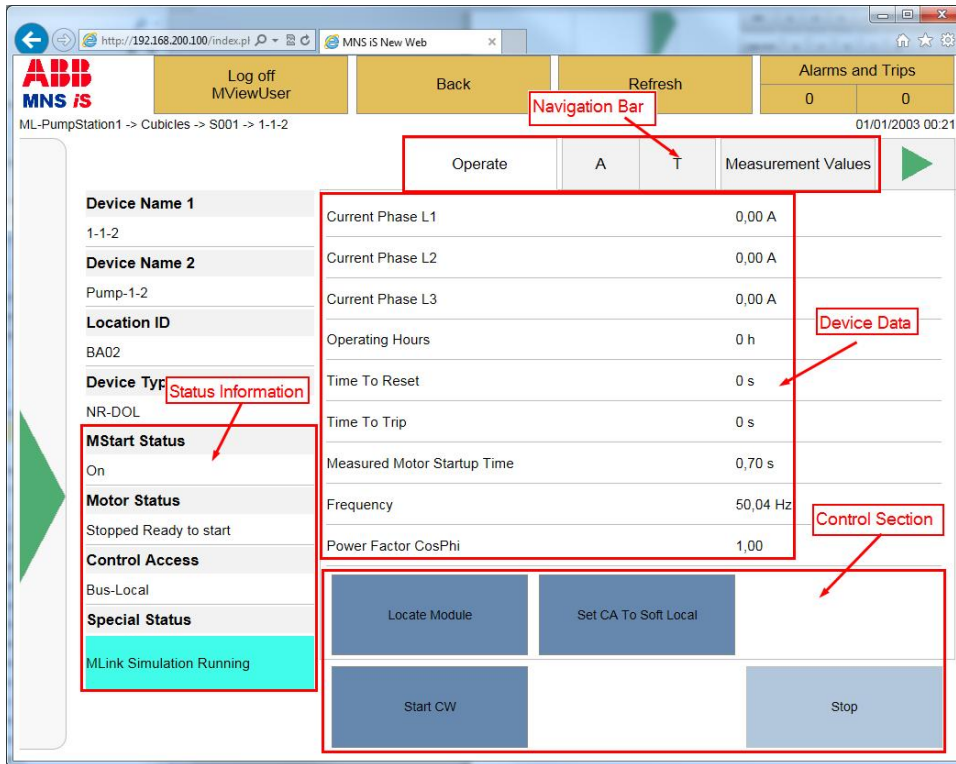


Figure 58 Device Details Page – MStart

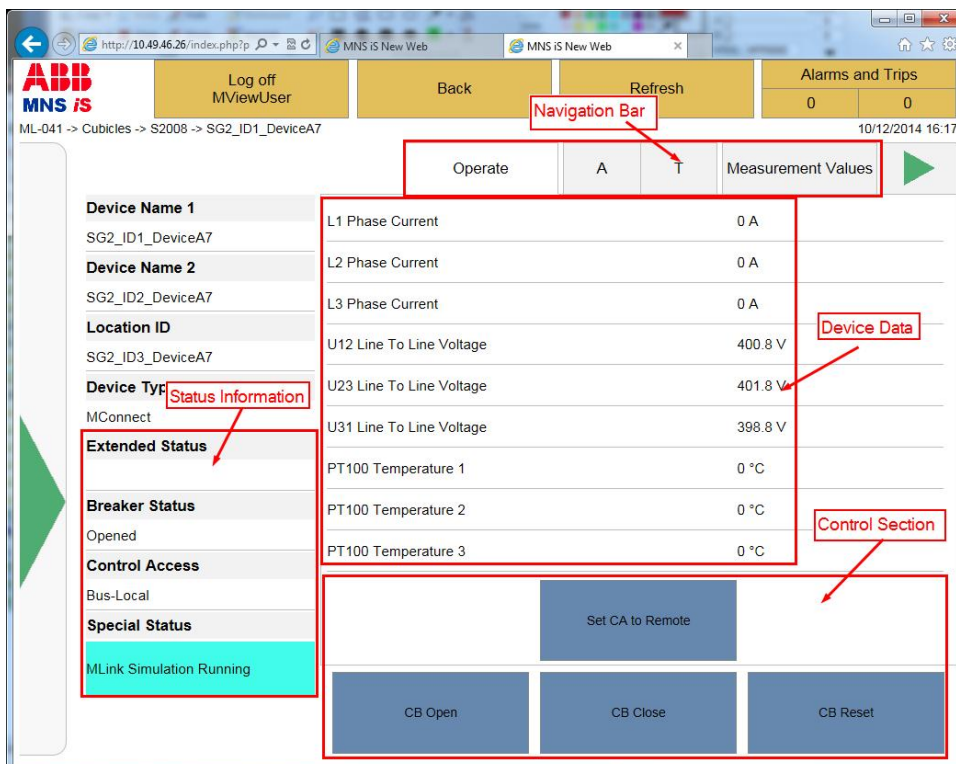


Figure 59 Device Details Page – ACB

The Device Details Page (MStart, ACB) is split into different areas :

Status Information	The status information area shows dynamic device specific information. These information are refreshed as soon as new data is available.
Control Section	The Control Section contains all relevant commands that can be executed.
Device Data	The section Device Data is the main area. Here all relevant information is shown on the selected sheet (see Navigation Bar).
Navigation Bar	<p>The Navigation Bar enables the user to switch between the different categories of device information. Depending on the selection the Device Data section is updated.</p> <p>Left and right green arrow buttons can be used to scroll through the Navigation Bar menus.</p>

The **Navigation Bar** has to be used to select the required information.

MStart / MFeed / ACB (MControl / MConnect)

After selecting an MStart / ACB and clicking on **Operate** the **Device Details Page** appears.

Depending on the user rights the **Device Details Page** gives the user the possibility to:

- Get an overview about the device status ([Operate](#))
- Get an overview about existing alarms / trips ([Alarms and Trips](#))
- See all process data ([Measurement](#))
- View diagnostic data ([Diagnostic](#))
- Retrieve MControl / MConnect Parameter ([Parameter Overview](#))
- Download MControl / MConnect application / parameter & configuration parameter files ([Device Setup](#))
- Retrieve MStart related information ([Device Information](#))
- Retrieve device status information ([Device Status](#))

Operate

In **Operate** the Device Data section contains most significant device data.

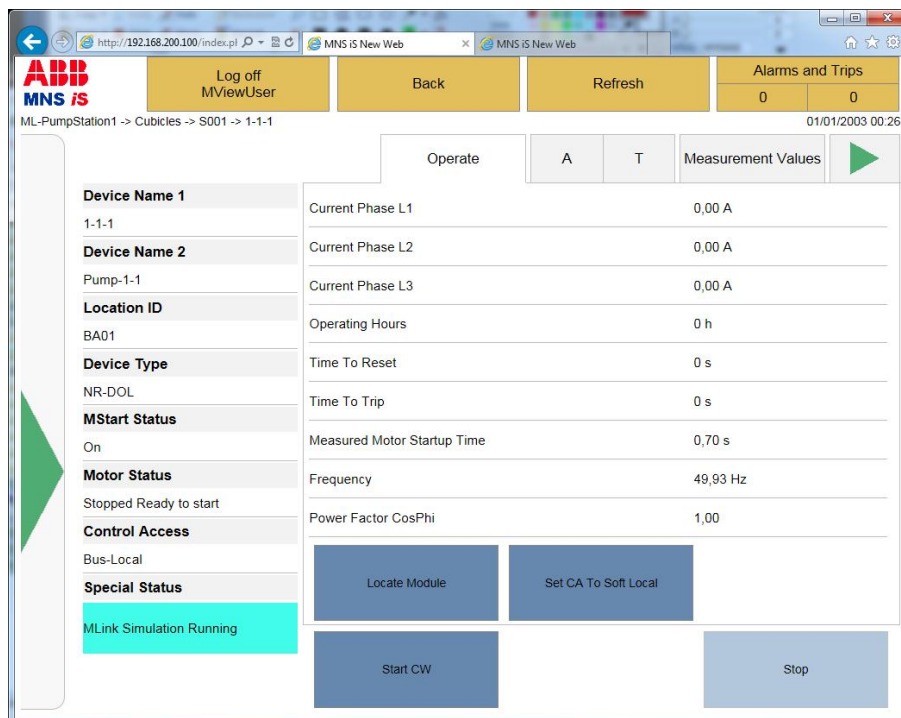


Figure 60 Device Details Page – MStart – Operate

The following actions can be done on that page:

- Send Control Commands to a dedicated device ([Device Control](#))
- Use Control Access mechanism ([Control Access](#))
- Locate a MNS *iS* Power Module ([Locate Module](#))

Device Control

To control a single device by using the Web Interface, the following is required:

- The MControl must be in the ‘Online’ state.
- The User Profile created in MNavigate must allow ‘Switching’ commands to be sent.
- The [Motor Status](#) must be ‘Stopped Ready to Start’, ‘Running’, ‘On’ or ‘Off’.
- The [MStart Status](#) must be either ‘On’ or ‘Test’.
- The [Control Access](#) status must be set to Bus-Local.

Locate Module

The **Locate Module** function enables the user to identify the physical MNS *iS* Power Module in the switchgear panel. As soon as the button is pressed the 4 LED’s on the front of MStart are blinking for a dedicated time interval (40 seconds).

Locate Module button is only enabled when MControl is ONLINE .

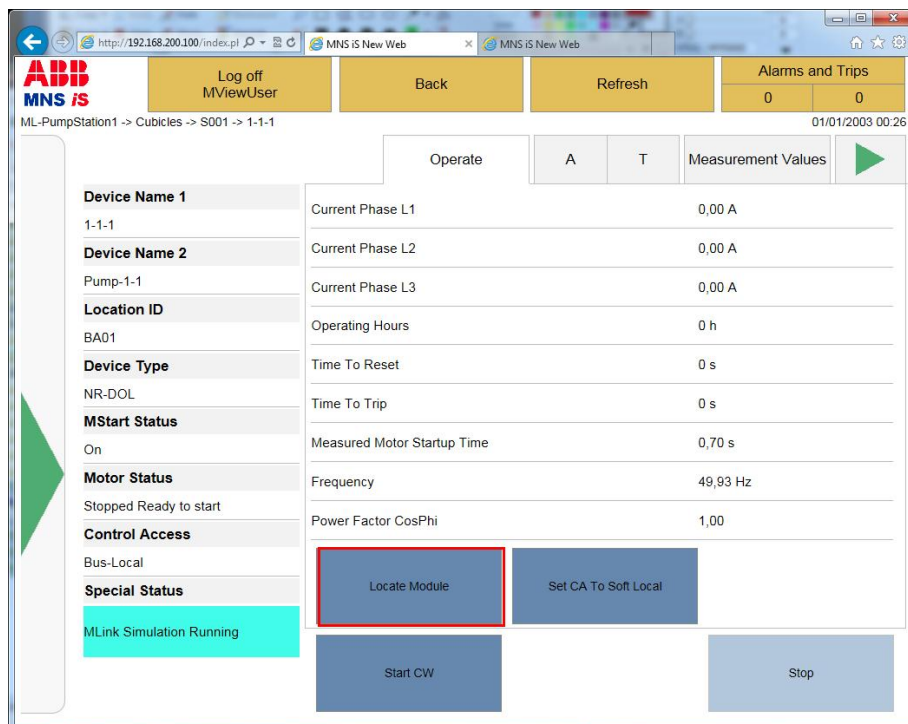


Figure 61: Locate Module Function in Operate Page

Control Access

Control Access (CA) is a mechanism within MNS iS to define and determine which interface has control rights to operate the *MControl* / *MConnect* and connected power module. The handling is defined below.

Control Access rights can be given, for example, by a specific command sent to switch operation rights from push-button (hardwired to *MControl*) to any other interface connected to the switchgear control network (e.g. *MView* or DCS / PCS). Soft-Local or Remote options exist for the CA handling from the Web Interface. It is only possible to have one of these selected for operation on any single *MLink*.

The Control Access module is a central point for the control of the motor / load. There are different stations like DCS (Remote), *MView*, hardwired inputs connected to I/O terminals on *MControl*, from where the motor can be started or stopped or trips can be reset

With the Control Access functionality it can be decided which of these stations is allowed to control the motor / load. When Control Access is used each *MControl* "knows" which station momentarily has the authority to control it. Commands coming from an unauthorized station will not be executed (exception: Reset commands). When *MControl* is powered down the previously selected control authority is preserved and after restart set again.

The Control Access command can be given through Fieldbus command or from *MView* or hardwired (HW) on *MControl* terminal.

The following possibilities exist for **Control Access**

Control Access
Remote

Control from Process / Plant Control System via the Fieldbus interface of *MLink*.

Control Access
Bus-Local

Operation is possible via *MView* (local panel in switchboard) or via a Web interface (any PC with a Web Browser software).

Control Access
Soft-Local

Operation is possible via digital inputs on *MControl*. Soft Local does not require a hardware input to be set.

Control Access
Hardware-Local


Operation is possible via digital inputs on *MControl*. Hardware Local requires a signal to be set on the 'Local' function, parameterized in *MNavigate*.

Control Access
Direct Fieldbus


Operation is possible only via *MControl* Direct Fieldbus interface card (direct connection).

**CA Status –
Soft Local / Bus Local Operation**

Operation of the CA for the Web interface utilizes the “[select before operate](#)” mechanism.

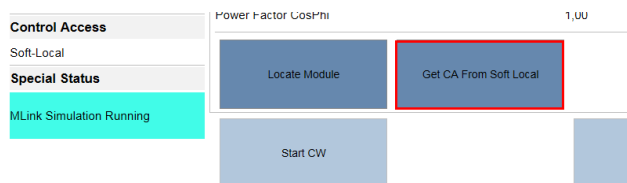

Here the Bus-Local currently ‘Holds’ the CA. The DCS/PCS can at any time request the CA by sending the ‘Remote’ or ‘Auto’ command.

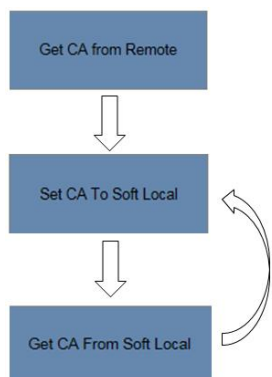

To obtain the CA at the Web Interface, select the red marked ‘Get CA’.... This is possible when the CA has either Remote or Soft-Local status.


Once the CA is Set to Bus-Local it is then possible to Control the MControl from the Web Interface.

From Bus-Local it is then possible from the Web Interface to set the CA to Soft-Local and back to Bus-Local.


Note:

The CA ‘Hardware-Local’ has the highest Control Access priority. Once activated it is not possible to change this CA by any command from DCS/PCS or MView. Only after releasing the CA ‘Hardware-Local’ other control stations are able to change the CA. For more information please refer to the MNavigate help file.

CA Status – Set CA to Remote Operation

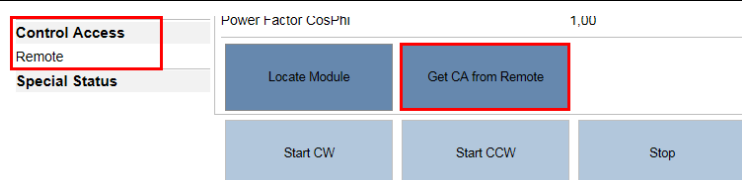

Here the DCS / PCS currently ‘holds’ the CA.




In this mode of operation the Web Interface can at any time obtain the CA from Remote and also return the MControl to Remote operation

Note:


The CA ‘Hardware-Local’ has the highest Control Access priority. Once activated it is not possible to change this CA by any command from DCS/PCS or MView. Only after releasing the CA ‘Hardware-Local’ other control stations are able to change the CA. For more information please refer to the MNavigate help file.

Alarms and Trips

As part of the Navigation Bar there is one selection option which is giving information about active alarms, trips and events. In normal condition (no alarm, no trip) the sheet is not colored and the screen appears as shown below:

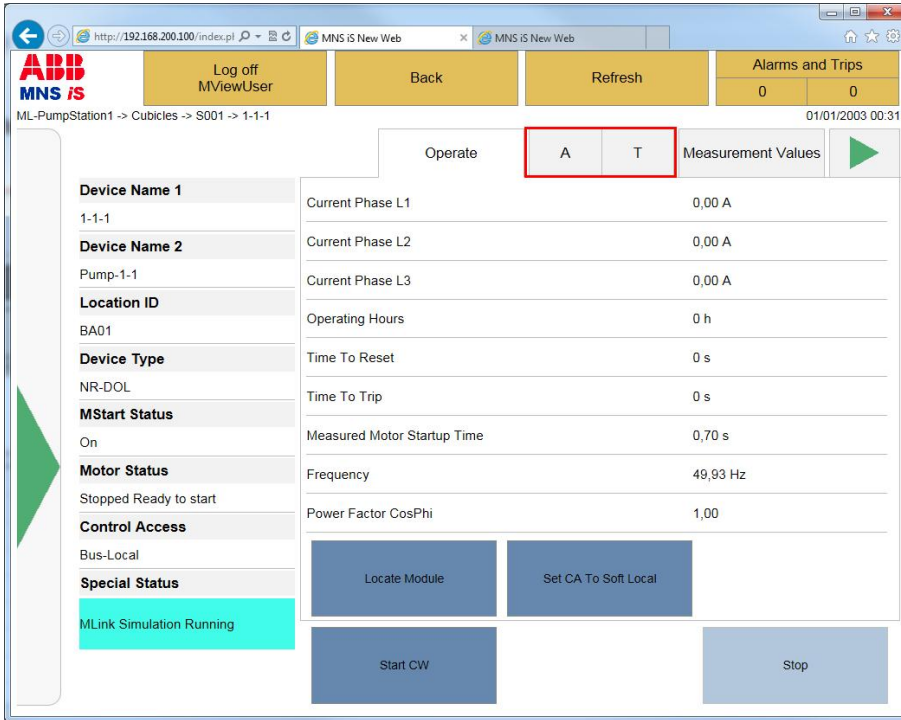

As soon as an alarm or trip gets active the divided sheet selector is colored :

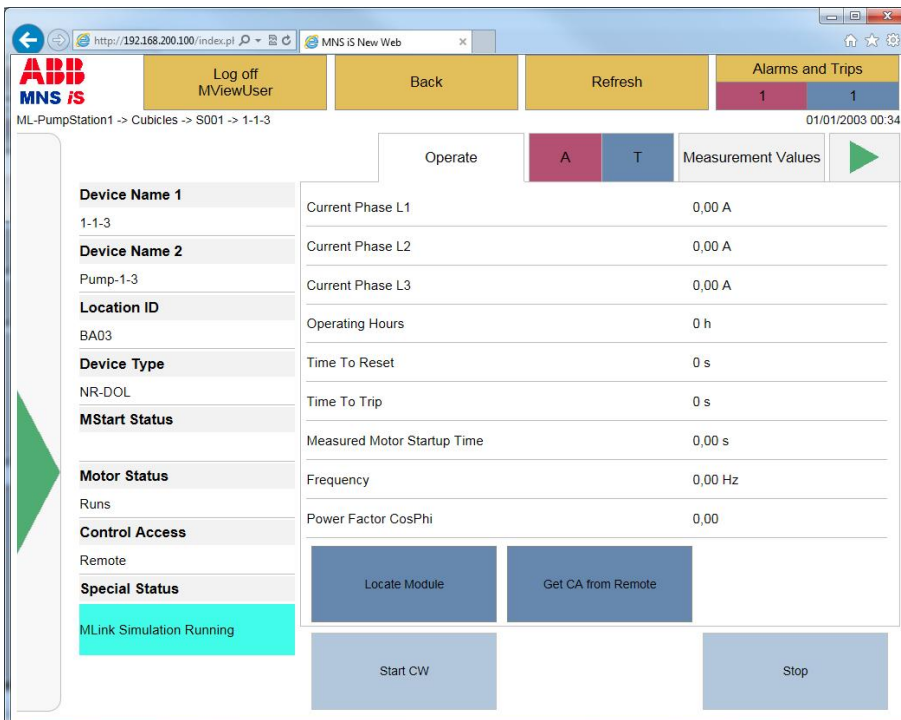



Indication is given if any Alarm or Trip is active. To get detailed information about the event itself the sheet has to be selected.

The following basic possibilities exist for Alarm and Trip indication; other combinations may be displayed due the actual plant operational conditions.



No Alarms or Trips active



Any active Alarm



Any active Trip



Active Alarm and Active Trip



Trip (has been Acknowledged)



Trip (can be reset)

By selecting the Alarms and Trips sheet in the Navigation Bar the user is able to access the alarm view. Here all details about active alarms & trips are available.

All active Alarms and Trips are then displayed for the selected device. The Device Data section contains all active alarms and trips together with a time stamp of the last Event that occurred (this can be either an Alarm, Trip or Event). On the right hand side of the window the type of the information is shown.


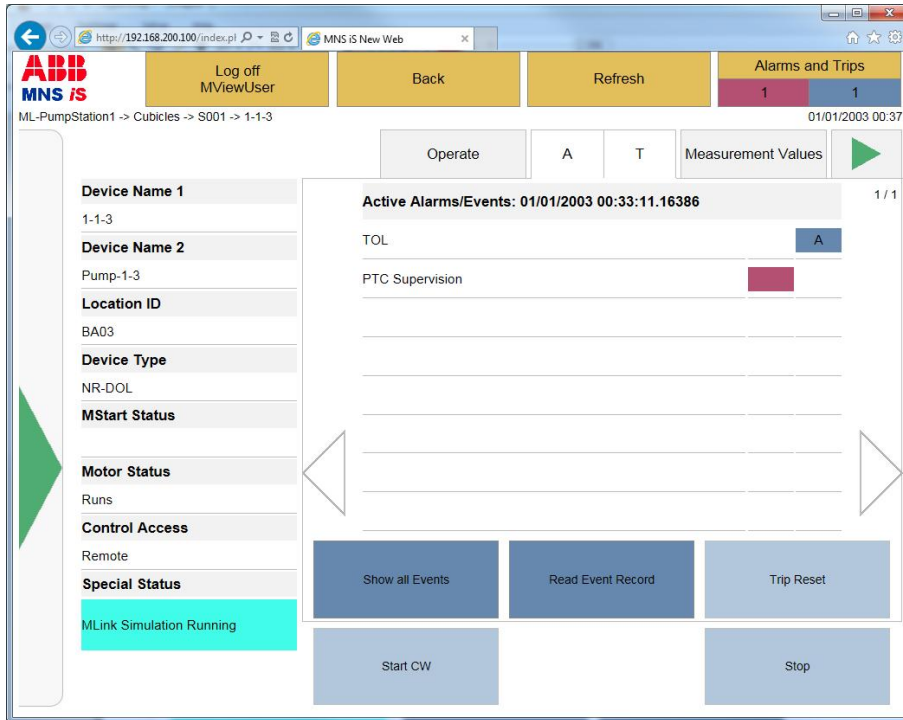


Figure 62 Device Details Page – MStart – Alarms and Trips

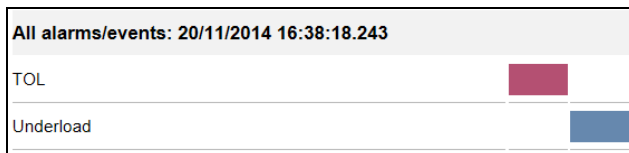


The left column indicates an Alarm, the right column a Trip.

For Trip signals in addition status indication is possible :

R: Resettable Trip

A: Acknowledged Trip




From the [Alarm View](#) the possibility exists to view all events and alarms / trips associated with the particular MControl / MStart / MFeed, independent if activated or not.

This can be done by using the 'Show all Events' button.


By default this view shows only active alarms and trips.

For details please refer: [Show all Alarms / Events](#).



When user clicks on 'Read Event Record' button in Alarm view the last 32 event details related to a particular *MControl* are shown.

For details please refer: [Read Event Record](#)



When user clicks on 'Trip Reset' button in Alarm view an existing *MControl* trip can be reset. Pre-conditions are :



- *MControl* CA status is Bus-Local
- Trip Condition is not active any longer

If the trip condition is still active and the Trip Reset command is sent, the trip will be acknowledged, indicated by (A).


If the trip is resettable and trip was already acknowledged before the entry will disappear automatically. Else the trip resettable information (R) will be displayed to indicate that user can reset the trip.

Show all Alarms / Events

Alarms / Events displayed depend upon project configuration.

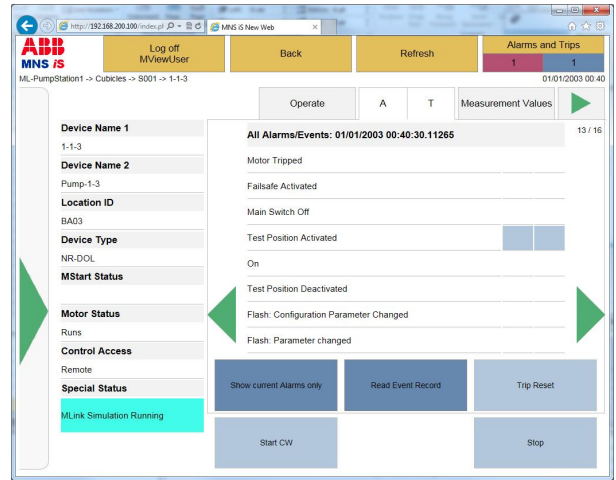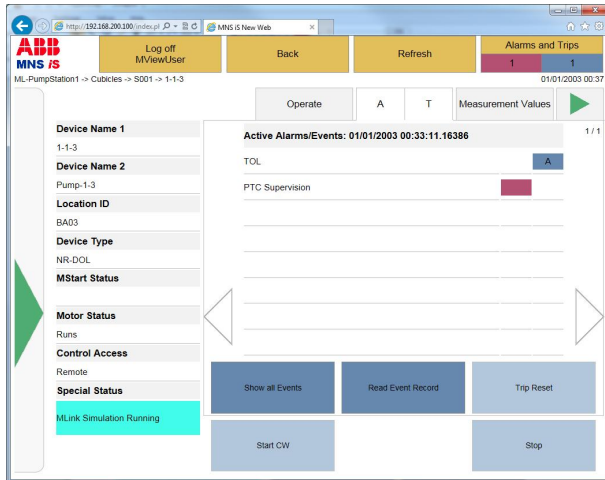

When entries are in Alarm / Trip format they are displayed with both Alarm and Trip indication



Event entries are displayed as below



Figure 63 Alarms and Events

The green arrows on the right and left hand side can be used for navigation.



Read Event Record

When user clicks on 'Read Event Record' button in Alarm view the last 32 event details related to a particular MControl are shown.

Each entry contains information about Occurrence [Date/Time] / Description / Type.

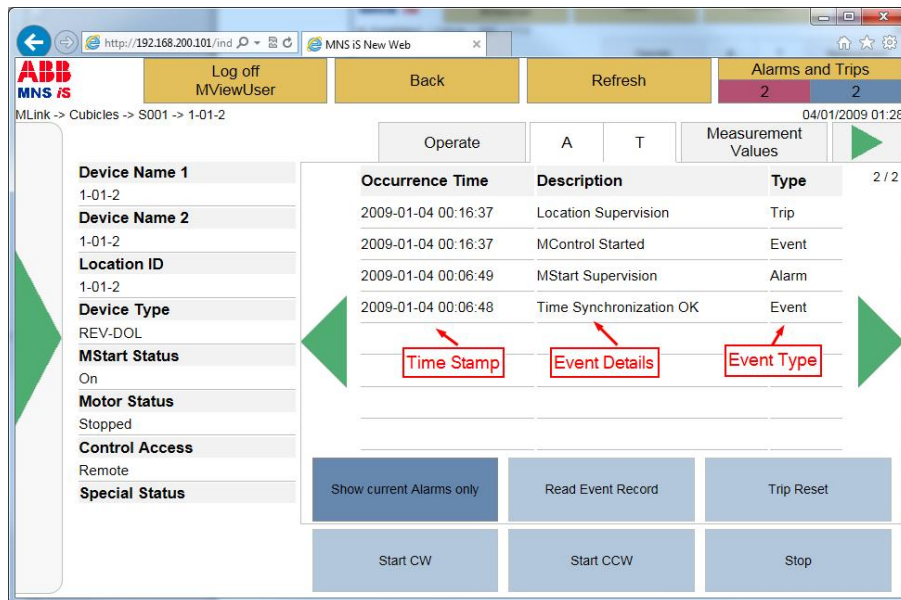


Figure 64 – Read Event Record

Note: The time stamp is related to the time setting of MLink. Accuracy is depending on the selected time synchronization method. For details ref. to MNavigate Help file.

General Alarm/Trip Indication

General Alarm/Trip Indication function informs user about the alarms or trips occurred in any MControl which is connected to any MLink in the network with same MView ID. It also indicates number of alarms or trips occurred in MLink network.

This function is an overall functionality and thus available in the main menu of MView as shown below.

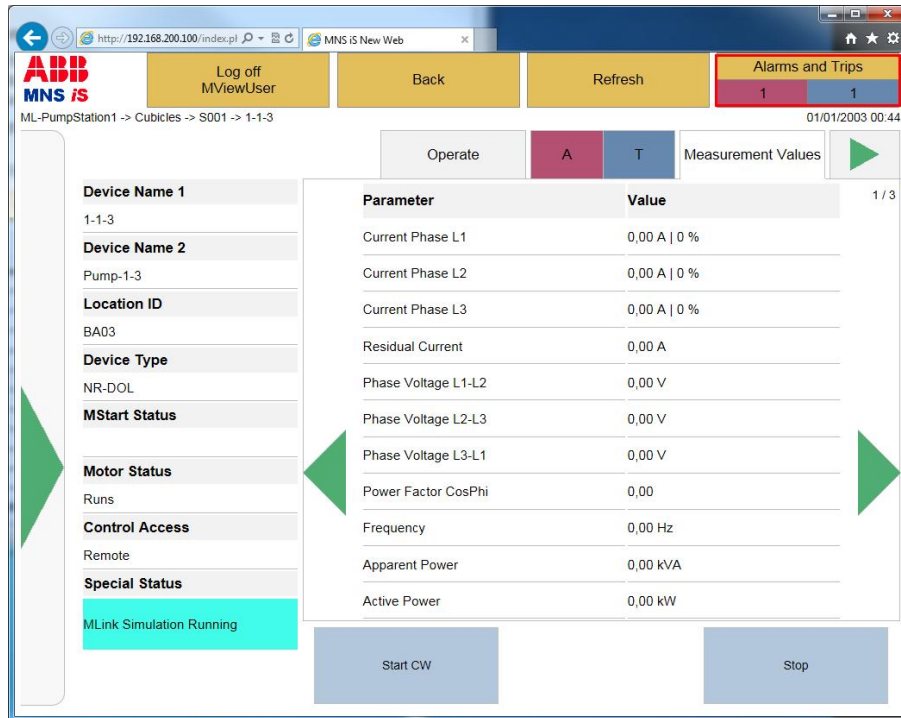


Figure 65: General Alarm/Trip Indication

General Alarm/Trip indication button is partitioned in two sections: one for Alarms and another for Trips. General Alarm / Trip button can have the following layout:

0-Alarm and 0-Trip:

ABB MNS iS	Log off MViewUser	Back	Refresh	Alarms and Trips	
				0	0

1-Alarm and 0-Trip:

ABB MNS iS	Log off MViewUser	Back	Refresh	Alarms and Trips	
				1	0

0-Alarm and 1-Trip:

ABB MNS iS	Log off MViewUser	Back	Refresh	Alarms and Trips	
				0	1

1-Alarm and 2-Trip:

ABB MNS iS	Log off MViewUser	Back	Refresh	Alarms and Trips	
				1	2

Note:

Colors shown are from the standard MNS iS color profile. User can change colors of Alarm and Trips by changing web color settings in MNavigate.

When user clicks on General Alarm/Trip indication button the page will list all the devices containing Alarms and Trips occurred in MLink network (MLink with same MView ID).

The list gives information of MLink name to which the device is connected and Device Identifier name and also the type of event which can be an Alarm or a Trip.

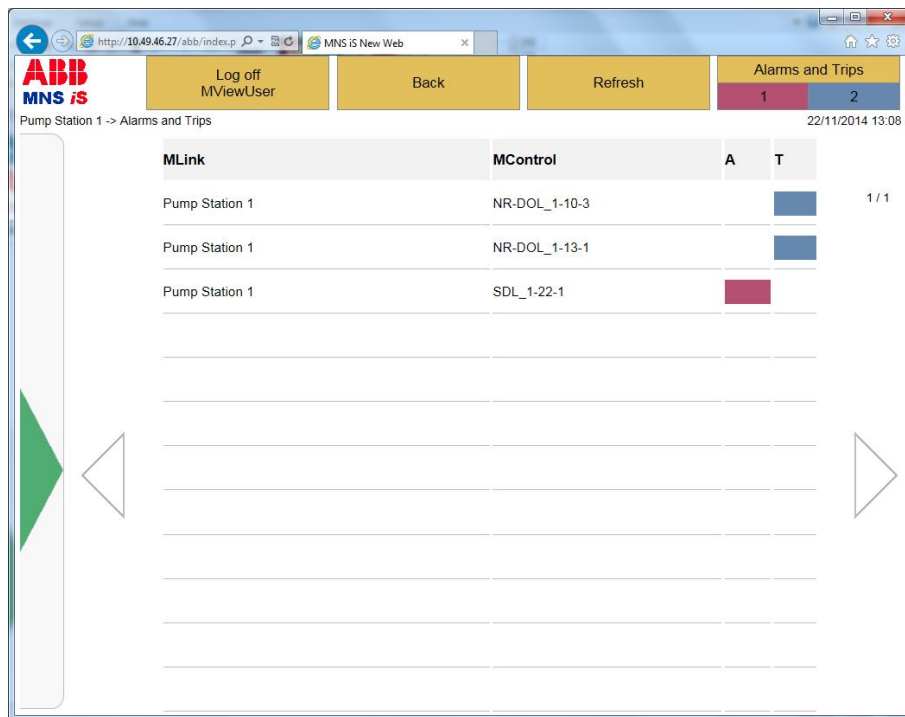


Figure 66: Plant Alarm page

Selecting one of the listed devices will redirect to Alarm/Event page of that particular device for detailed Alarm/Trip information.

Note: If the user account of the current logged in user exists also for the MLink to which the selected device is connected then the redirection is done automatically.
 If not the user has to enter the credentials before redirection to Alarm/Event page.

Measurement Values

The **Measurement** sheet shows all measurement values belonging to the selected device. The content can vary depending on the project settings.

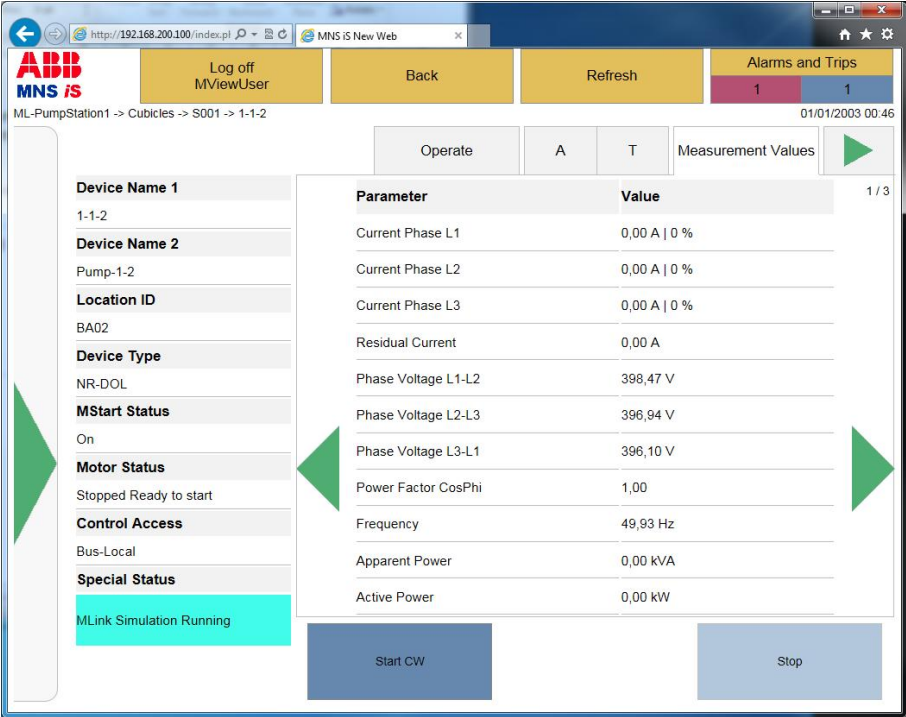


Figure 67 Device Details Page – MControl / MConnect - Measurement

The green arrows on the right and left hand side can be used for navigation.



Diagnostics

The **Diagnostics** sheet shows all measurement values belonging to the selected device. The content can vary depending on the project settings.

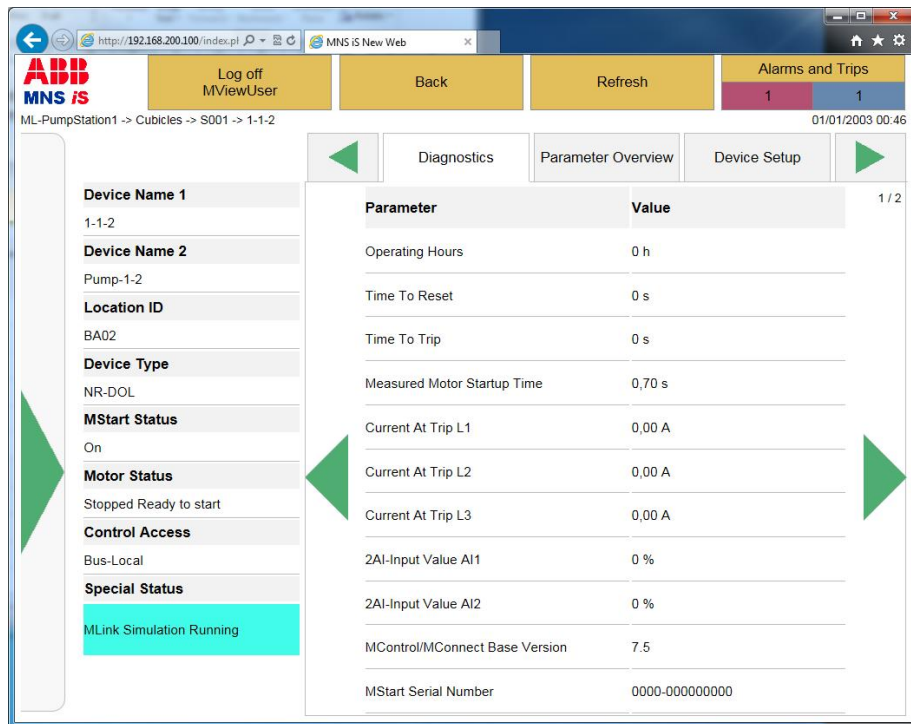


Figure 68 Device Details Page – MControl / MConnect - Diagnostics

The green arrows on the right and left hand side can be used for navigation.



Parameter Overview

If the user selects the option **Parameter Overview** the configured software components of the selected MControl / MConnect are shown.

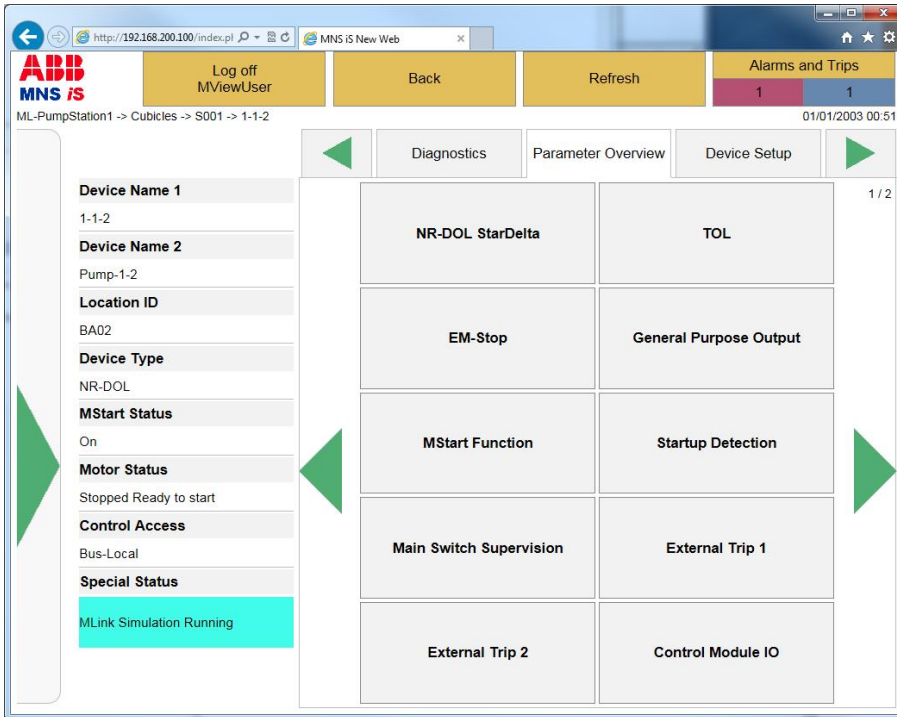


Figure 69 Device Details Page – MControl / MConnect – Parameter Overview

After selecting the parameter module a detailed overview appears:

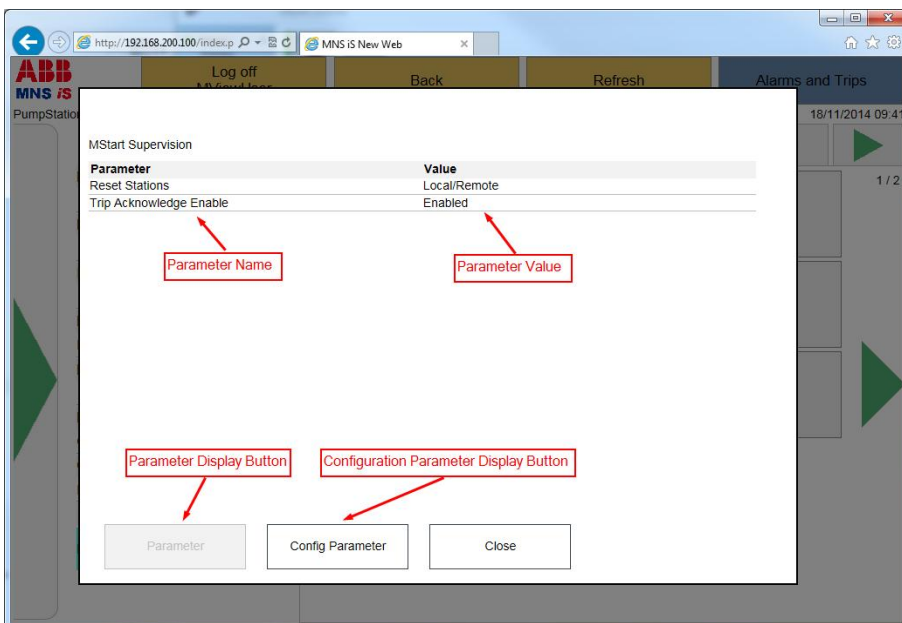


Figure 70 MControl parameter details

When user selects 'Config Parameter' the following screen appears:


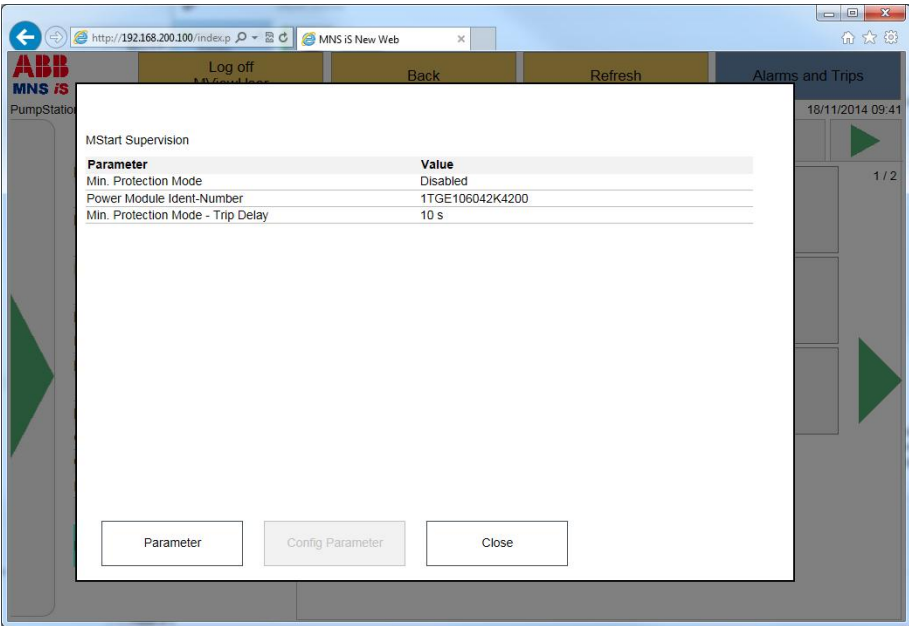


Figure 71 Device Details Page – MControl / MConnect – Configuration Parameter Overview

Use the **Close** button to return to the previous view.



Device Setup

The **Device Setup** provides the following functions dependent upon the User Profile configured in *MNavigate*.

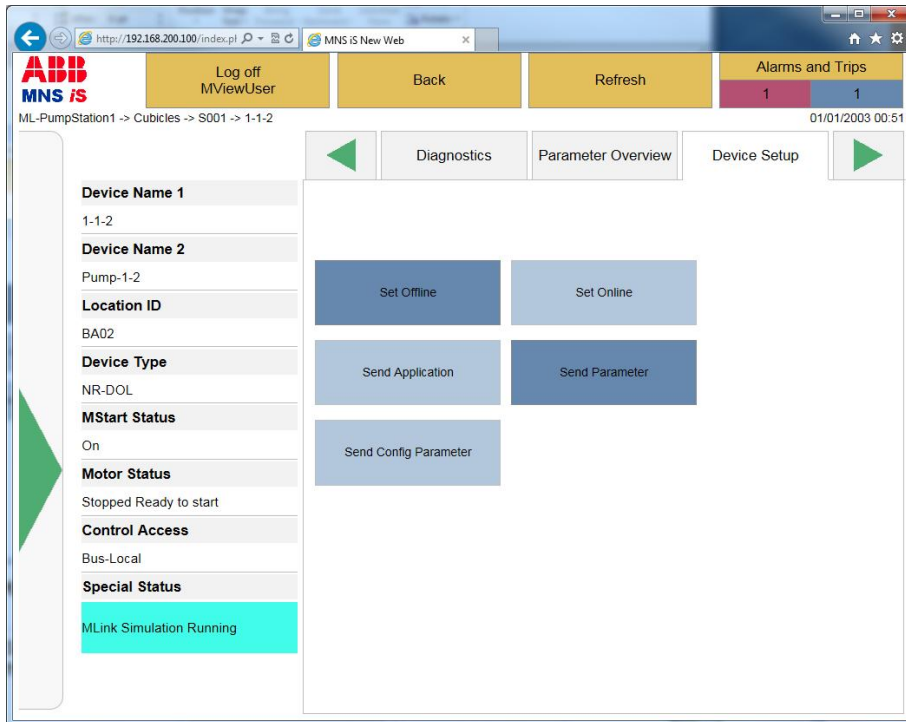



Figure 72 Device Details Page – MControl / MConnect – Device Setup




Sets the MControl / MConnect to Offline status




Sets the MControl / MConnect to Online condition



Downloads the Application to the MControl / MConnect



Downloads the Parameter to the MControl / MConnect



Downloads the Configuration Parameter settings to the MControl / MConnect

set to offline successful (0x00)

If an operation is performed a result message is then displayed at the top of the screen

In some cases the shown setup menu items may not be available (disabled) due to the user profile settings and the *MControl* status. Disabled setup items are shown light blue and cannot be selected.

Device Information

This dialog provides technical information about the selected MNS *iS* Power Module. The information is exported from ABB Engineering tool.

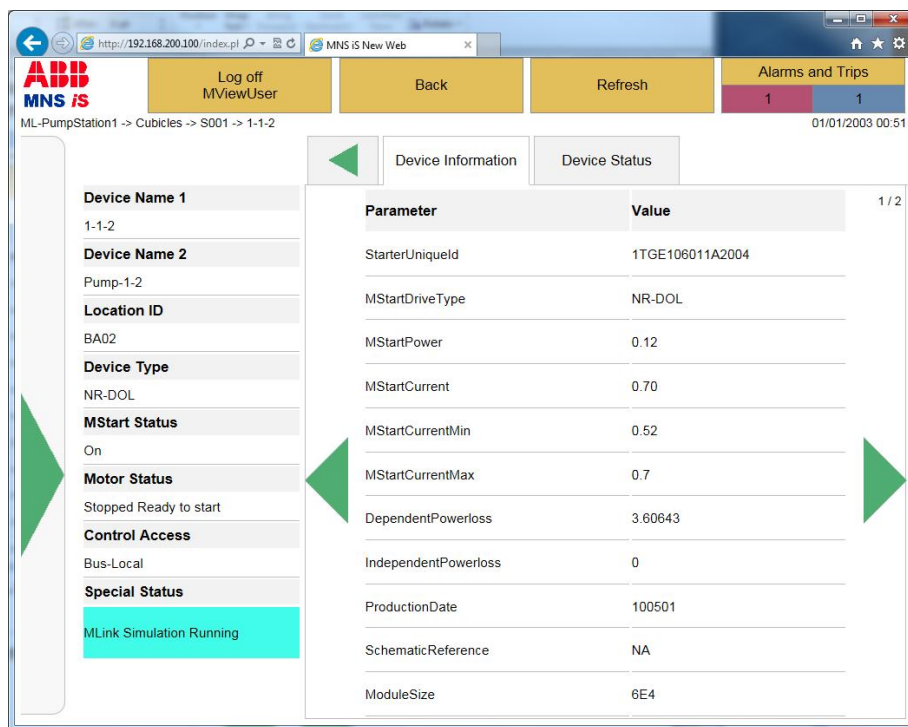


Figure 73 Device Details Page – MStart – Device Information

The green arrows on the right and left hand side can be used for navigation.



Device Status

The **Device Status** screen shows the cyclic updated status of the device and status of MControl / MConnect GPI signals.

Note: The coding of the Device Status is described in OPC User Manual.

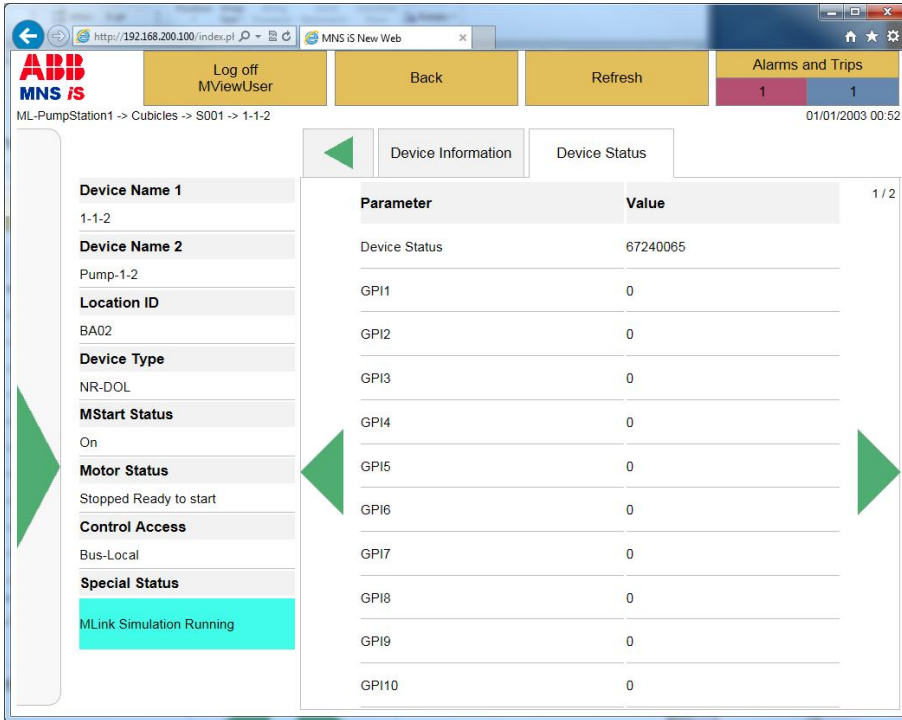


Figure 74 Device Details Page – MControl / MConnect – Device Status

The green arrows on the right and left hand side can be used for navigation.



Status Information

The Status information area is located on the left hand side of the Device Details Page. Information on the Control Access function is contained in the [Control Access status \(CA\)](#) section.

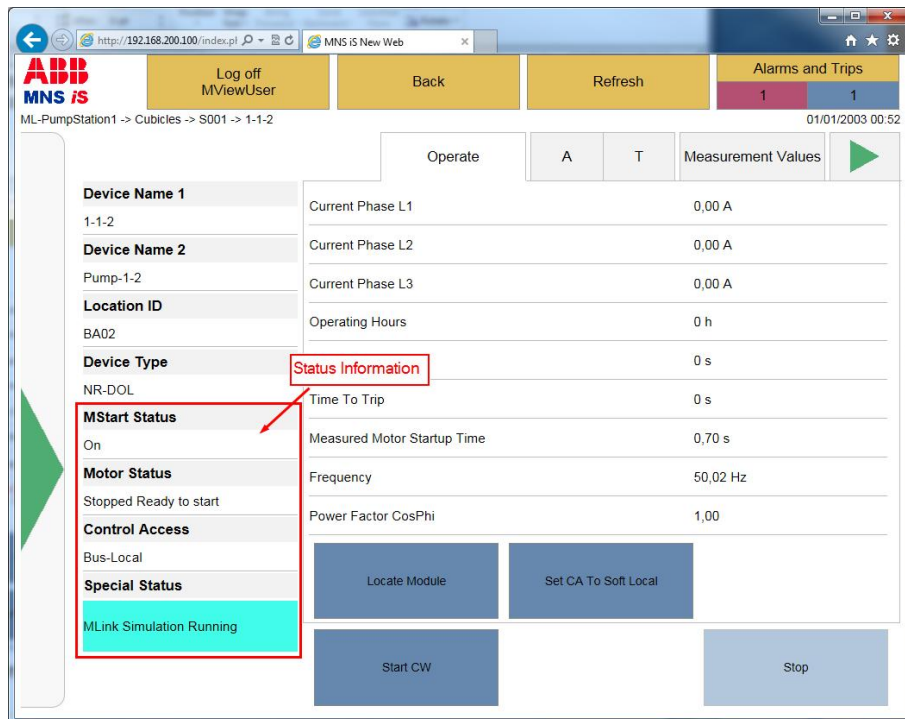


Figure 75 – Status Information Area


MStart Status
On
Motor Status
Stopped Ready to start
Control Access
Bus-Local
Special Status
MLink Simulation Running

The information provides an overview of the configured MNS iS Power Module, the Motor and which interface holds the current Control Access rights.

Motor Status

The following possibilities exist for **Motor Status**.


NOTE: Motor Status information is Starter Type dependent. Please refer to the *MNavigate* Help File for further information.




No Alarms or Trips present.




Starter type dependent information



Stopped due to trip of a Protection function or external action. Cannot be re-started before Trip/interlocking is cleared !




The blue background color indicates that the Failsafe condition was activated (if enabled, ref. to *MNavigate* Help file for details). If enabled the Failsafe is caused by a communication loss between DCS / PCS and MLink or between MLink and *MControl* / *MConnect*.




MStart Status


The following status indication exist for **MStart Status**



Main power and Control circuits connected. Isolator in ON position.




Main power circuit disconnected, Control circuit connected. Isolator in TEST position.




Main power and Control circuits are disconnected. The isolator is in either the OFF position or the ISOLATED position.

Special Status Information


The following status indication exist for **Special Status**




No Information

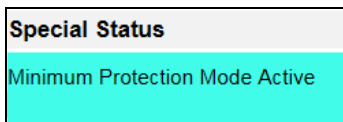

As long as the Minimum Protection Mode is active the information is displayed. For details about Minimum Protection Mode ref. to MNavigate Help file.

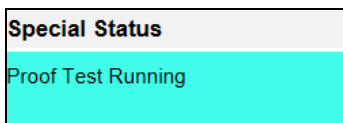


As long as the Proof Test mode is active the information is displayed.

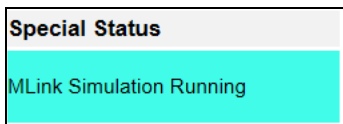


As long as the MLink Simulation is active the information is displayed

Note:


In addition to the above mentioned single Special Status indication a combination is possible. Examples are shown below.

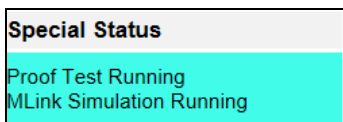

Proof Test & MLink Simulation are active simultaneously.

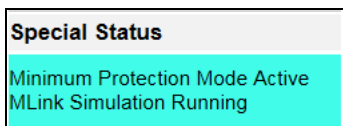

Minimum Protection Mode & MLink Simulation are active simultaneously.

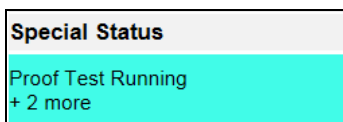

Proof Test & Minimum Protection Mode & MLink Simulation are active simultaneously.


MLink

Depending on the user rights the **Device Details Page - MLink** gives the user the possibility to:

- Search for devices ([Device Search](#))
- Set the internal system time ([Time synchronization](#))
- Retrieve IP Configuration setting ([Network Information](#))
- Retrieve MLink Parameter ([MLink Parameter Overview](#))
- Retrieve User settings ([User Settings](#))
- Obtain application version / status information ([Application Information](#))
- Retrieve System Information ([System Information](#))

Device Search

If the user selects **Device Search** the following screen appears, giving the possibility to find specific Power Modules in a MNS iS system:

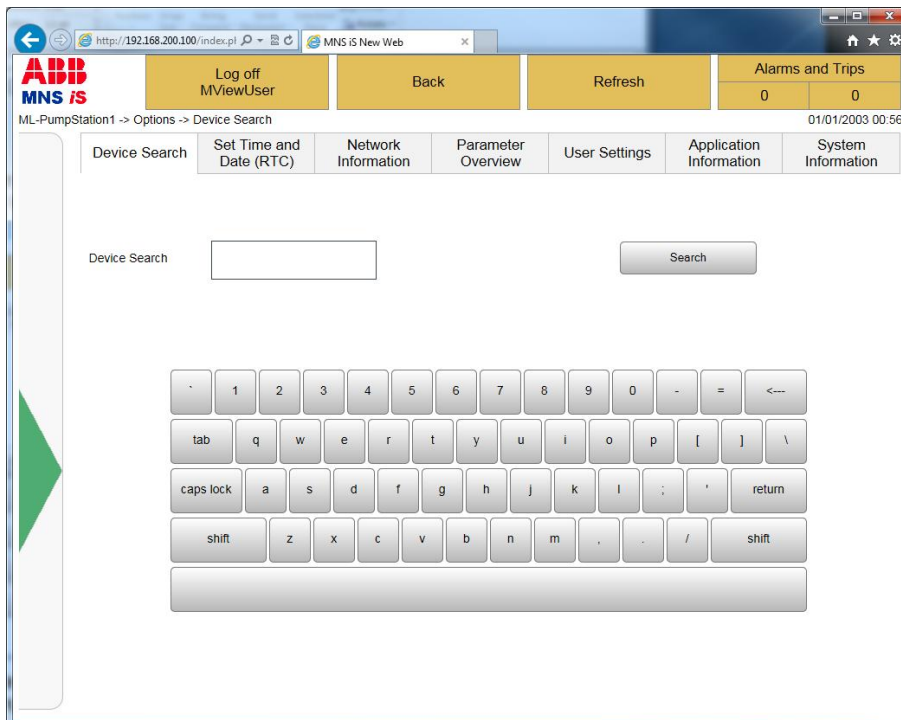


From here it is possible to either enter the full tag name or a group of characters to search for a module. The input field allows entering two supported 'wild' search characters:

- ? Replaces a single undefined character
- * Replaces an undefined string

The *MLink* then searches with the entered Power Module tag name against all 3 device identifiers (Device Identifier 1, Device Identifier 2, Location-ID (Device Identifier 3)). If the Power Module name matches to one of these identifiers the result is shown in a dialog containing three columns. The third column is the identifier the match occurred.

The following shows an example of the correct usage of this feature. Here the shown MNS iS network structure is taken as precondition:

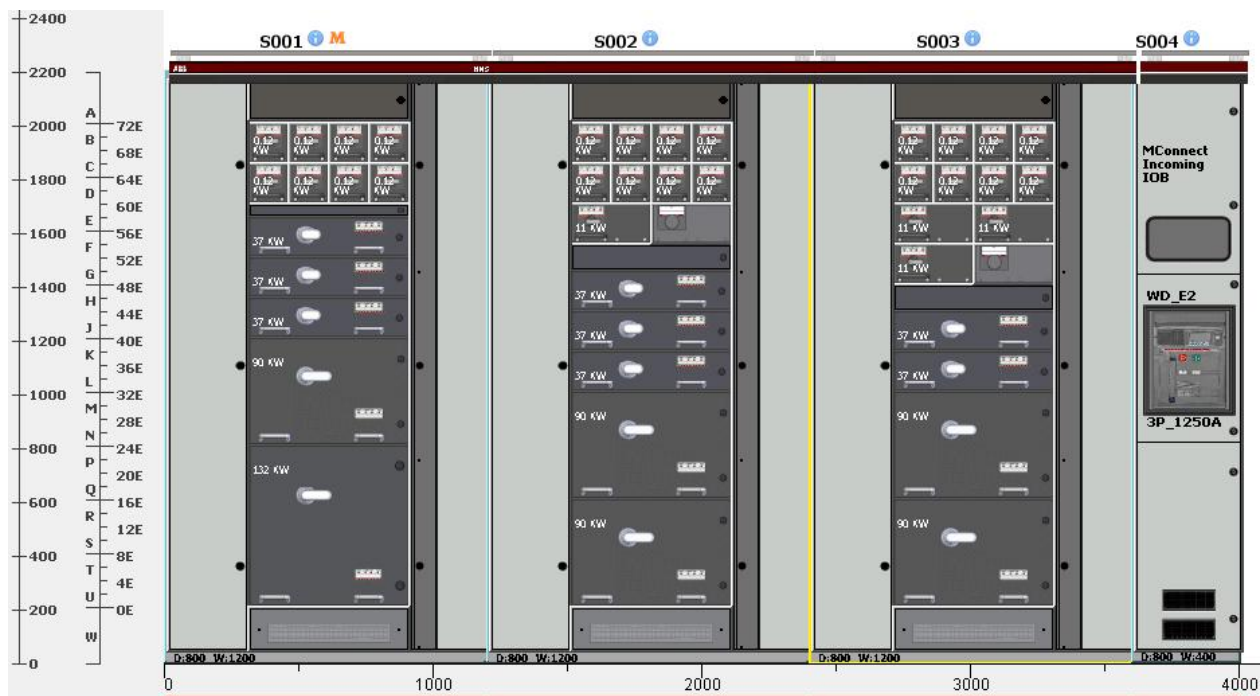

When the physical location and / or the exact name of a Power Module is not known the search function can be used in the following way :

User input: "Pump-1-1-1":

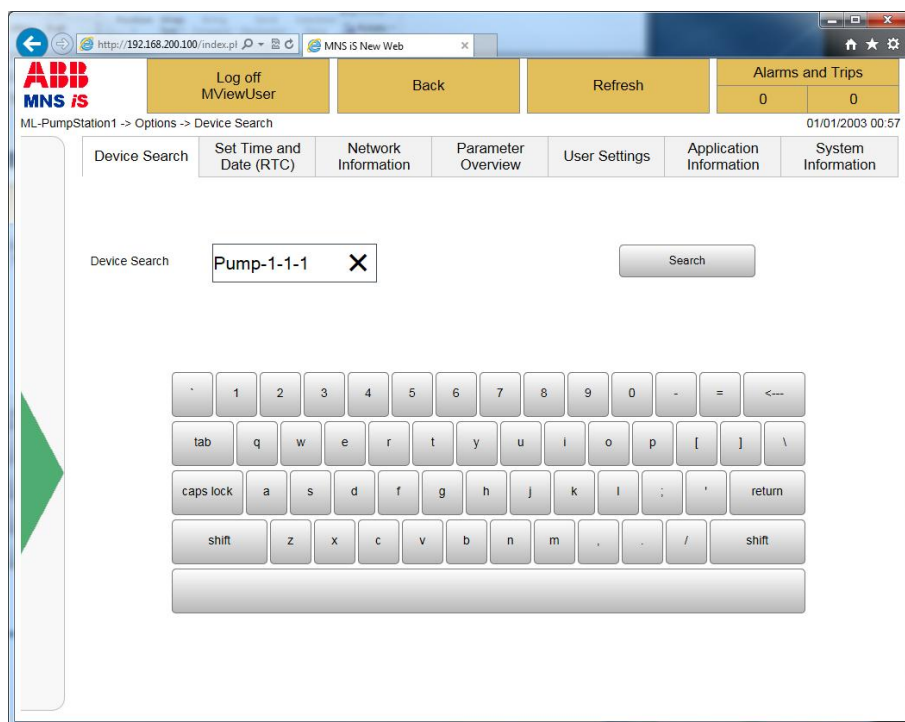


Figure 76 User Input 1

After clicking the **Search** button the results are presented as shown below.

MView output:

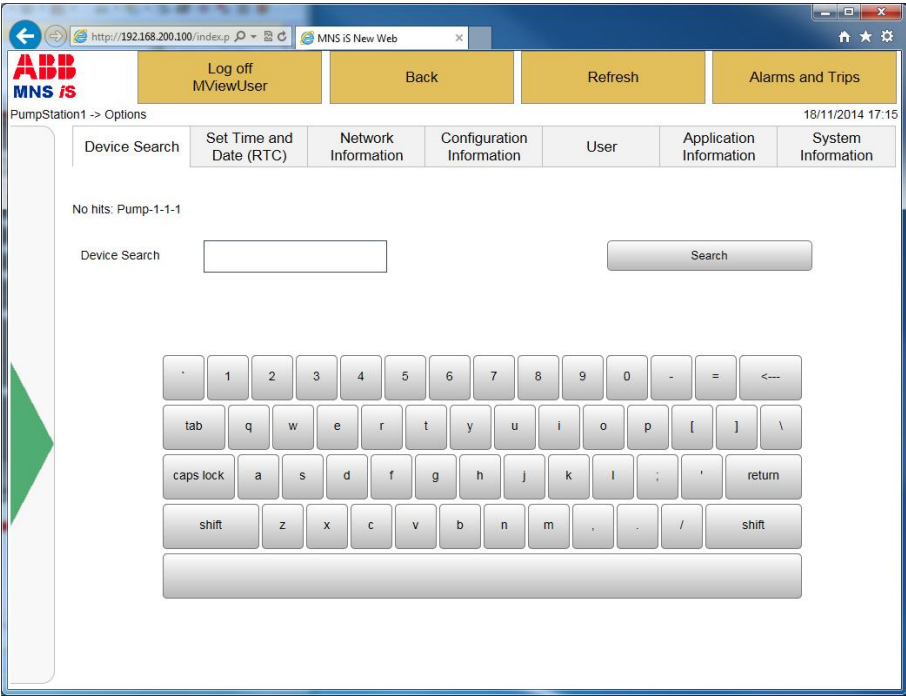


Figure 77 Search Result 1

Result: There is no Power Module “Pump-1-1-1” configured in the MNS iS network.

User input: "Pump-1-1":

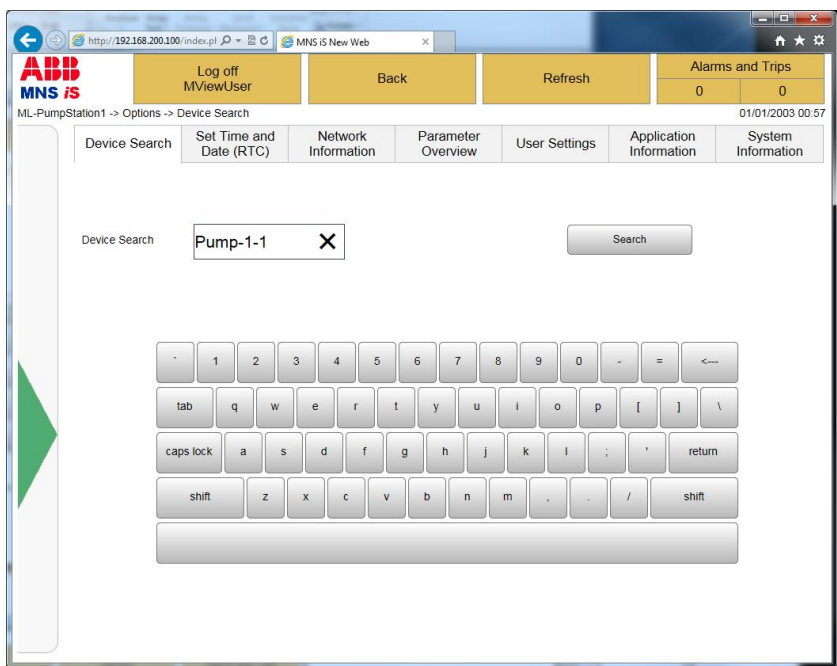


Figure 78 User Input 2

After clicking the **Search** button the results are presented as shown below.

MView output:

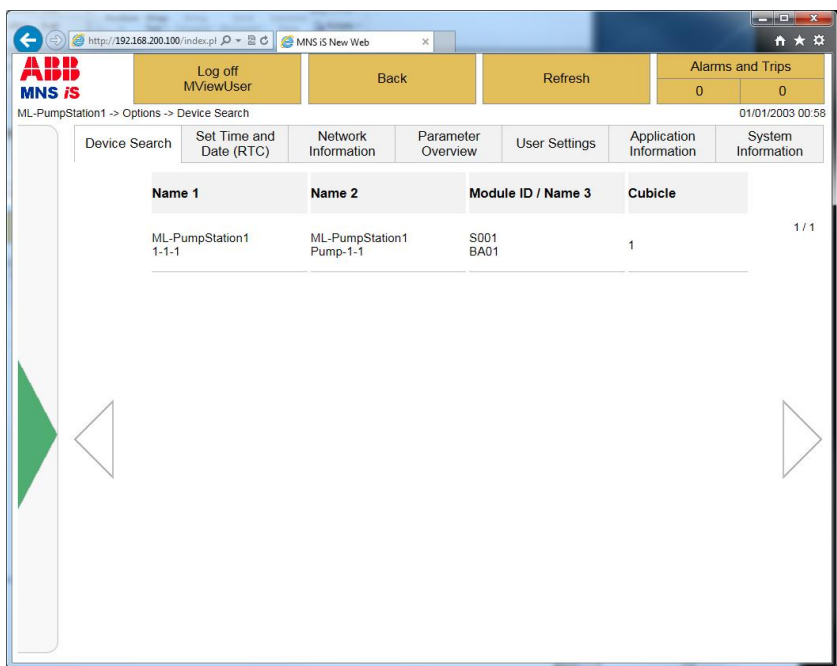


Figure 79 Search Result 2

Result: There is one Power Module configured which uses "Pump-1-1" as Device Name 2 and which is connected to a MLink "PumpStation1" in the MNS iS network. The Power Module is inserted into Cubicle 1.

The next 2 scenario show how to handle the 'wild' character search.

User input: "Pump-?-1" – Search with undefined character

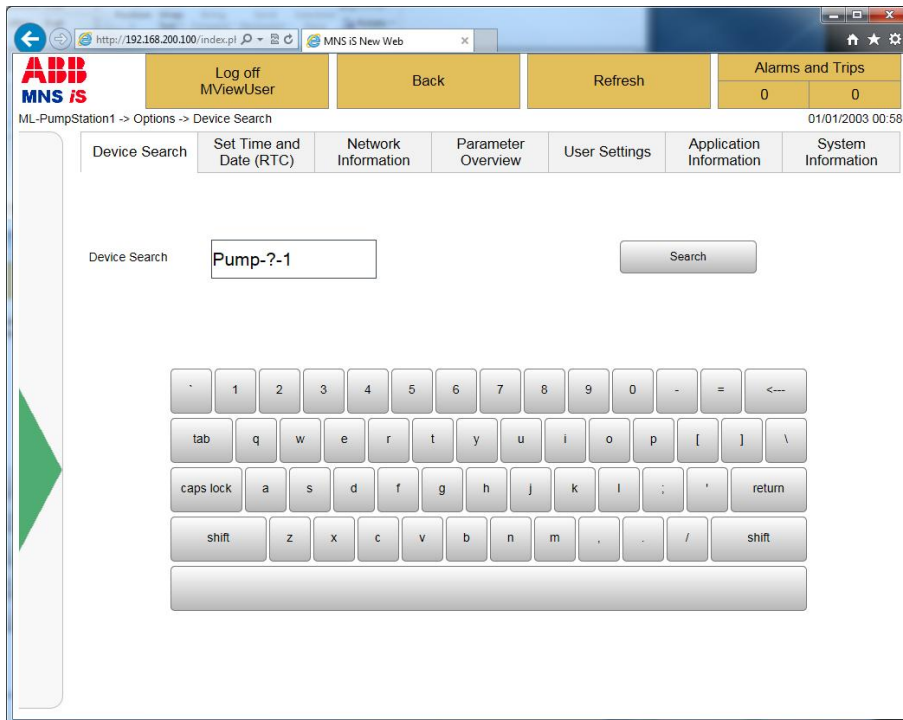


Figure 80: User Input 2

MView output:

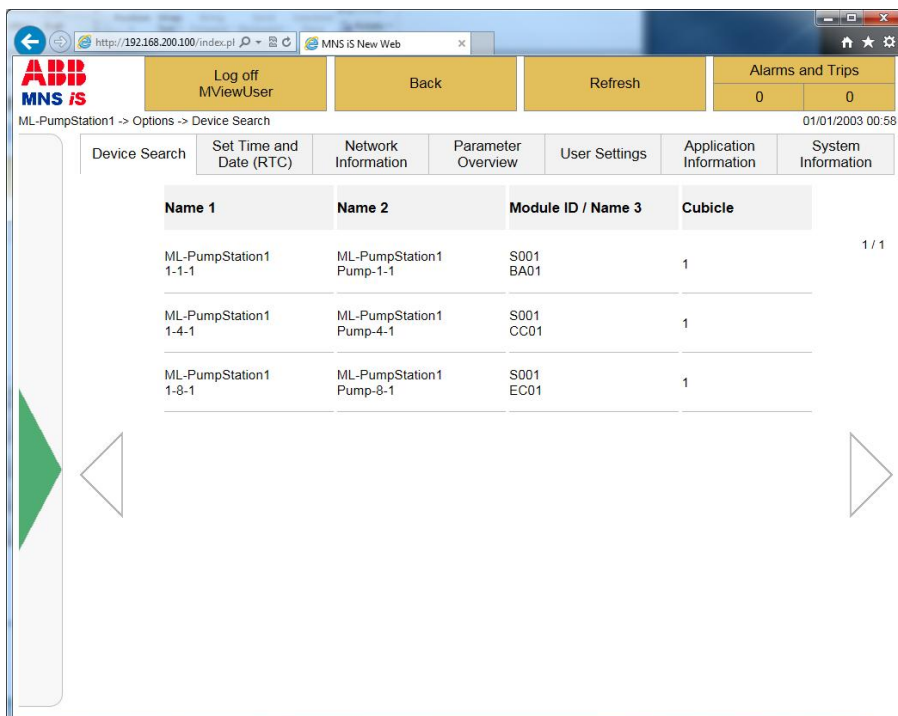


Figure 81: Search Results 2

Result: 3 Power Modules were found. In this case the selected Power Modules are connected to the same MLink (PumpStation1). If the user selects one of these Power Modules (e.g. Pump-4-1) a redirection is done to the Operate Screen of the dedicated Power Module.

User input: "Pump-*" – Search with undefined string

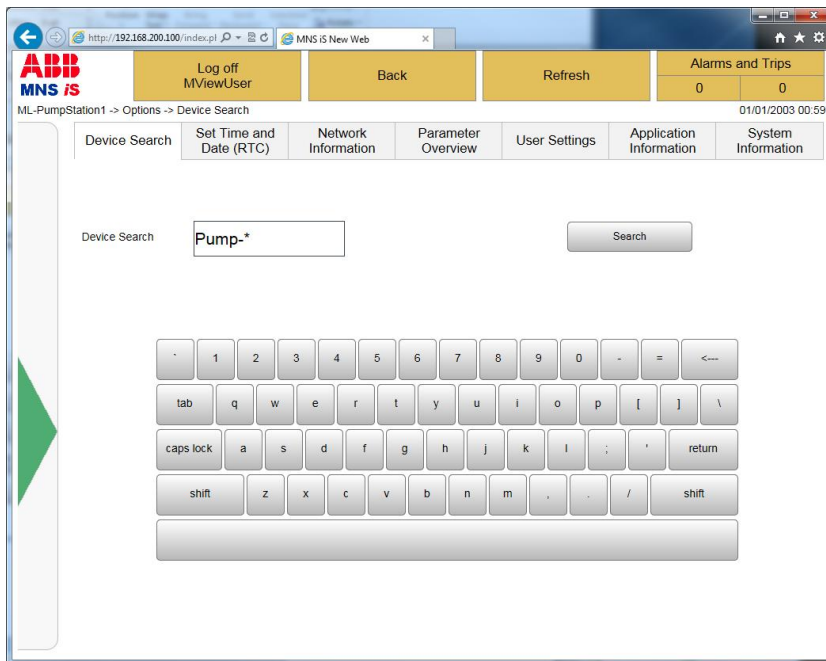


Figure 82 User Input 3

MView output:

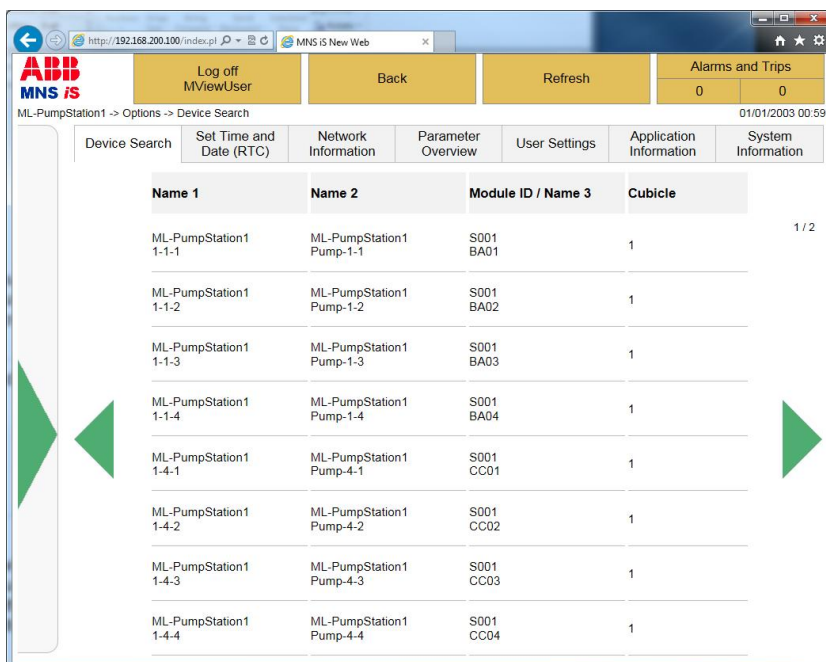


Figure 83 Search Result 3

Result: Several Power Modules were found. In this case the selected Power Modules are connected to the same *MLink* (PumpStation1). If the user selects one of these Power Modules a redirection is done to the Operate Screen of the dedicated *MControl*.

The green arrows on the right and left hand side can be used for navigation.



If a Power Module is not found with a known Device Identifier please check the *MView* ID. The *MView* ID enables the user to create logical networks. Only *MControls* connected to a *MLink* parameterised with the *MView* ID for that particular network segment will be displayed. For more information please see chapter [MView ID](#)

Set Time and Date

MNSiS provides the possibility of using an external time server (NTP) or an internal system clock (RTC). To change between both time synchronization methods *MNavigate* has to be used.

Synchronization methods and options

Depending upon the user profile setting and project configuration “Time Synchronization” the following options are possible:

No time synchronization configured

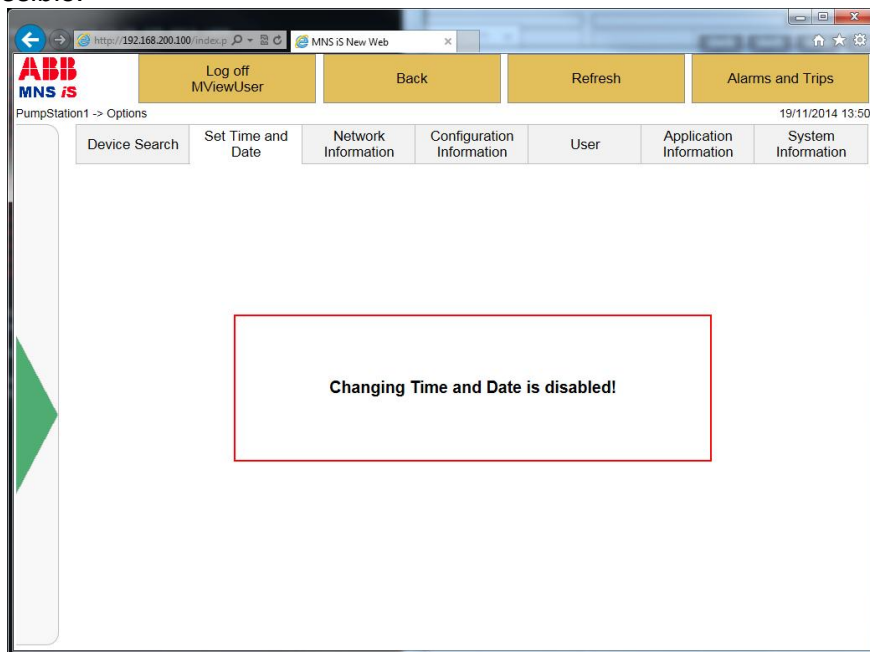


Figure 84 MLink Device Setup, no time synchronization configured

User doesn't have sufficient user rights

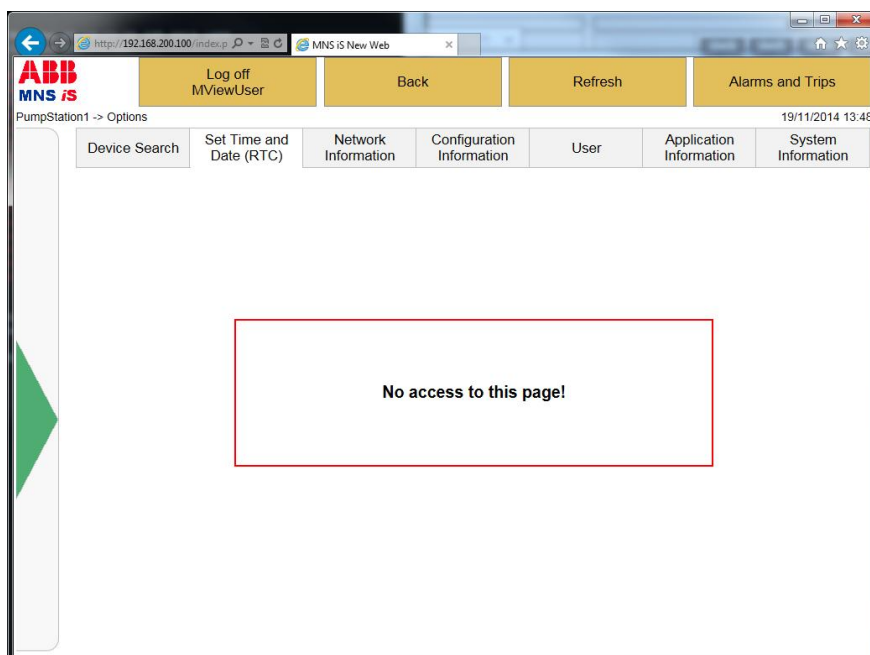


Figure 85 MLink Set Time and Date, no user right for setting the MLink system time (RTC)

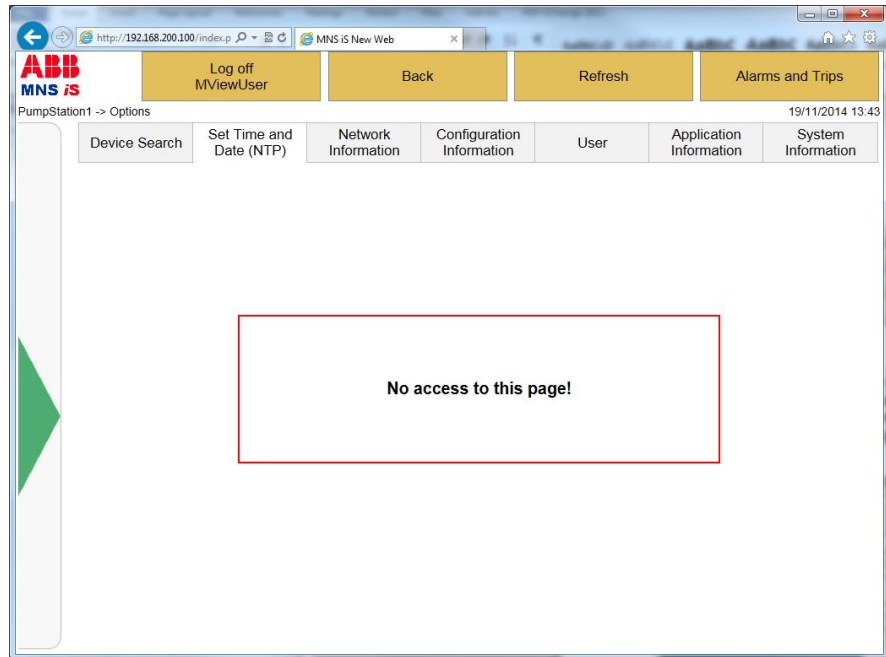


Figure 86 MLink Device Setup, no user right for setting the MLink system time (NTP)

RTC time synchronization

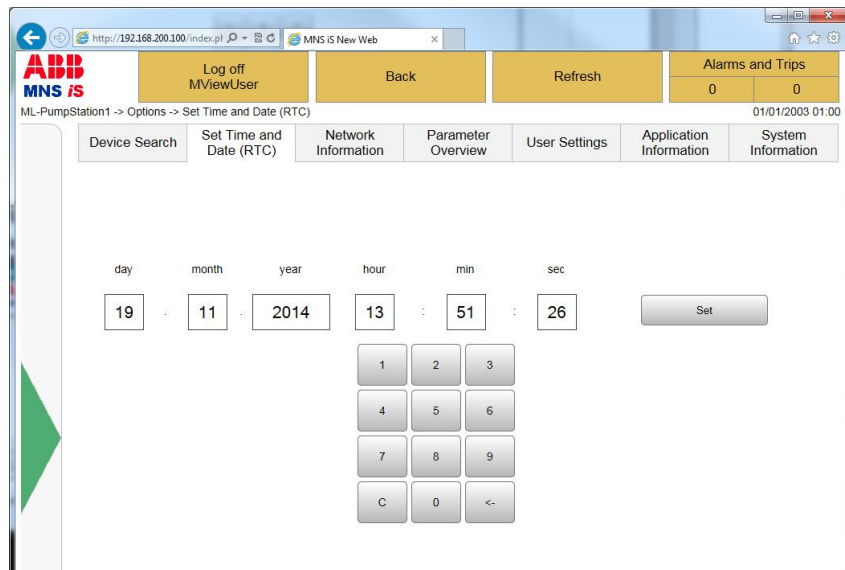


Figure 87 MLink Device Setup, RTC time synchronization

Here the user has the possibility to set the MLink system time.

NTP time synchronization


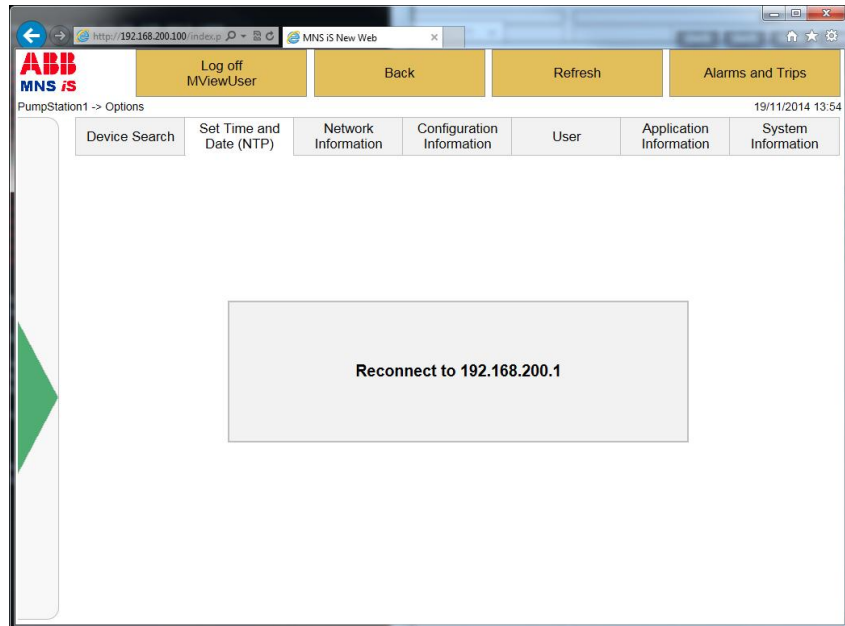


Figure 88 MLink Device Setup, NTP time synchronization


Here the user has the possibility to request the time from the time server again.

Local Time Zone Support


After enabling **Use Time Zone Offset** in *MNavigate* the WEB interface shows localized time information on the system menu and on Alarm / Event overview page. As soon as the parameter file is downloaded the local time zone offset is taken out of the client machine and added to *MLink* system time information.

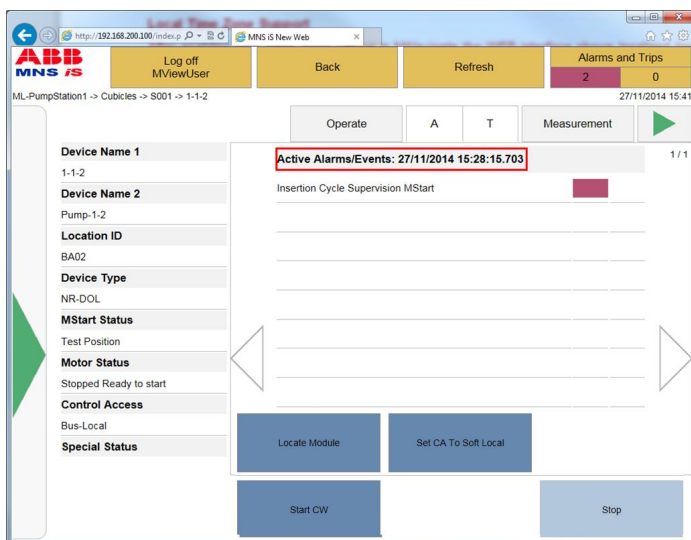

If the **Use Time Zone Offset** setting is disabled the **UTC** system time is shown in system menu.

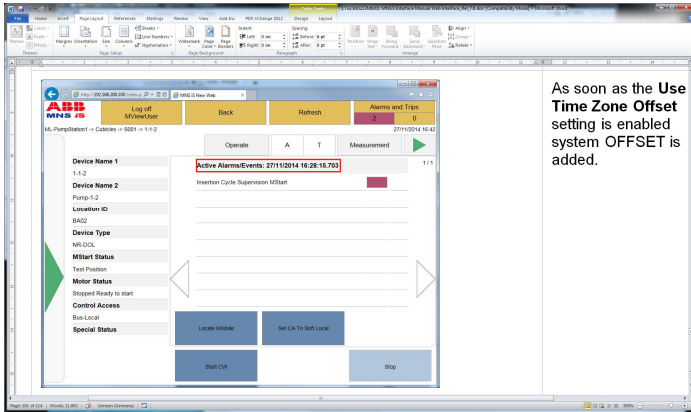

As soon as the **Use Time Zone Offset** setting is enabled system OFFSET is added.

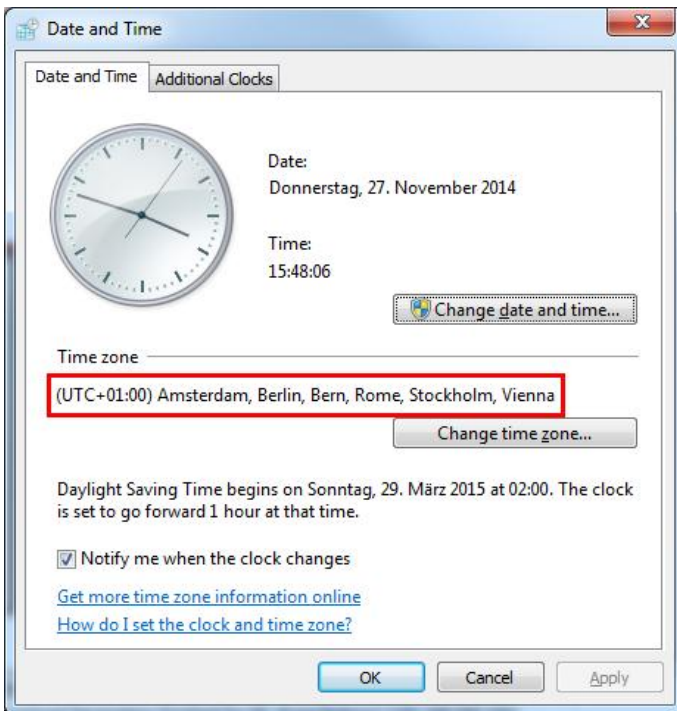

The Web Interface is running on a machine having an offset of 1h (1h offset).

Network Information

The **Network Information** page displays information about *MLink* Ethernet IP address and Subnet masks settings which are configured in MNavigate.

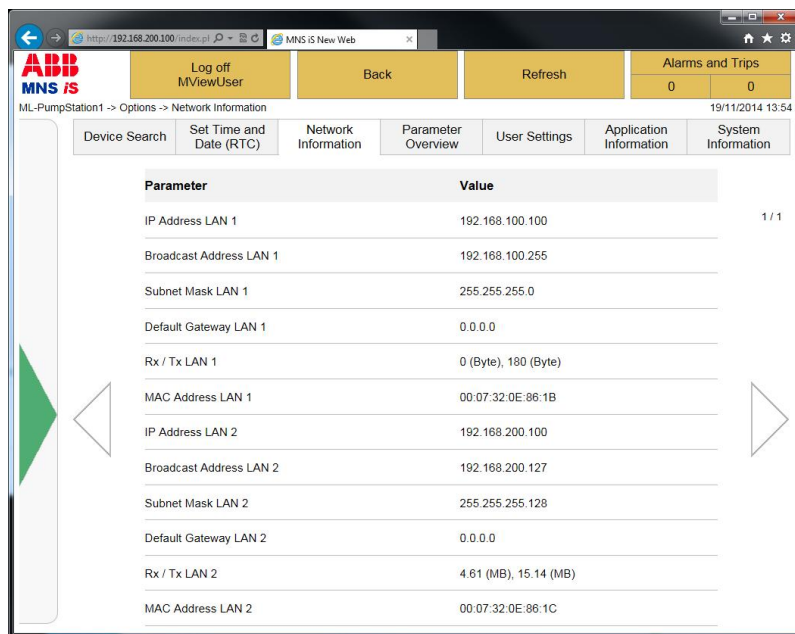


Figure 89 Network Information Dialog

Configuration Information

The 'Parameter Overview' page displays information about *MLink* Parameters i.e. OPC ID, MView ID, Access Control which are configured in MNavigate.

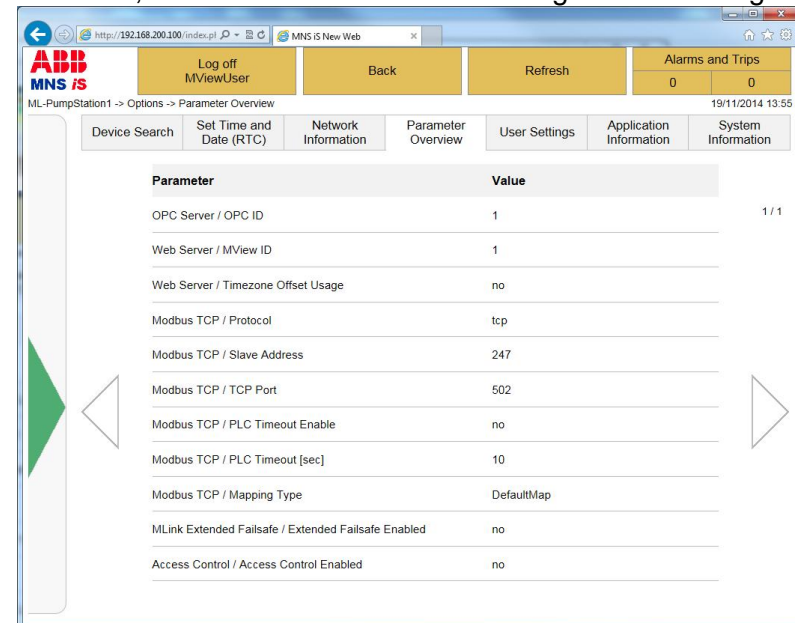


Figure 90 Parameter Overview - MLink

User Settings

The 'User Settings' page displays information about the user privileges of the user currently logged in. User privileges can be modified by using MNavigate.

For more details refer to the MNS iS MNavigate Help File.

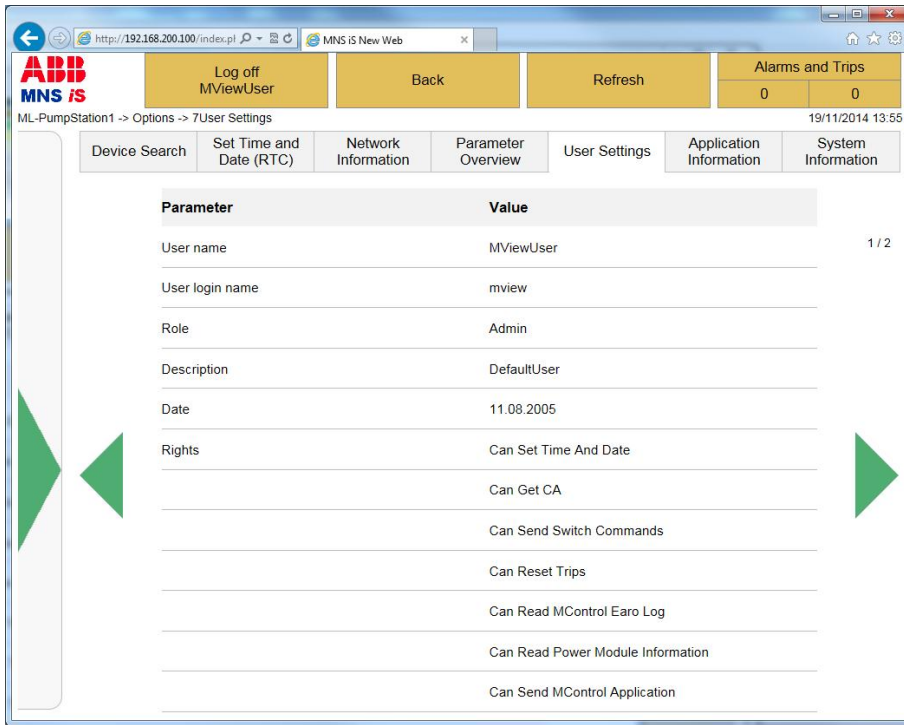


Figure 91 User Settings dialog

The green arrows on the right and left hand side can be used for navigation.



Application Information

The **Application Information** page displays information about *MLink* application version and the status of the single applications. This information might be required by ABB Service in case of detailed system diagnosis is required.

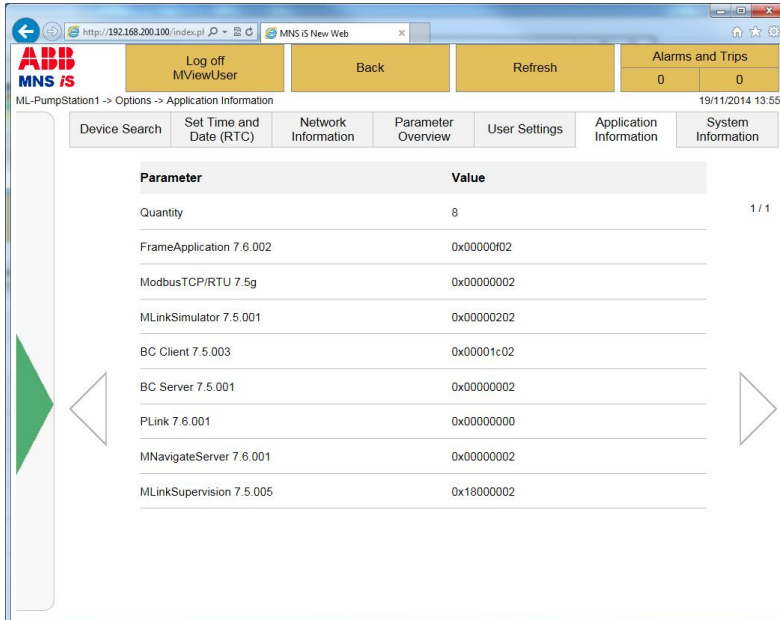


Figure 92 *MLink* Application Information

System Information

The **System Information** page displays information about *MLink* related device information, e.g. Serial Number, Memory Usage, etc. This information might be required by ABB Service in case of detailed system diagnosis is required.


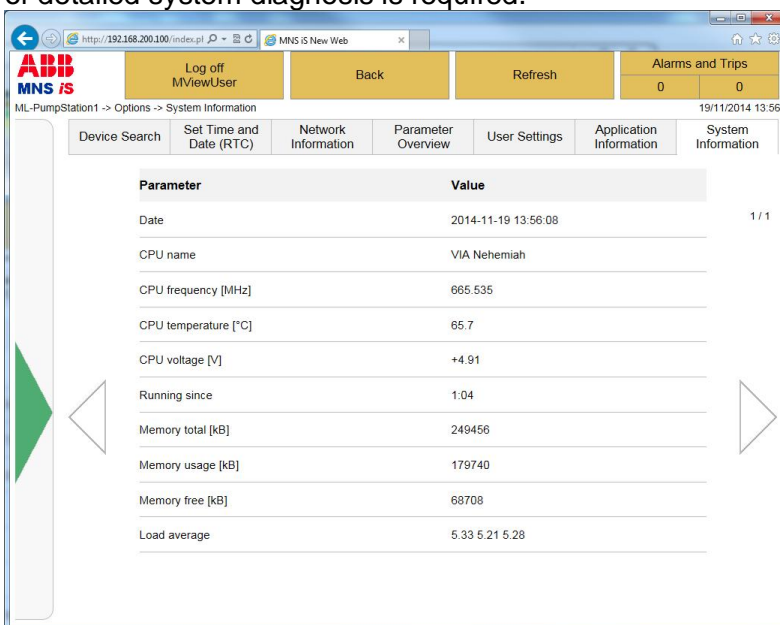



Figure 93 *MLink* System Information

Select before operate

For safety reasons the active buttons (for sending commands to *MControl* / *MConnect*) work according to “select before operate” in two steps:

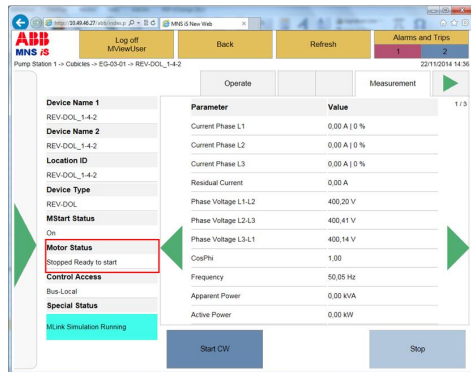


Click on




The example left shows the sequence required to start a motor in the CW direction from the *MView*, for this to be possible the Control Access must be in the Bus-Local state.

With the first click the button is selected and adopts another colour (dark blue). Motor Status indication remains unchanged.

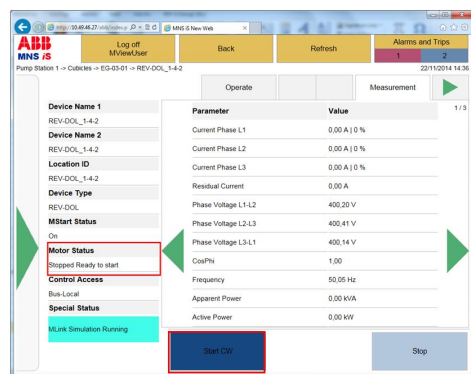


Click on




With a second click on the selected button the command is finally sent to the *MControl*.

Motor Status then changes to 'Runs CW' and current flow is indicated.

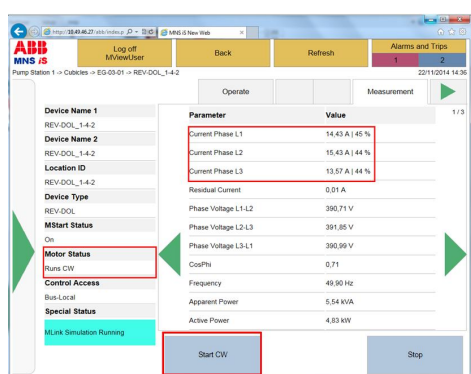

Command Selector



Device specific commands can be sent to the *MControl* / *MConnect*. In this example (motor control) commands like “Start CW”, “Start CCW” or “Stop” are listed. “Stop” is inactive (light blue) since the motor is stopped. Other factors influencing buttons to be inactive are the control access, user rights, and parameterisation and configuration of the modules.

Redundancy

The web interface will always use data received from the primary MLink. Should a change over occur the web interface will be automatically redirected to the backup MLink. The following sequence will run when a changeover of the primary MLink is initiated. For more information please refer to the MNS iS Redundancy Manual.

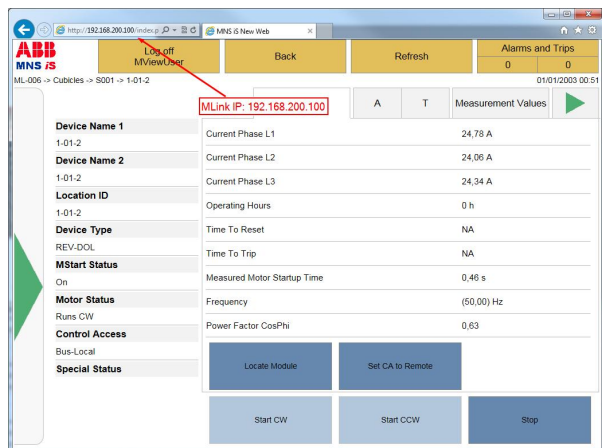


Figure 94 Screen before redundancy event

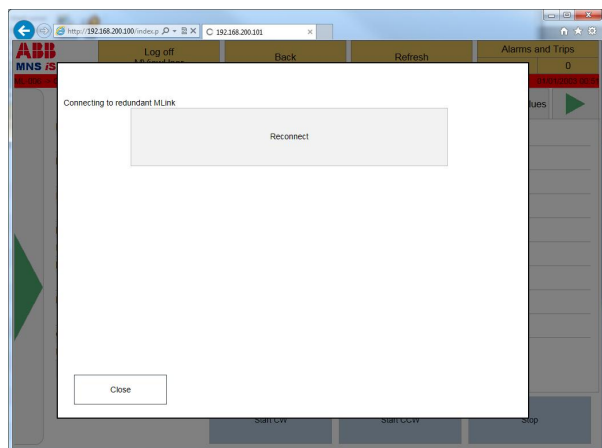


Figure 95 Screen during redundancy redirection

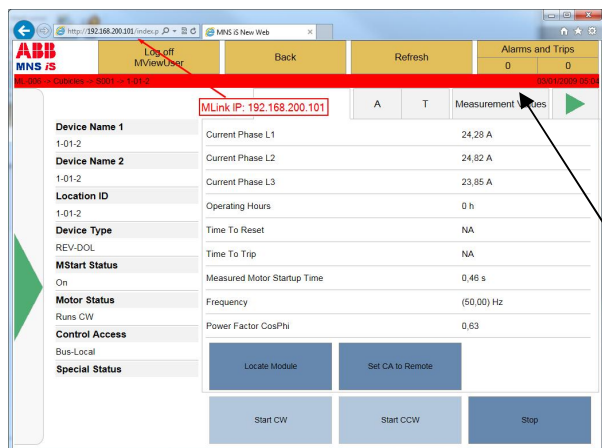


Figure 96 Screen after redundancy event



Change over of MLink initiated.

Web Interface redirection

Web Interface redirection



The red stripe on the top of the window is indicating a redundancy error. Please refer to the MNS iS Interface Manual Redundancy for more detailed information.

MView ID

The MView ID enables the user to create MNS iS Ethernet network segments without the need of physical splitting. This could be required in systems containing a large number of MLink. In these circumstances it may not be possible to handle all MLink in one MView, because of the size of the MLink-list available, (one entry for every physically connected MLink). By using the MView ID the number of accessible MLink can be reduced.

By using MNavigate a MView ID can be configured for each MLink. The example below will describe the system behaviour if this function is used.

	MLink1	MLink2	MLink3	MLink4
M View 1	yes	yes	yes	no
M View 2	no	no	no	yes

The MView ID has to be set accordingly by using MNavigate. After downloading the settings to MLink and adapting the start-up page for MView as described below the following segmentation is created:

M View name	MView Start-up page
M View 1	MLink 1 or MLink 2 or MLink 3
M View 2	MLink 4

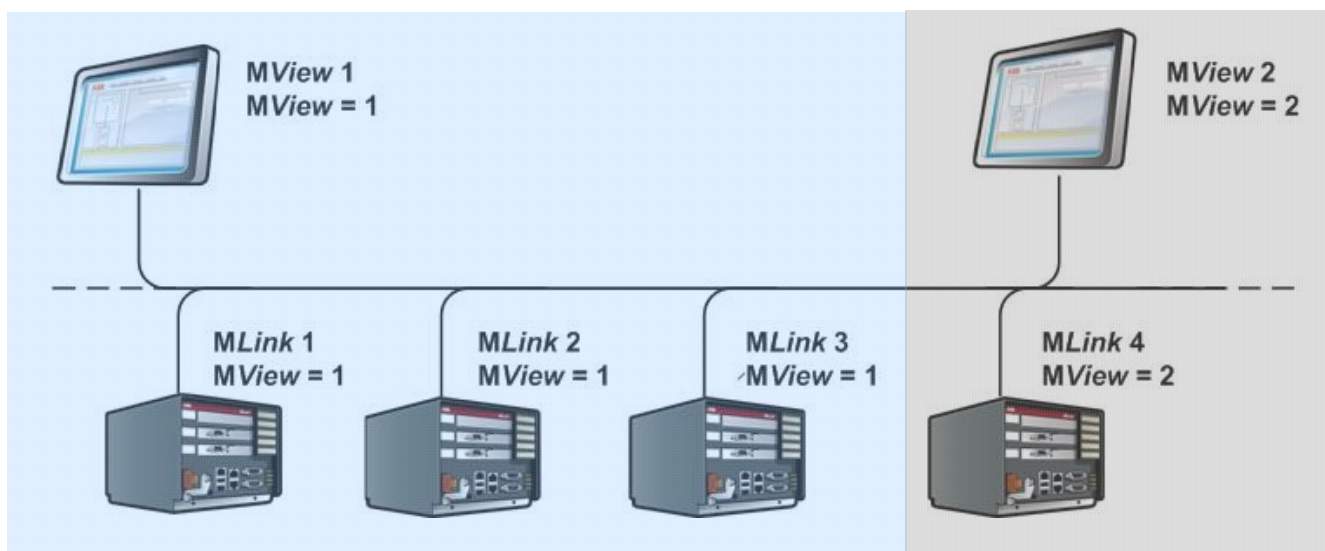


Figure 97 MView ID – Ethernet network segmentation



MLink having no MLink-ID support (previous to MNS iS V5.3) are available / visible in all logical network segments.

Automatic Logoff

MNS iS supports a user authentication mechanism on MView level that handles user roles and user rights. This feature can be configured in MNavigate. Depending on the user role different activities can be executed by a dedicated user. To prevent any unauthorized access to the system via MView a user logoff should be done after finalization of operation.

To avoid any misuse an additional **Automatic Logoff** can be configured in MNavigate which ensures a session termination after the configured time interval if no user interaction (button click) is detected. The remaining time of the session is indicated in the button showing the current logged in user.



The timer value is restarted automatically if user is navigating through the web pages (refresh on any click inside the window).

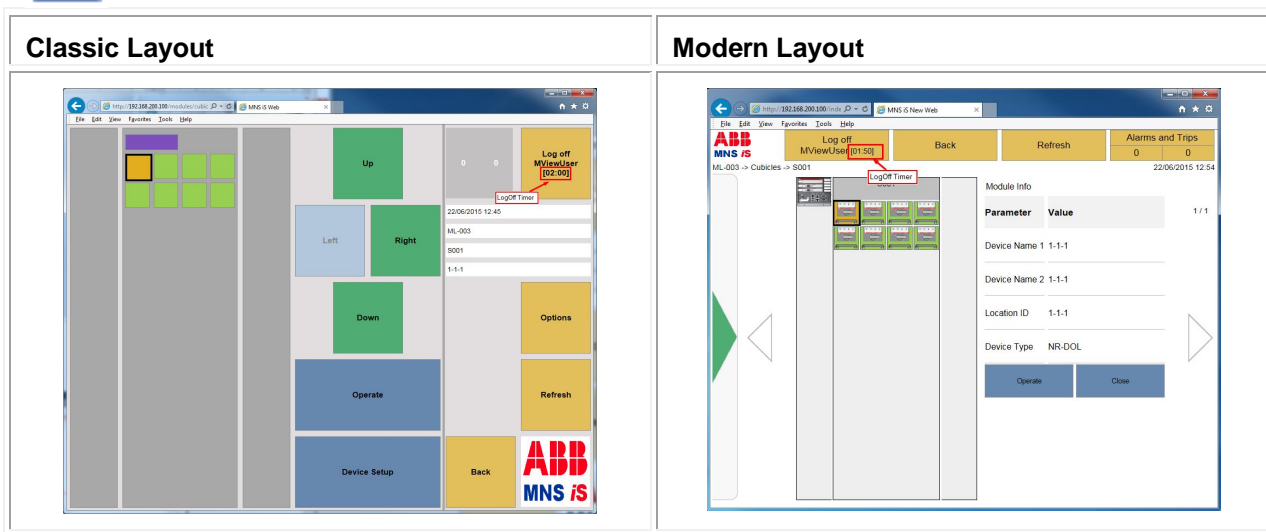


Figure 98 Screen after redundancy event

20 seconds before the logoff timer is elapsing an attention message is shown:

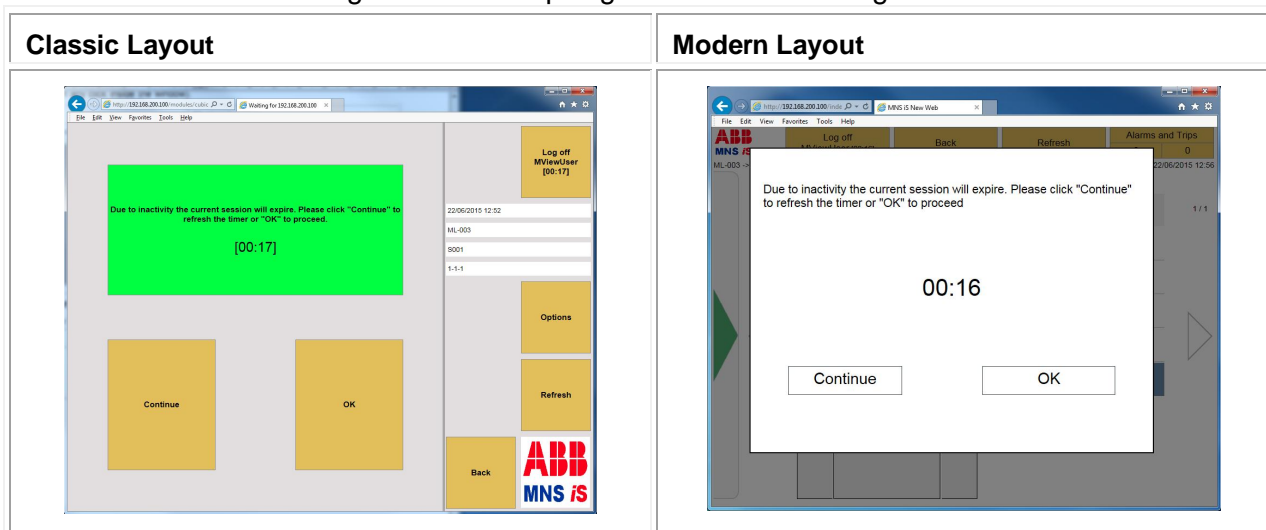


Figure 99 Screen after redundancy event

Continue: This option is restarting the logoff timer.

OK: This option is closing the dialog box and the logoff timer is not restarted.

If no option is selected the user will be logged off automatically after the indicated timer expires.




WEB Server Interface settings


The following WEB interface settings can be customized

- User and user roles
- Language – native languages support
- User colour schemes – Web Colour Setting
- Date & Time Format (system menu)
- MView ID
- Time Zone Offset
- Single Trip Reset
- Automatic Logoff

For more details refer to the MNS *iS* *MNavigate* Help File.

Troubleshooting and Maintenance

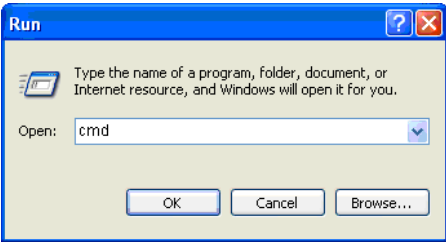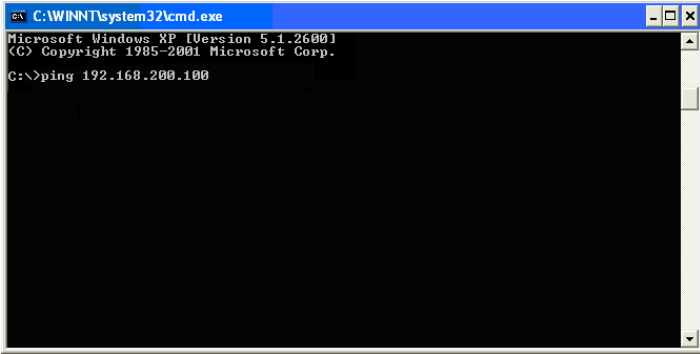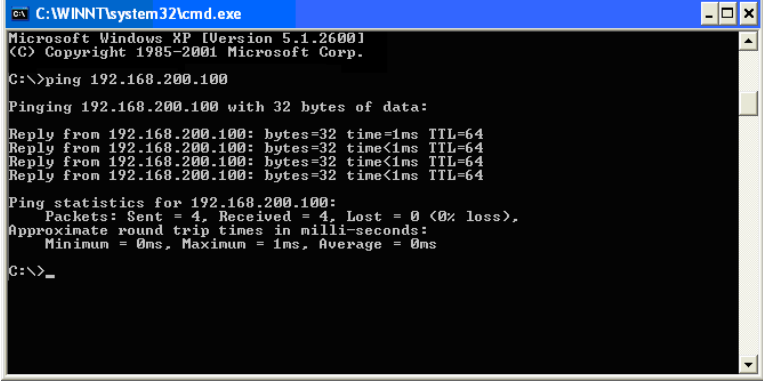Problem	Solution
No access to <i>MLink</i> with the web interface	Check if the correct IP address in the address bar of the web interface has been entered.
	Check if the <i>MLink</i> is powered on and no fault indication is on the LED indication of <i>MLink</i> .
	Check if the Web Server option is activated. This can be done using <i>MNavigate</i> and verification of the settings for the <i>MLink</i> .
	<p>Check if the network configuration is correct; use a ping command to verify that the <i>MLink</i> is reachable. Open a command window on the PC:</p> <ul style="list-style-type: none"> Start / Run, then type in "cmd" and select Enter  <ul style="list-style-type: none"> Enter the ping command with the correct IP address: <i>ping xxx.yyyy.zzz.aaa</i>  <ul style="list-style-type: none"> If no reply is received, check the cable connection of the PC or <i>MView</i> and <i>MLink</i>. If a reply is received the connection is ok. 

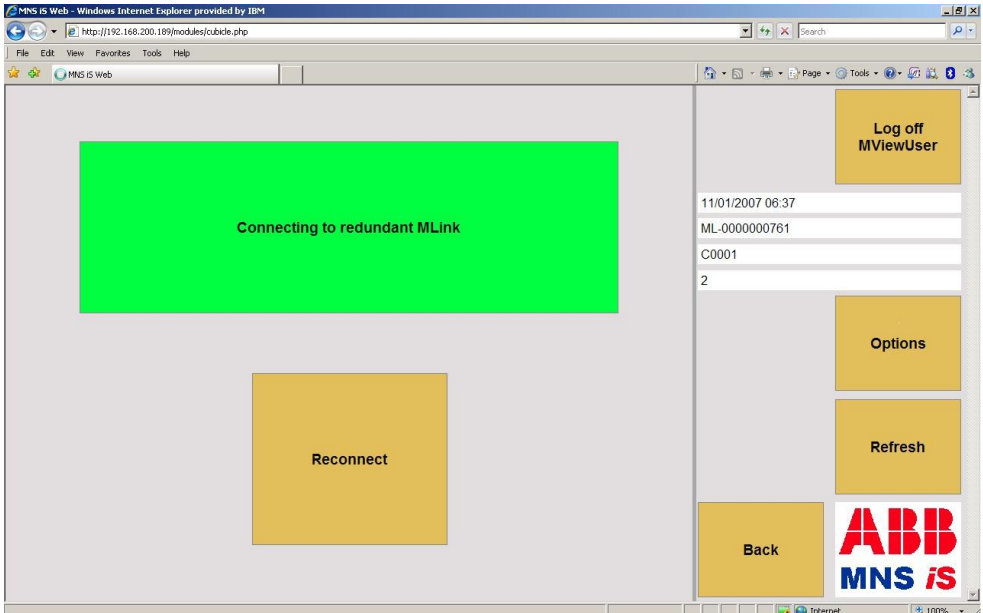Problem	Solution
	<p>If it is still not possible to reach the <i>MLink</i>. Remove the CF card from <i>MLink</i>, insert the CF card into a card reader connected to <i>MNavigate</i> and write the <i>MLink</i> data again to the CF card. Re-insert the card to <i>MLink</i>, start <i>MLink</i> and check communication.</p>
<p><i>MLink</i> communication problem</p>	<p>In case of the following kind of error please check the Ethernet cable connections (LAN 2 on <i>MLink</i> side) and press the Reconnect button.</p> 

Contact us

ABB Low Voltage Systems

Publication Editor:

ABB Automation Products GmbH

Ladenburg, Germany

Local Contacts on

www.abb.com/mns

Copyright© 2015 ABB

All rights reserved.

Publication No.

1TGC910224M0201